LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 12/23/2022 Expiration Date: 12/22/2023

Property Owner: Jeremiah & Sara Helgert

Mailing Address: [redacted]

Telephone: [redacted] Email:

Installer: Royden Caldwell License #: 171

Proposed Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Gravity system with standard 2' wide trenches, perf pipe & drain rock

Parcel Description:

Legal: S6 T35N R27W, COS 3898, Parcel B, 35.33 acres

Property Address: Moonshine Mountain Trail, Rexford Assessment Code: 7799

Approved Design Criteria:

# of Bedrooms: 3 Septic Tank Size: 1000 gallons Trench Width: 24 inches

# of Laterals: 3 Length of Laterals: 100 feet Trench Depth: 24 – 36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Kathi J. Hooper, R.S.

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

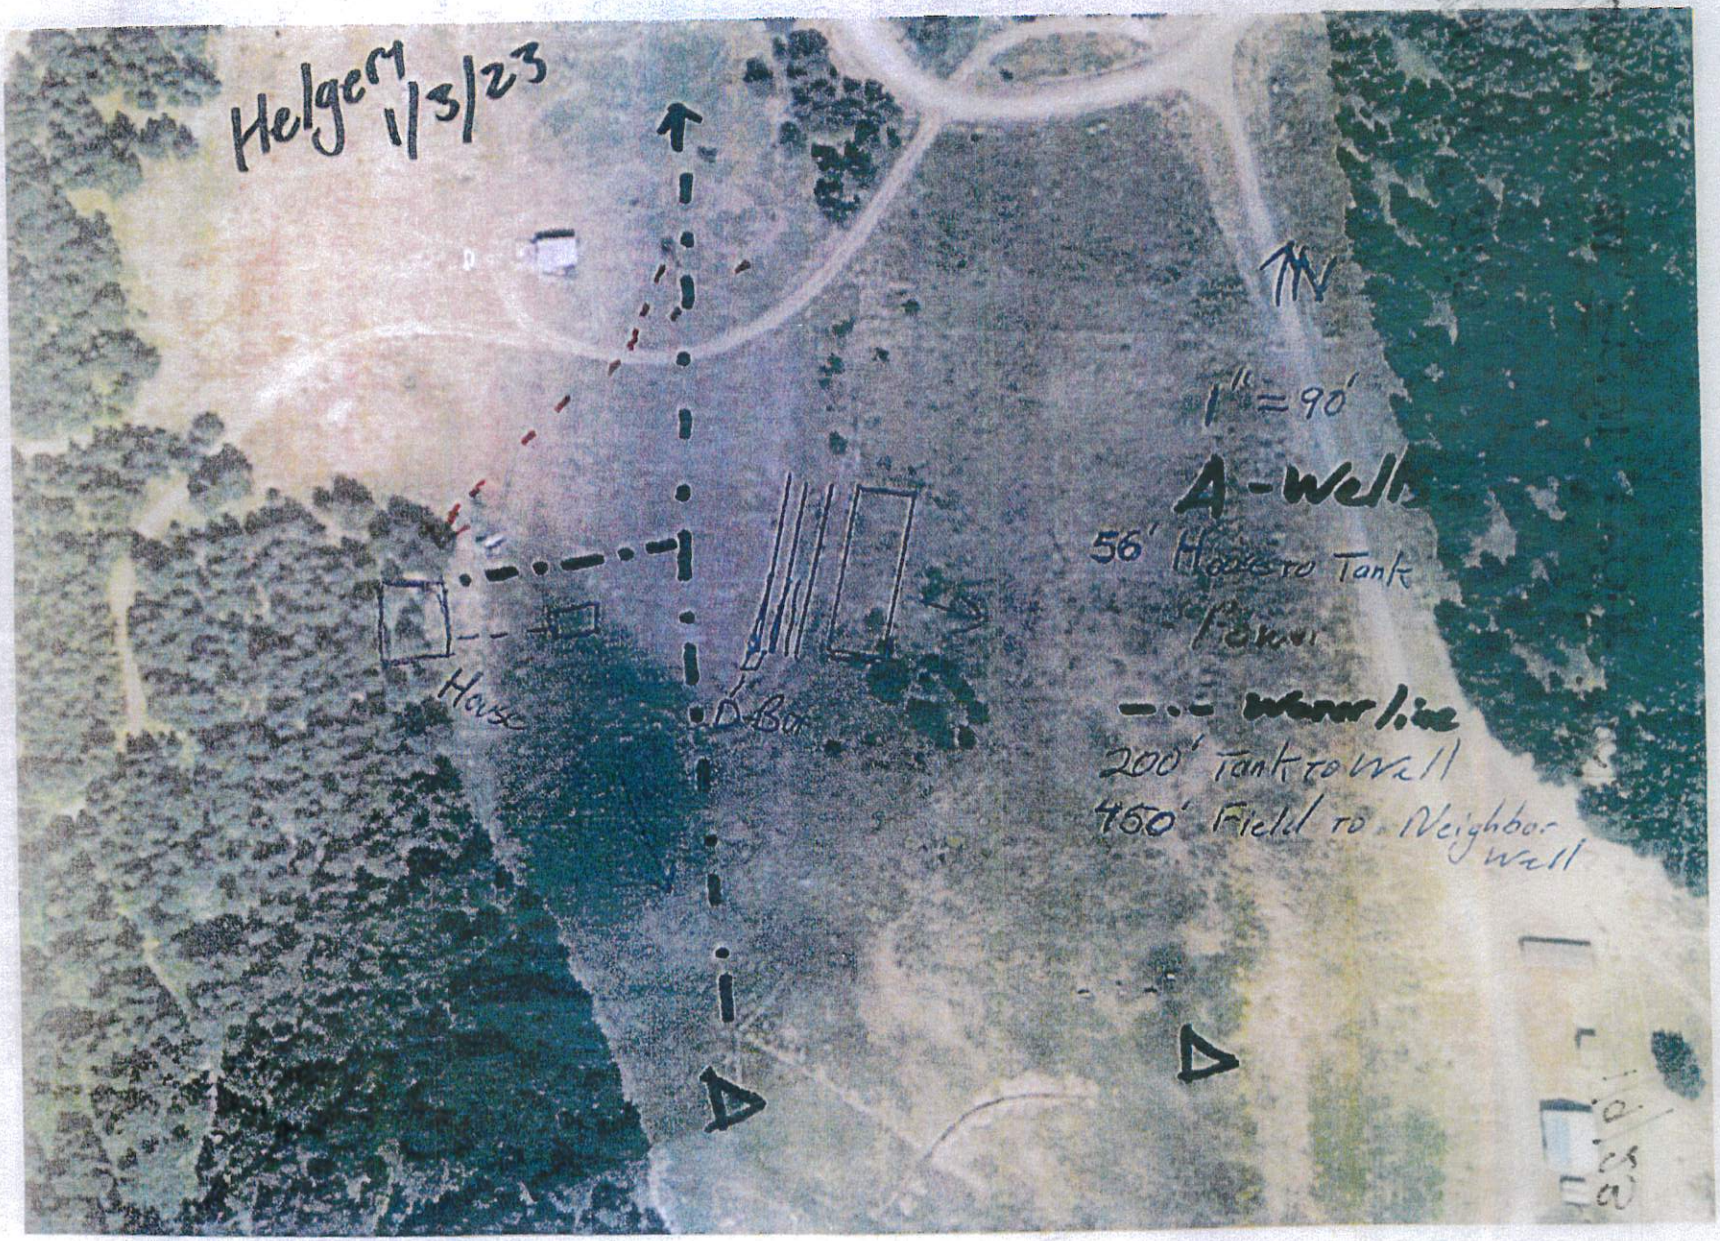
I, Maranda Davis *, have inspected this system and found it to be in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.*

Signed: Maranda Davis, Envir. Health Tech. *Date:* 1/9/23

√ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Helgem 1/3/23
N
1" = 90'
A-well
56' Hoosero Tank
Power
Water line
200' Tank to well
460' Field to Neighbor well
House
D-Bar