LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 11/06/2022 Expiration Date: 11/05/2023

Property Owner: Andy & Malaina Hollinger

Mailing Address: [redacted]

Telephone: [redacted] Email: [redacted]

Installer: Billie B Gardner License #: 177

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Gravity system with standard trenches, chambers

Parcel Description:

Legal: Mount Snowy Vista, Lot 6, S11 T29N R31W, 6.08 acres

Property Address: 113 Deerfield Rd, Libby, MT Assessment Code: 55024

Approved Design Criteria:

# of Bedrooms: 5 Septic Tank Size: 1500 gallons Trench Width: 24 inches

# of Laterals: 3 Length of Laterals: 65 feet Trench Depth: 24-36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. 25% reduction given for chambers. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

I, Miranda Davis *, have inspected this system and found it to be in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.*

Signed: Miranda Davis, Envir. Health Tech. *Date:* 12/8/22

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


LINCOLN COUNTY, MONTANA

LOT 6, LOT LAYOUT

PER C.O.S. 6731
SECTION 11 & 12, TWP. 29 N., R. 31 W., P.M.M.
FOR: ANDY HOLLINGER
DATE: OCTOBER 2022

NO KNOWN POTENTIAL SOURCES OF CONTAMINATION WITHIN 500' OF THE PROPOSED WELLS EXCEPT FOR THE PROPOSED AND EXISTING DRAINFIELDS.

NO EXISTING DRAINFIELDS WITHIN 100' OF LOT BOUNDARIES EXCEPT WHERE INDICATED.

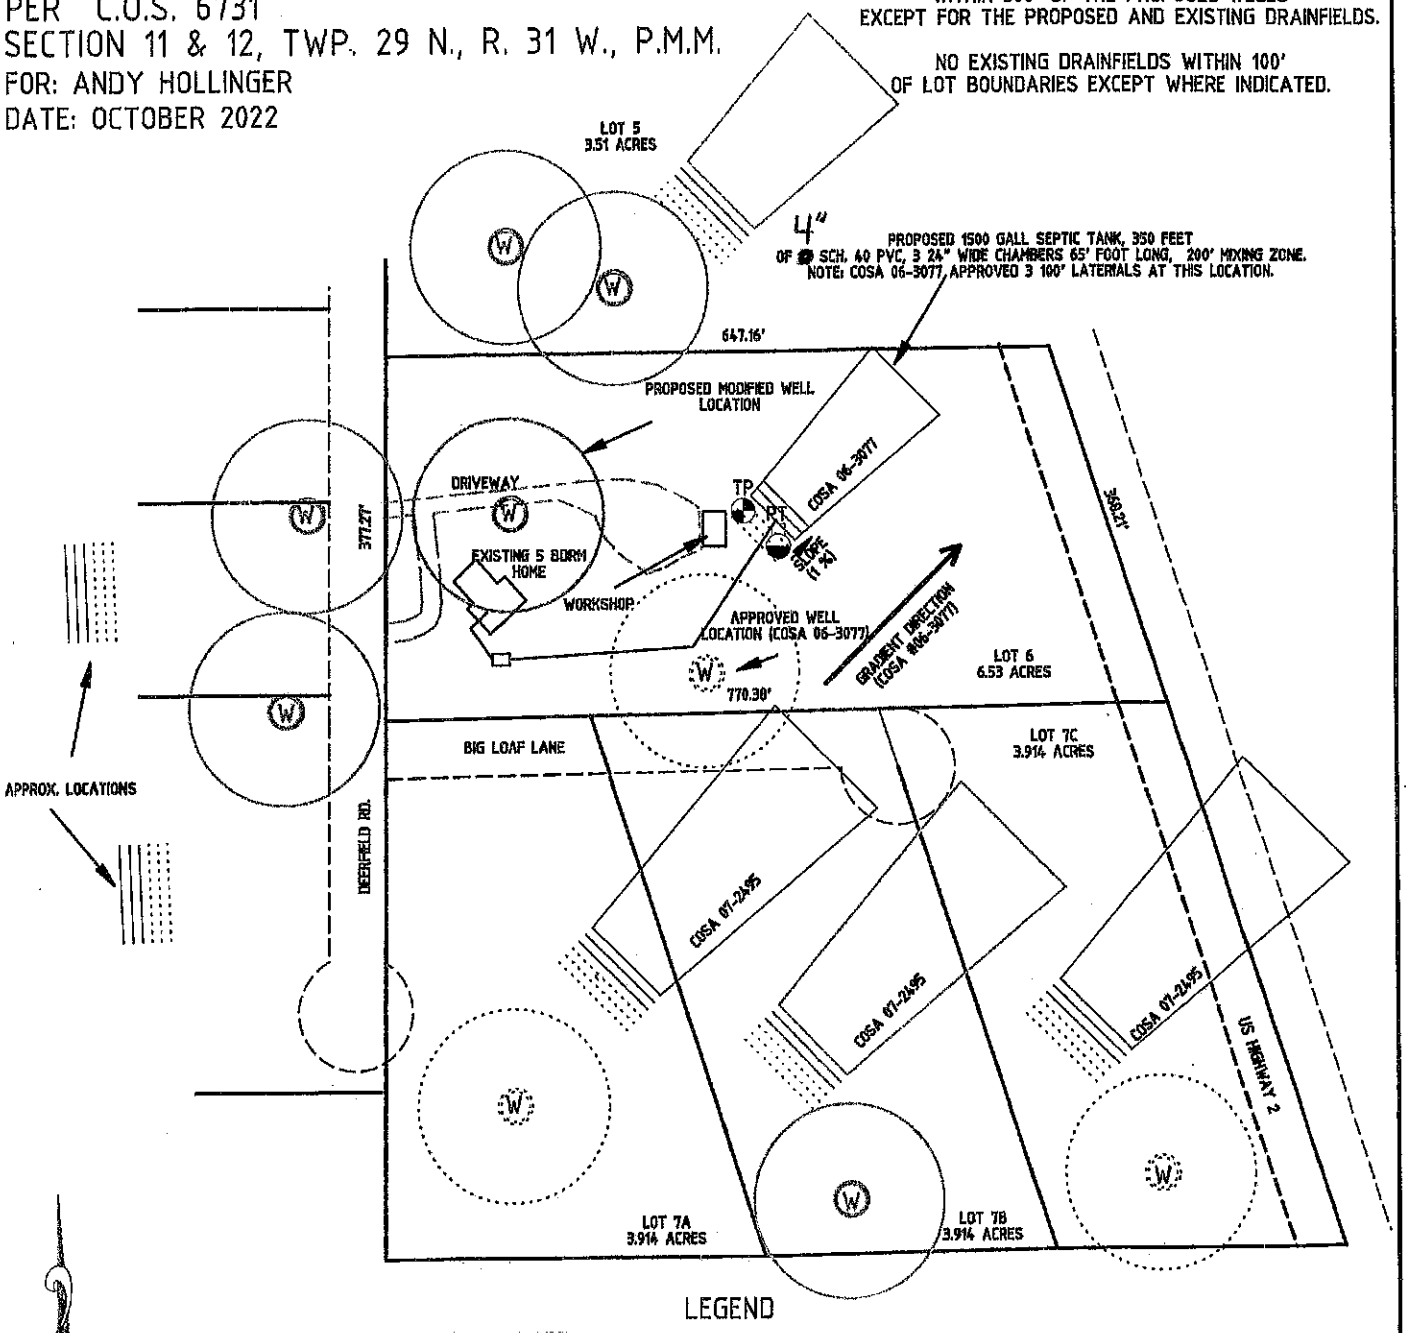

LEGEND

- APPROVED PRIMARY DRAINFIELD 3-24" X 100' TRENCHES 10' APART
- APPROVED REPLACEMENT DRAINFIELD 3-24" X 100' TRENCHES 10' APART
- EXISTING PRIMARY DRAINFIELD 3-24" X 100' TRENCHES 10' APART
- EXISTING REPLACEMENT DRAINFIELD 3-24" X 100' TRENCHES 10' APART
- WELL SITE (EXISTING)
- WELL SITE (PROPOSED)
- WELL SITE (APPROVED)
- SOIL PROFILE (COSA #06-3077)
- PERCOLATION SITE (COSA # 06-3077)

ALL TRENCHES ARE STANDARD GRAVITY FED LATERALS

SCALE
200' 200'
1" = 200'

DAVIS SURVEYING, INC.
TROY, MT. 406.295.5441

DATE: 05/10/2022
DRAWN BY: KD, PhD

FILE: HOLLINGER LOT LAYOUT