LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/08/2022

Expiration Date: 07/08/2023 RENEWAL

Property Owner: Doug & Julie Jelley

c/o:

Address: [redacted]

Telephone: [redacted] (Home)

(Work)

Installer: Elmer Brenneman

License No. 170

___XX___ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Five 88' laterals using drain rock and perf pipe.

Parcel Description:

Legal: SCENERY HILL, S15, T36 N, R27 W, ACRES 10.63, LOT 3 PM 6745

Address or Location: Lot 3

Geo/Assessors code: 0000054761

Approved Design Criteria:

Bedrooms: 4 Septic Tank Size: 1500 gallons Drainfield Size: 440 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kathi Hooper, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____


Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

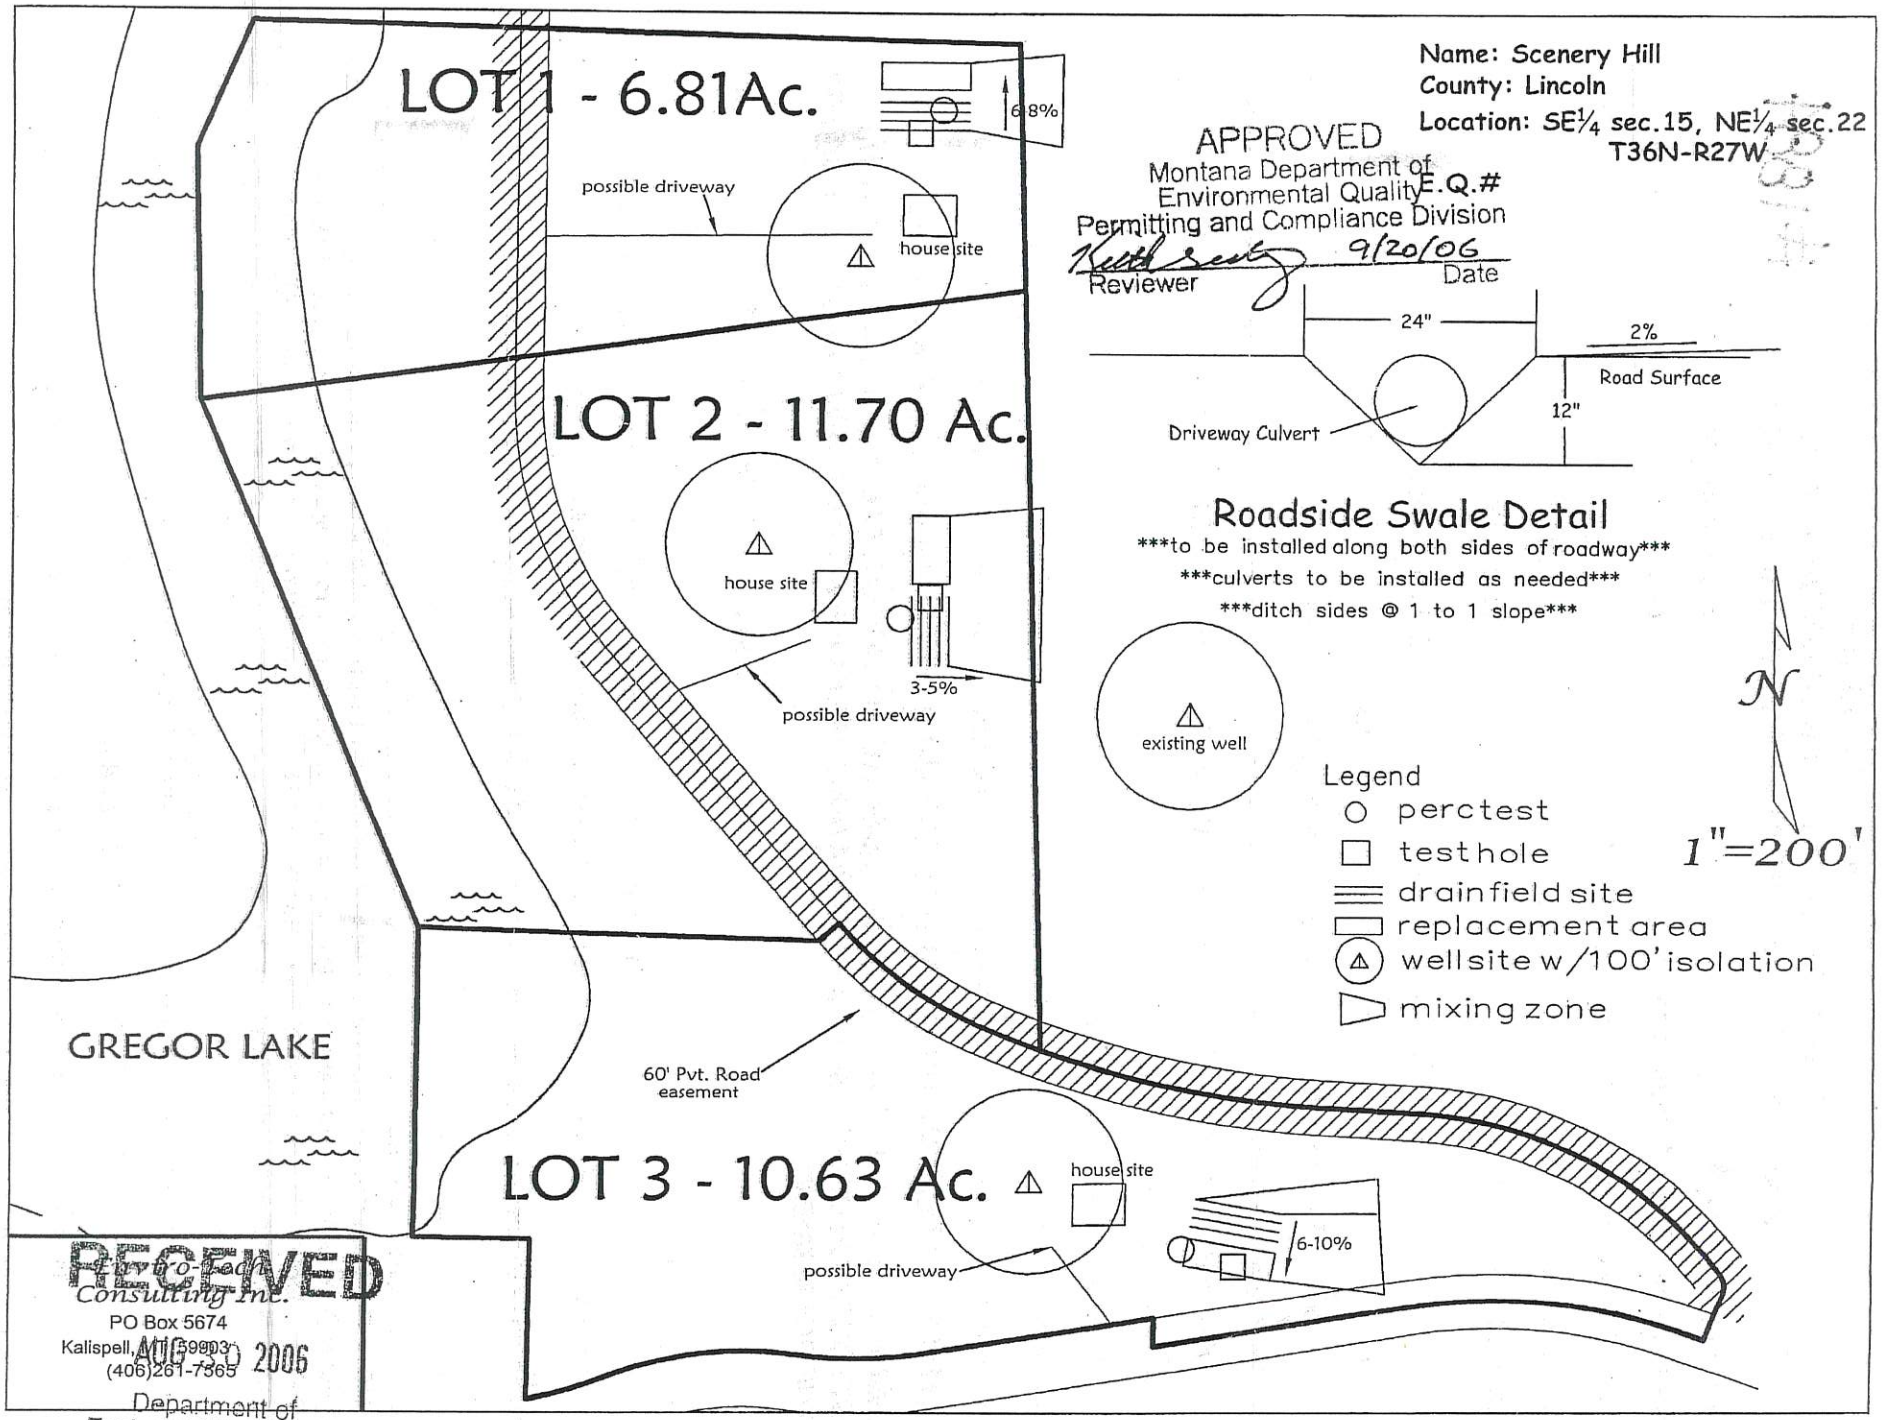

Eco-Tech Consulting Inc.
PO Box 5674
Kalispell, MT 59903
(406)261-7365

RECEIVED
AUG 30 2006
Department of Environmental Quality
Kalispell Regional Office