LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/20/2022 Expiration Date: 07/22/2023

Property Owner: David Johnson c/o:

Address: [redacted]

Telephone: [redacted] [redacted]

Installer: Koocanusa Excavating LLC License No. 135

____ Direct Connection ____ Grinder Pump Connection XX___ Lift Tank Connection

Describe: Sewer line connection to sewer main for approved Drainfield

Parcel Description:

Legal: INDIAN SPRINGS PH 1, S36, T37 N, R27 W, Lot 23 AMD, ACRES 0.835, CS 4218

Address or Location: 204 Quirk Trl Eureka, MT 59917

Tax ID: 0000055123

Approved Design Criteria:

This lot is approved for (3) bedroom . This structural size may not be exceeded, and wastewater flows are prohibited from exceeding 300 gallons per day. Any proposed increase in wastewater flows must be reviewed by and receive the approval of the HOA Review Board and the Montana DEQ Subdivision Section. Any activity that increases wastewater flows without prior review and approval is in violation of the conditions of approval and subject to enforcement action.

Special Instructions: INSTALL DIRECT SEWERLINE CONNECTION TO THE SEWER MAIN LINE FOR DRAINFIELD ACCORDING TO THE LOT LAYOUT AND DEQ APPROVAL STATEMENT E.Q. 06-332. ANY DEVIATIONS FROM APPROVED PLAN MUST HAVE PRIOR AUTHORIZATION FROM THE HOA *SUBDIVSION HOMEOWNERS* ÆNVIRONMENTAL REVIEW BOARD, DEQ AND THE DEPARTMENT.

Issued By:

Closure Statement:

I, Buck Schermerhorn, have inspected this system and found it to be in compliance with the conditions of the permit, and the DEQ Approval Statement requirements.

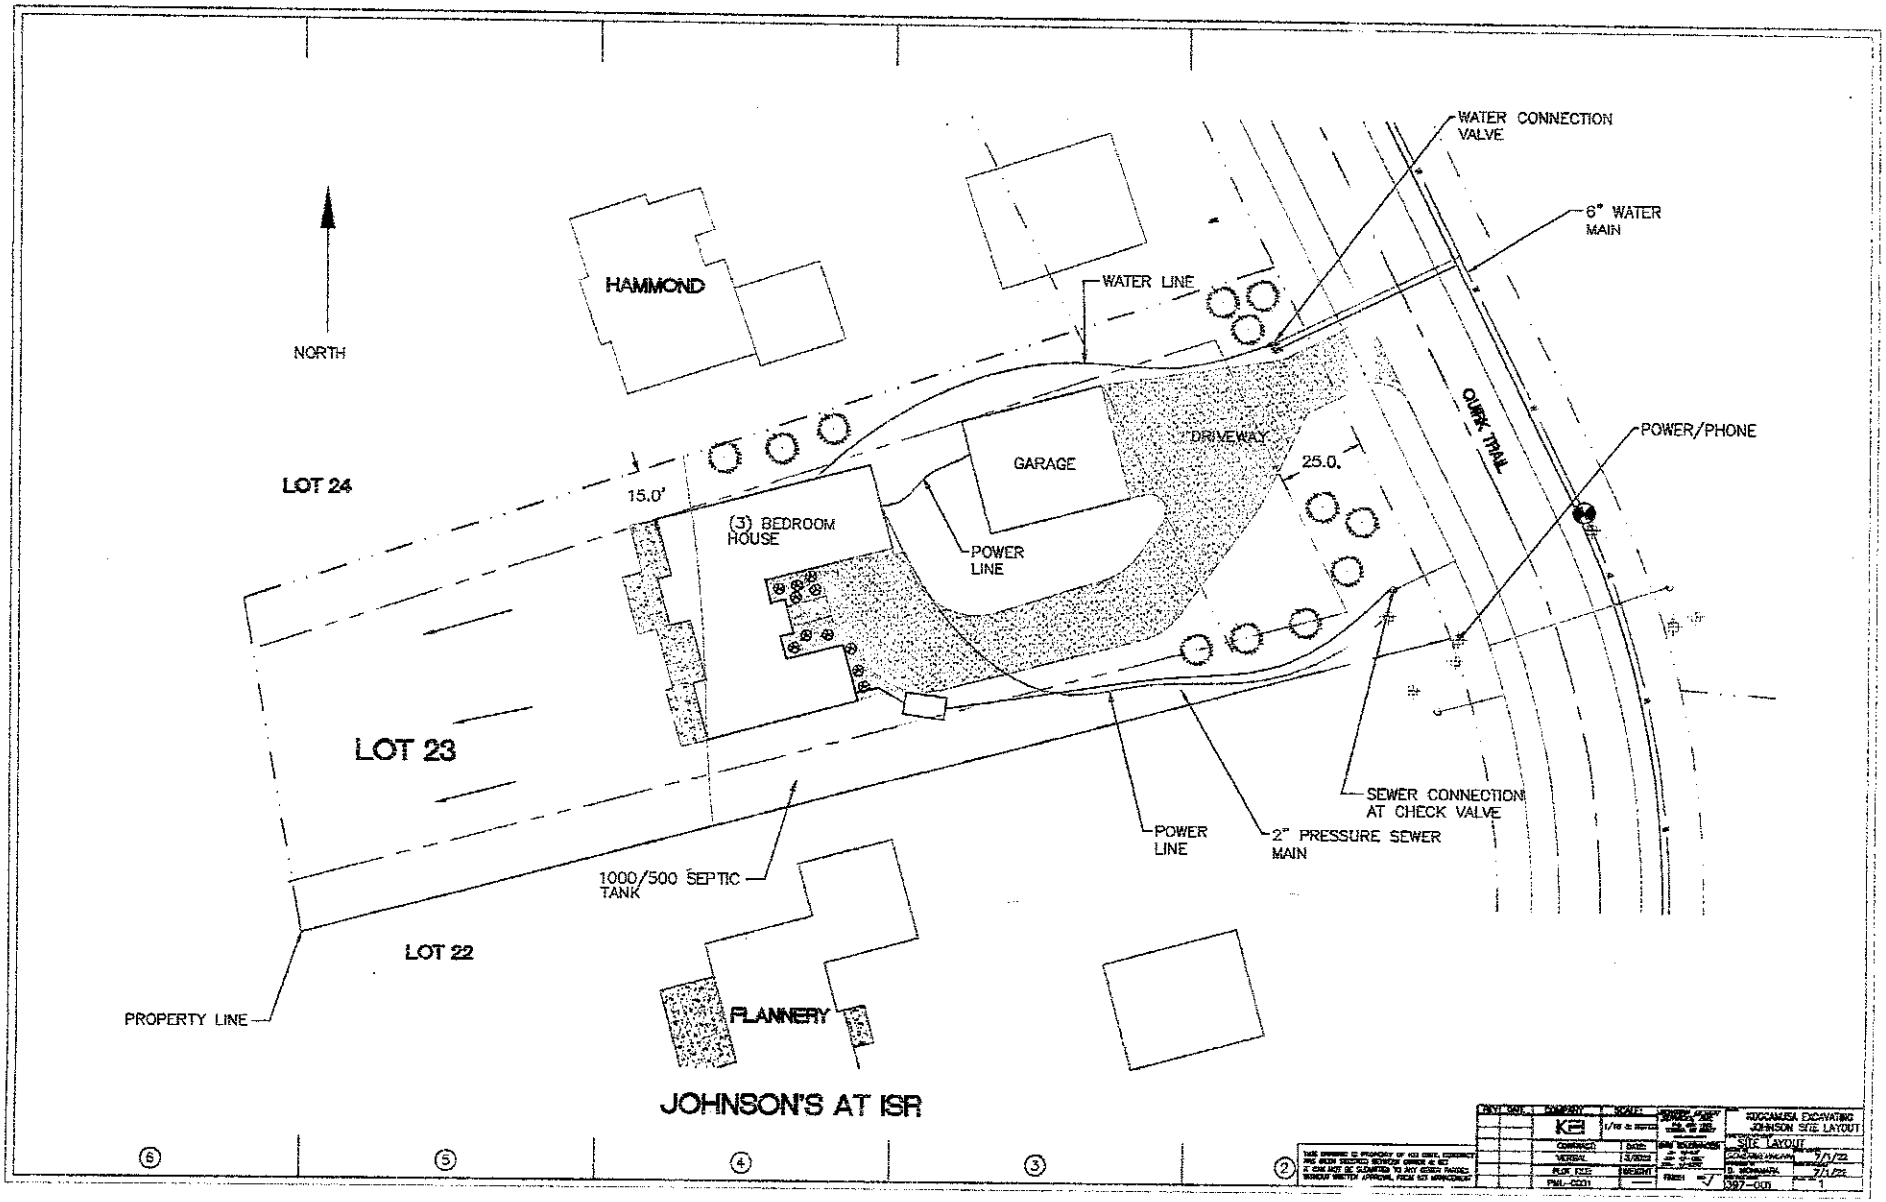
Signed: Buck Schermerhorn *Date:* 3/23/23

Title: President

NOTICE: The Department must be notified at least 48 hours prior to installation of the connection. Any connection installation not inspected by the Department or its designated representative is considered an illegal connection and may be subject to fines and/or requirements to remove or reconstruct the connection.

DISCLAIMER

This permit is not a guarantee by the Department that this connection will function properly for a prescribed period of time.


NORTH
HAMMOND
WATER LINE
WATER CONNECTION VALVE
6" WATER MAIN
QUIRK TRAIL
POWER/PHONE
LOT 24
15.0'
(3) BEDROOM HOUSE
GARAGE
DRIVEWAY
25.0'
POWER LINE
LOT 23
SEWER CONNECTION AT CHECK VALVE
POWER LINE
2" PRESSURE SEWER MAIN
1000/500 SEPTIC TANK
LOT 22
PROPERTY LINE
FLANNERY
JOHNSON'S AT ISR
6
5
4
3
2