LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 03/18/2022 Expiration Date: 03/18/2023

Property Owner: Johnson, Ronald c/o: Welch, Dustin

Address: [redacted]

Telephone: [redacted]

Installer: Dustin Welch License No. 155

XX New Installation ____ Existing System ____ Repair ____ Replacement

____ Extension ____ Other

Describe: Gravity feed system with 1,000 gallon tank and effluent filter. Gravelless absorption trenches (infiltrators) with 4 laterals @ 85-feet in length each. Laterals to be separated by at least 5-feet between trench walls.

Parcel Description:

Legal: DOUBLE CREEK, S17, T30 N, R33 W, Lot 001

Address or Location: Double Creek Subdivision Lot 001

Geo/Assessors code: 0000052557

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1,000 gallon Drainfield Size: 340 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Nicholas Raines

Closure Statement:

I, Dustin Welch, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: [signature] Date: 1-26-24

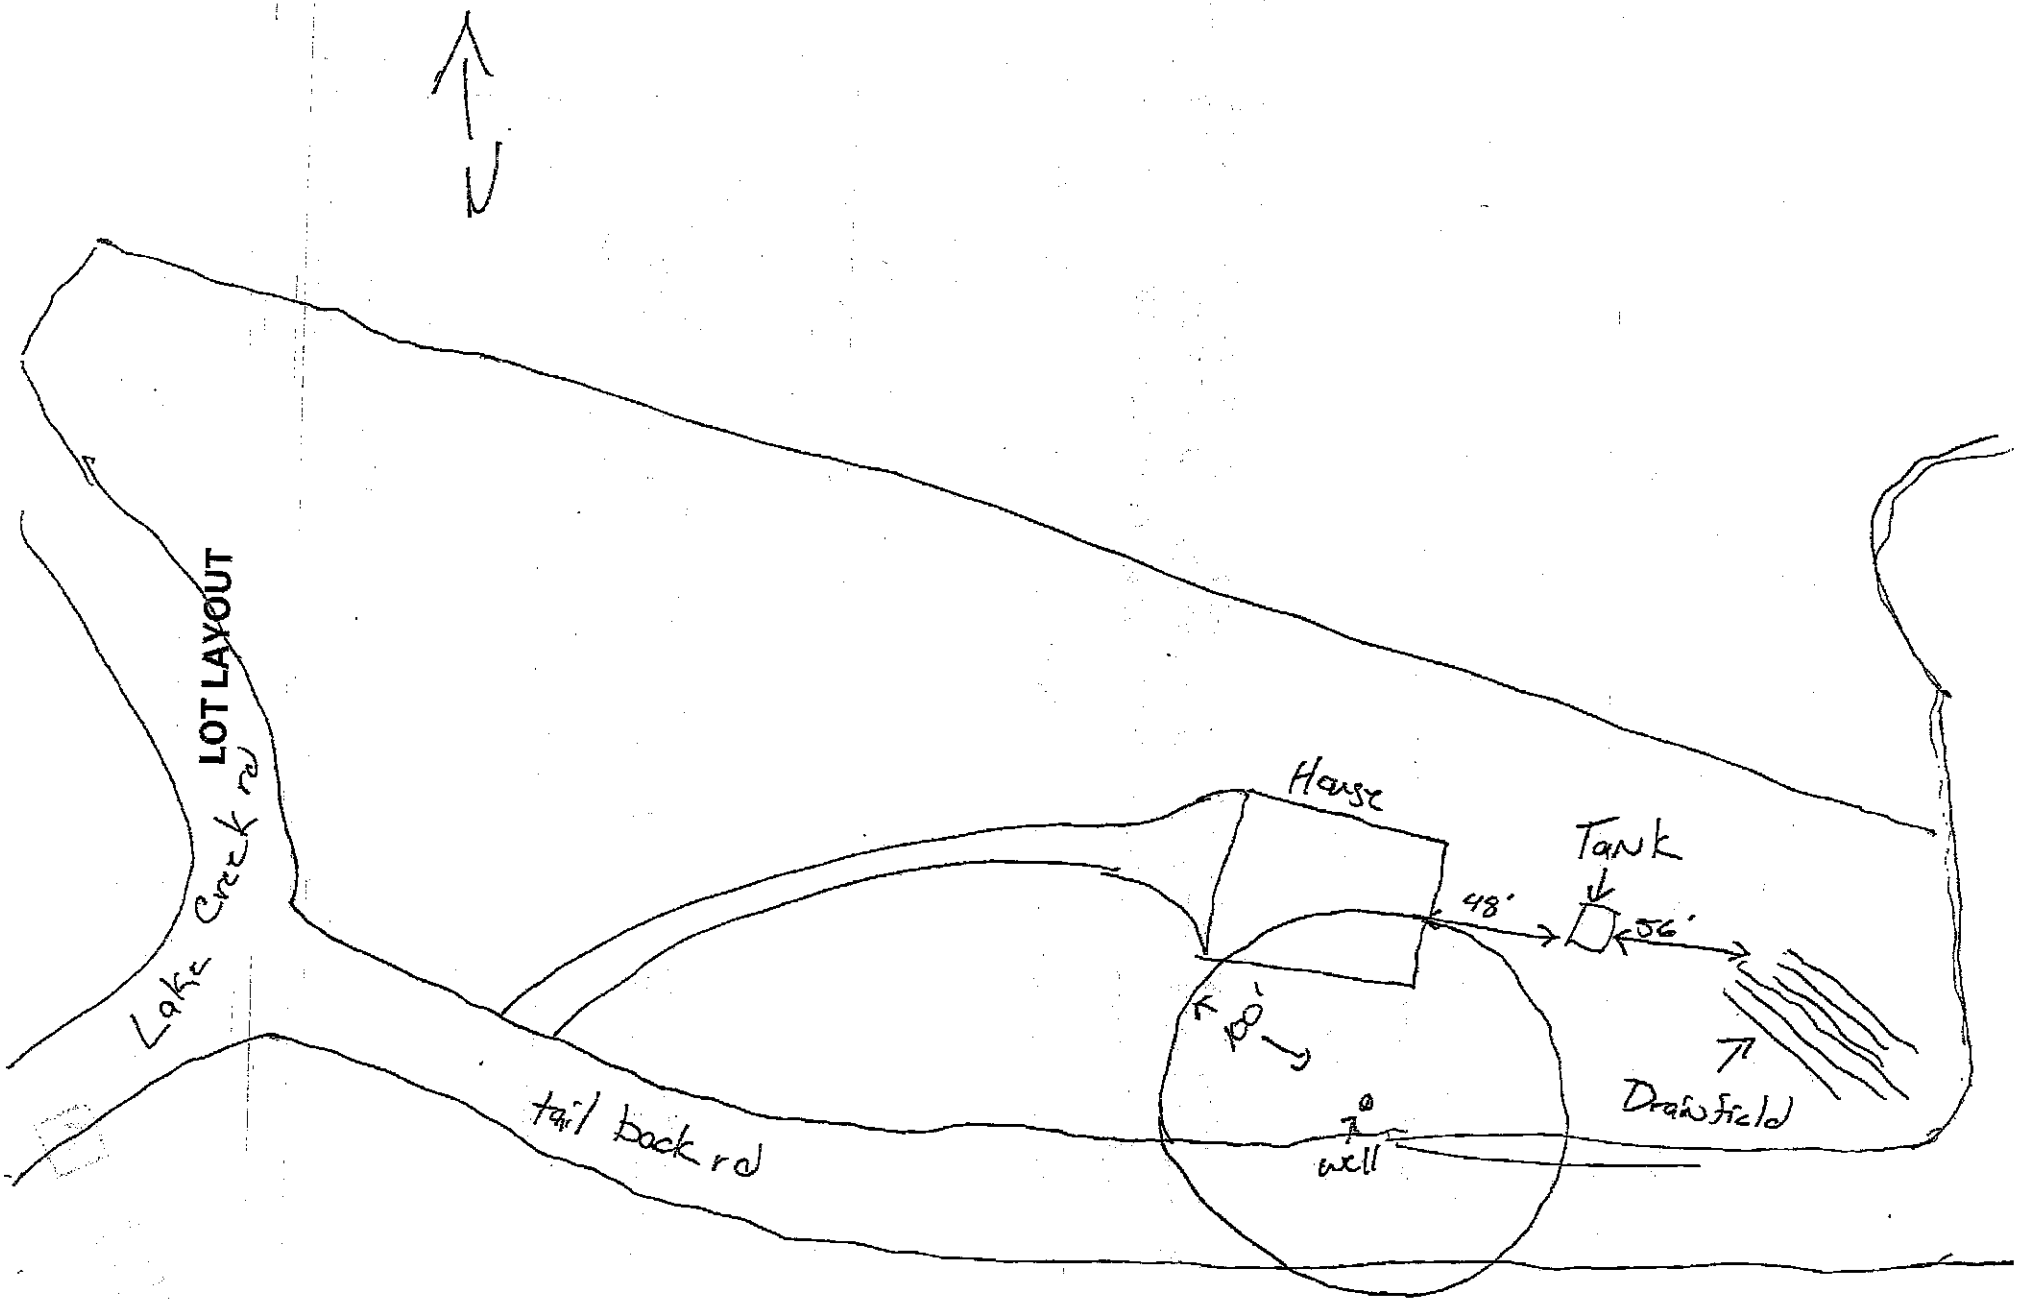
Title:

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.
406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

5


N
LOT LAYOUT
Lake Creek rd
tail back rd
House
Tank
48'
56'
100'
well
Drain field