LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Permit #25-9953

Issue Date: 05/12/2025 Expiration Date: 05/11/2026

Property Owner: Stanley Johnson

Mailing Address: [redacted]

Installer: Logan Muntz License #: 160

Approved Work: (Check One) ☐ New Installation ☒ Existing System

☐ Replace Drainfield ☒ Replace Tank ☐ Extension

Describe: Replace existing septic tank

Legal: S5 T30N R33W, COS 1548, Lot 1 and Tr 1D

Property Address: 3095 Lake Creek Rd, Troy, MT 59935 Assessment Code: 9953

DEQ COSA: E.Q.# Date:

Approved Design Criteria: Installation of new 1000 gallon septic tank

# of Bedrooms: 3 Septic Tank Size: 1000 gallons Trench Width:

# of Laterals: Length of Laterals: Trench Depth:

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Kathi Hooper, RS

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

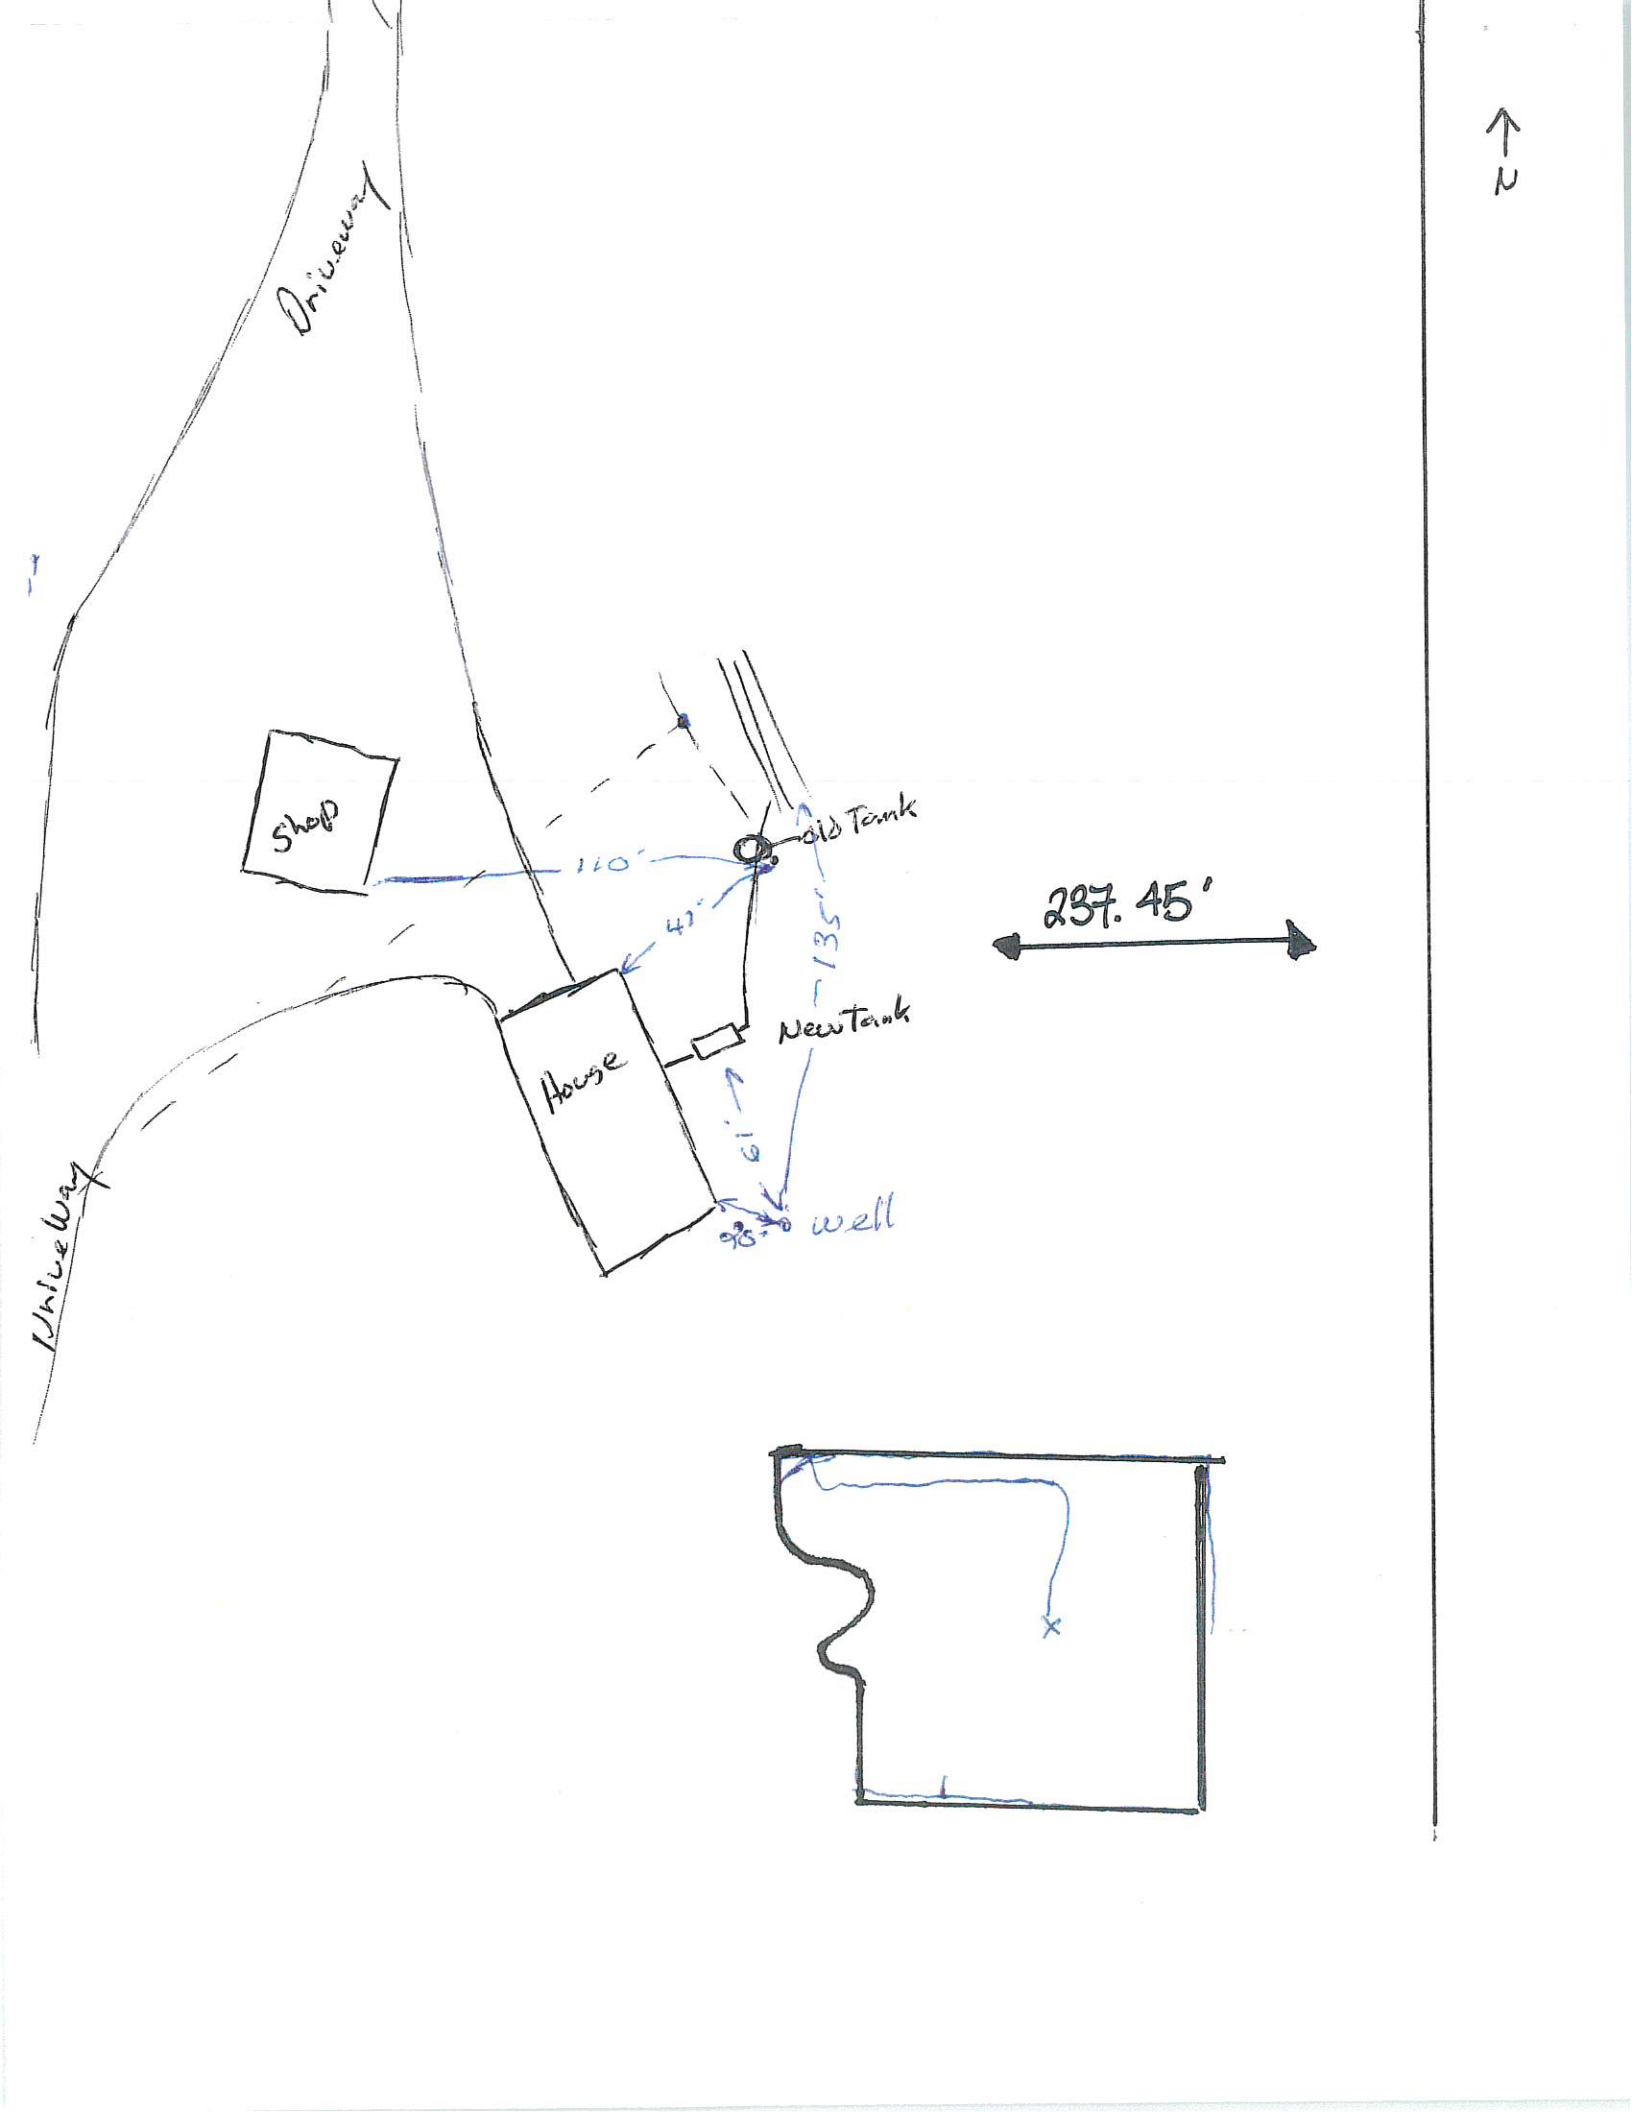
Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: [signature] *Date:* 5/20/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


Driveway
Shop
110'
41'
old Tank
135'
237.45'
House
New Tank
61'
95'
well
Driveway
N