LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 9/2/2022 Expiration Date: 9/1/2023

Property Owner: Brian Kenny

Mailing Address: [redacted]

Telephone: [redacted] Email:

Installer: Buck Schermerhorn License #: 135

Approved Work: ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Pump to double distribution box, gravity to standard 2' wide chambers

Parcel Description:

Legal: Cyhawk Estates, Lot 11, S29 T36N R27W, 8.139 acres

Property Address: Angus Road, Rexford, MT Assessment Code: 55375

Approved Design Criteria:

# of Bedrooms: 3 Septic Tank Size: 1000/500 gallons Drainfield Size: 510 sq ft

# of Laterals: 3 Length of Laterals: 85 feet Trench Depth: 36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. 15% reduction given for chambers. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

I, Robin Blumbers *, have inspected this system and found it to be in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.*


Signed: Robin Blumbers *Date:* 6/6/23

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

#55325

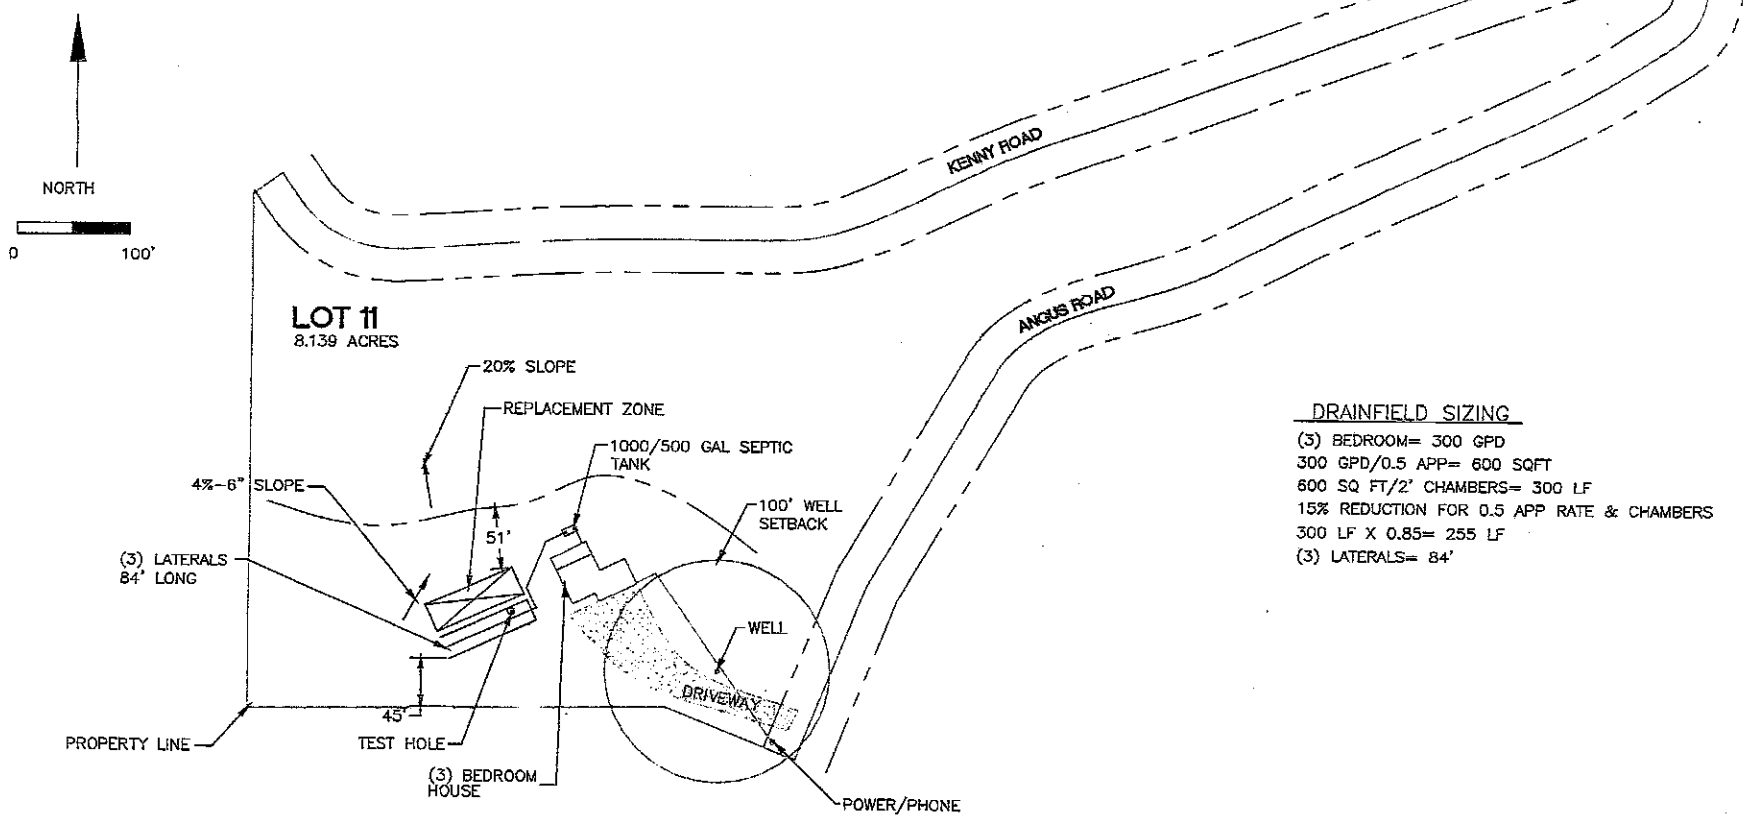

DRAINFIELD SIZING

(3) BEDROOM= 300 GPD
300 GPD/0.5 APP= 600 SQFT
600 SQ FT/2' CHAMBERS= 300 LF
15% REDUCTION FOR 0.5 APP RATE & CHAMBERS
300 LF X 0.85= 255 LF
(3) LATERALS= 84'

BRIAN KENNY SITE LAYOUT

REV	DESCRIPTION	BY/DATE	APPD/DATE

COMPANY	DSHE	SCALE	1/16 = 1'0"
CONTRACT		DATE	
VERBAL		7/2022	
PLOT FILE		WEIGHT	
PMC-0001			

SCHMIDT HAULING & EXCAVATION
KENNY SEPTIC
SITE LAYOUT
CONFORMS/WORK
D. SCHMIDT 8/2/22
403-00 1

THIS DRAWING IS PROPERTY OF SCHMIDT HAUL, CONTRACTOR AND SHALL NOT BE REPRODUCED, ALTERED, CHANGED OR SUBMITTED IN ANY MANNER WHATSOEVER WITHOUT WRITTEN APPROVAL FROM SAID OWNER/CONTRACTOR