LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 01/28/2022

Expiration Date: 01/28/2023

Property Owner: Ketchem, Steve

c/o:

Address: [redacted]

Telephone: [redacted]

[redacted]

Installer: Shayne Nelson

License No. 096

__XX__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: 1,000-gallon septic tank with effluent filter. Gravity feed system with gravelless trenches (infiltrators), 2 laterals at 56-feet in length each

Parcel Description:

Legal: S19, T27 N, R27 W, ACRES 5.144, TR 1CA IN NW

Address or Location: 352 West Camp Rd., Libby, MT 59923

Geo/Assessors code: 0000003004

Approved Design Criteria:

Bedrooms 2 Septic Tank Size: 1,000 gallon Drainfield Size: Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3,. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Nicholas Raines

Closure Statement:

I, SHAYNE NELSON *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 4/5/2022

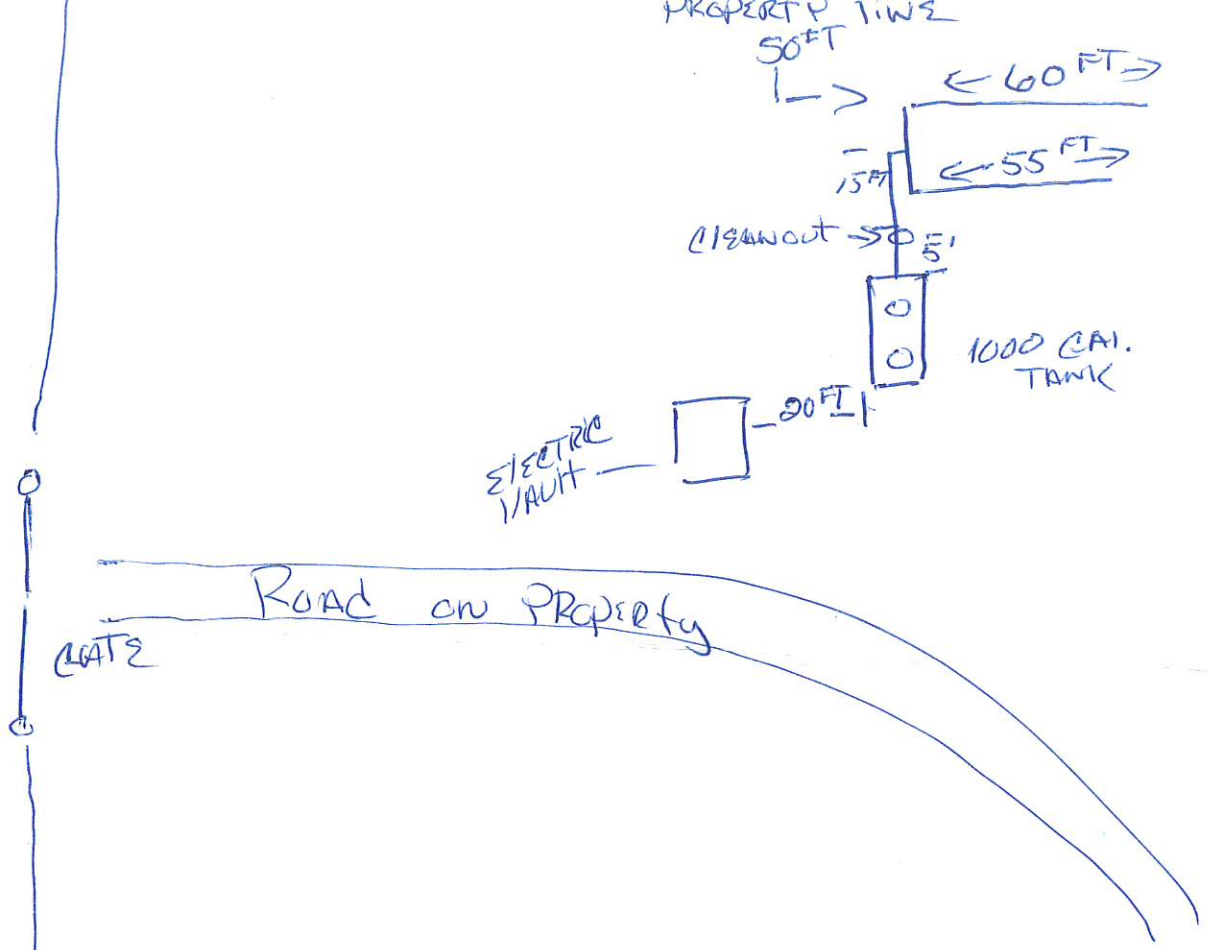
Title: NELSON EX. LLC / OWNER

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.
406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

Over


PROPERTY LINE
50 FT
60 FT
55 FT
15 FT
CLEANOUT
5'
1000 GAL. TANK
20 FT
ELECTRIC VAULT

ROAD ON PROPERTY
GATE