LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/02/2022 Expiration Date: 08/03/2023

Property Owner: Marvel Thompson Estate c/o Del Goss

Mailing Address: [redacted]

Telephone: Email:

Installer: Tally Hoe License #: 1

Proposed Work: (Check One) ☐ New Installation ☒ Existing System

☒ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Replace drainfield only, standard trenches, existing tank is good condition

Parcel Description:

Legal: Glenwood Park, Lot 48, S4 T30N R31W, 0.3857 acres

Property Address: 383 Parmenter Dr, Libby Assessment Code: 8779

Approved Design Criteria:

# of Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 280 square feet

# of Laterals: 2 Length of Laterals: 140 feet Trench Depth: 24-36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

I, Thomas J Cole, *have inspected this system and found it to be in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.*

Signed: Thomas J Cole *Date:* 8-6-22

____ Lincoln County Health Department (LCHD) ✓ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV

SEPTIC TANK PERMIT
for
LINCOLN COUNTY

Permit Sent ____

Phone 3-485Z

Date 4-10-79

Property Owner Ray Tarbert Address Box 443 - Libby


Lot, Block Number, or legal description of Property Lot 48 - Glenwood Fa

To be built by: — Square feet absorption area. 240'

Septic Tank Size 1000 gal # of bedrooms 2 Water Supply City

Description of Absorption Area: Dig a ditch at least 120' long x 2½-3' deep x 2' wide according to lot layout and ditch diagram. Slope of pipe should not exceed a 1% drop.

Sketch: Must include property lines, buildings, and proposed septic tank-drainfield layout. Sketch must show distance from absorption area to wells, springs, streams, or lakes. Indicate depth of water table. Indicate slope.

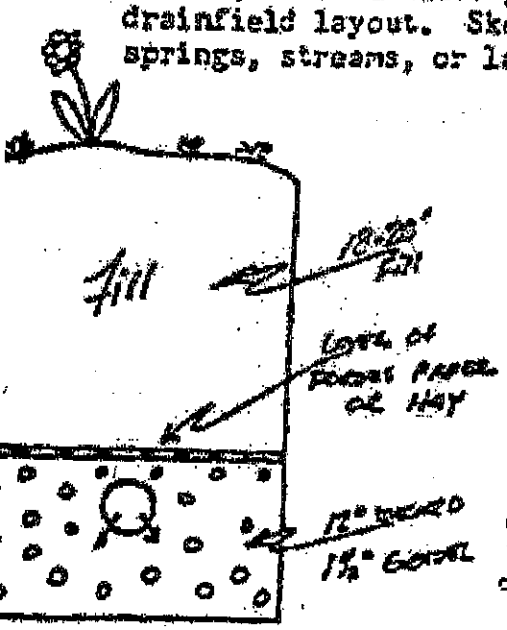


ditch Diagram

oil: gravelly loam

lope: 0%

LOT LAYOUT

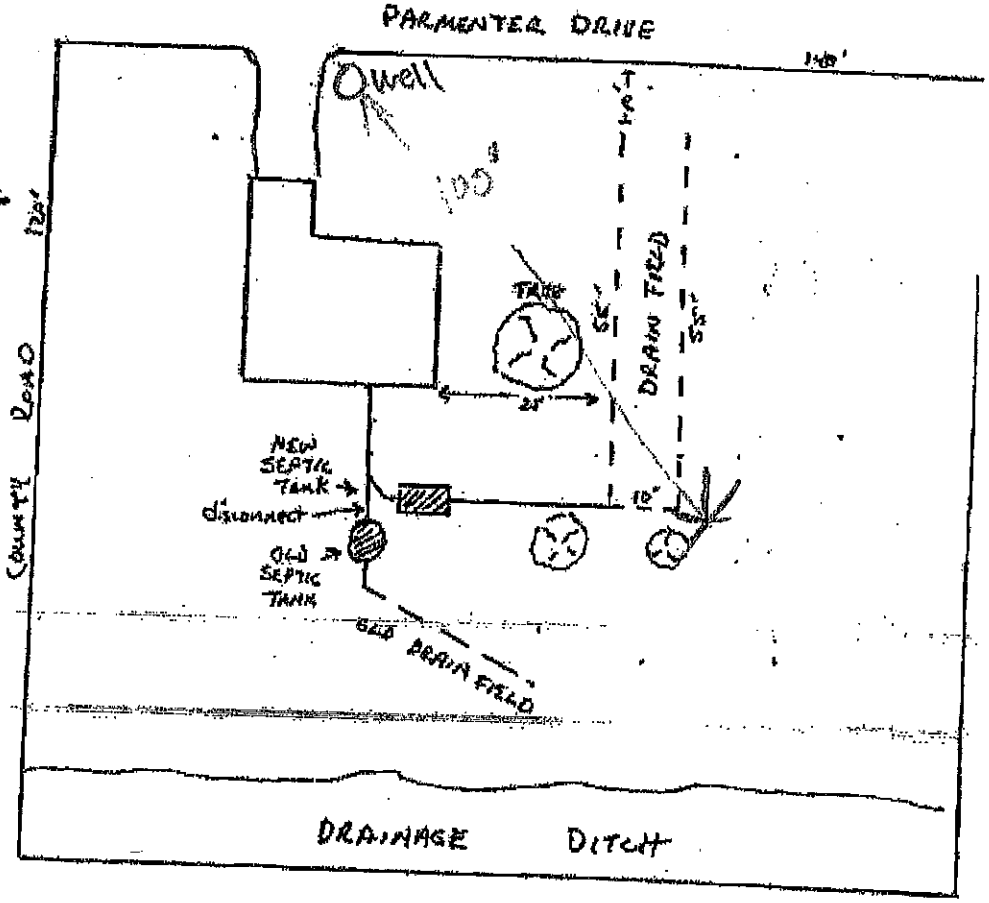

Issued by Johnny Pettrow Inspected by ____

Date 4-10-79