LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 8/12/2022 Expiration Date: 8/11/2023

Property Owner: Nicholas & Jaclyn Mazariegos

Mailing Address: [redacted]

Telephone: [redacted] Email: [redacted]

Installer: Homeowner (Inspection required) License #: NA

Proposed Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Standard 2' wide trenches, gravity system, 2 houses on system (550 gpd)

Parcel Description:

Legal: S10 T33N R34W, COS 809, 20.136 acres

Property Address: 2835 Rocky Draw Rd,Troy Assessment Code: 1193

Approved Design Criteria:

# of Bedrooms: 3 + 2 Septic Tank Size: 2 x 1000 gallons Drainfield Size: 800 square feet

# of Laterals: 4 Length of Laterals: 100 lineal feet Trench Depth: 24-36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

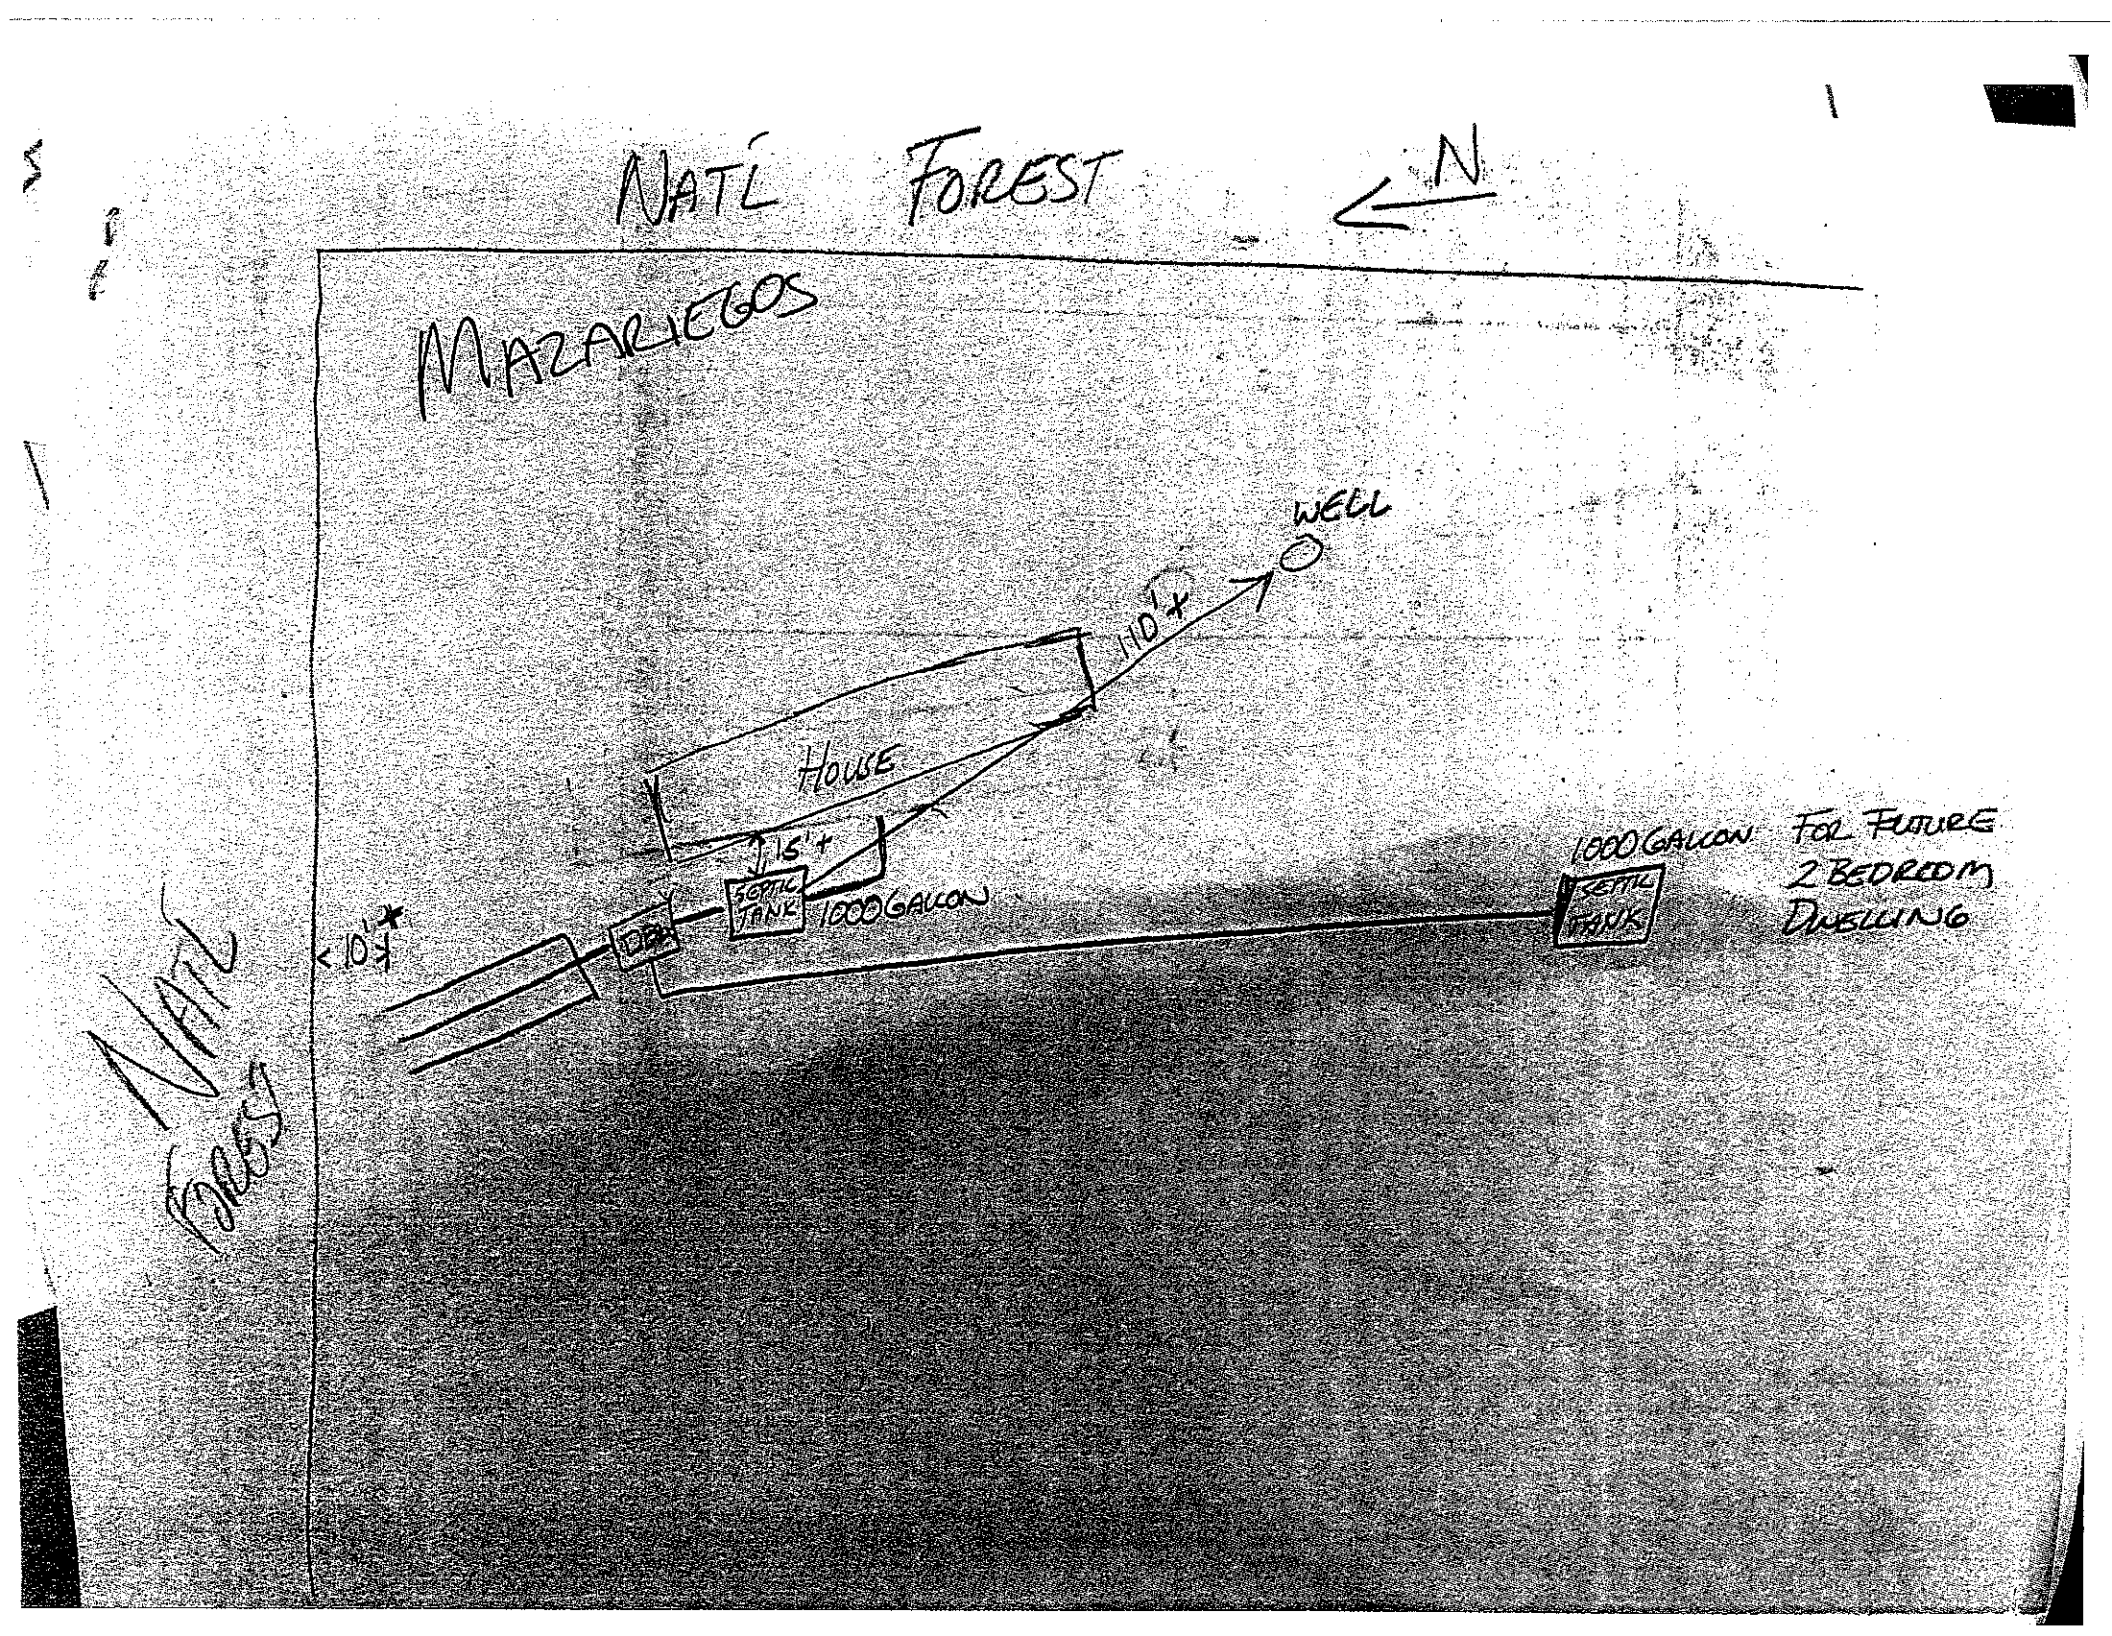
This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* 9/6/22

X Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


NATL FORREST
N
MAZARIEGOS
WELL
110'±
HOUSE
15'±
SEPTIC TANK
1000 GALON
10'±
1000 GALON
SETTL TANK
FOR FUTURE
2 BEDROOM
DWELLING
NATL FOREST