LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/18/2022 (updated 8/19/22) Expiration Date: 07/17/2023

Property Owner: Daniel & Maria McDaniel

Mailing Address: [redacted]

Telephone: [redacted] Email:

Installer: Dirt Works License #: 144

Proposed Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: sand lined trenches, pressure dosed, 3' wide trenches due to <3mpi perc rate

Parcel Description:

Legal: Banks Draw, Parcel B, S05 T35N R27W

Property Address: Banks Draw Rd, Rexford, MT Assessment Code: 55536

Approved Design Criteria:

# of Bedrooms: 2 Septic Tank Size: 1000/500 gallons Drainfield Size: 288 square feet

# of Laterals: 2 Length of Laterals: 48 Trench Depth: 24-36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

I, Maranda Davis, have inspected this system and found it to be in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

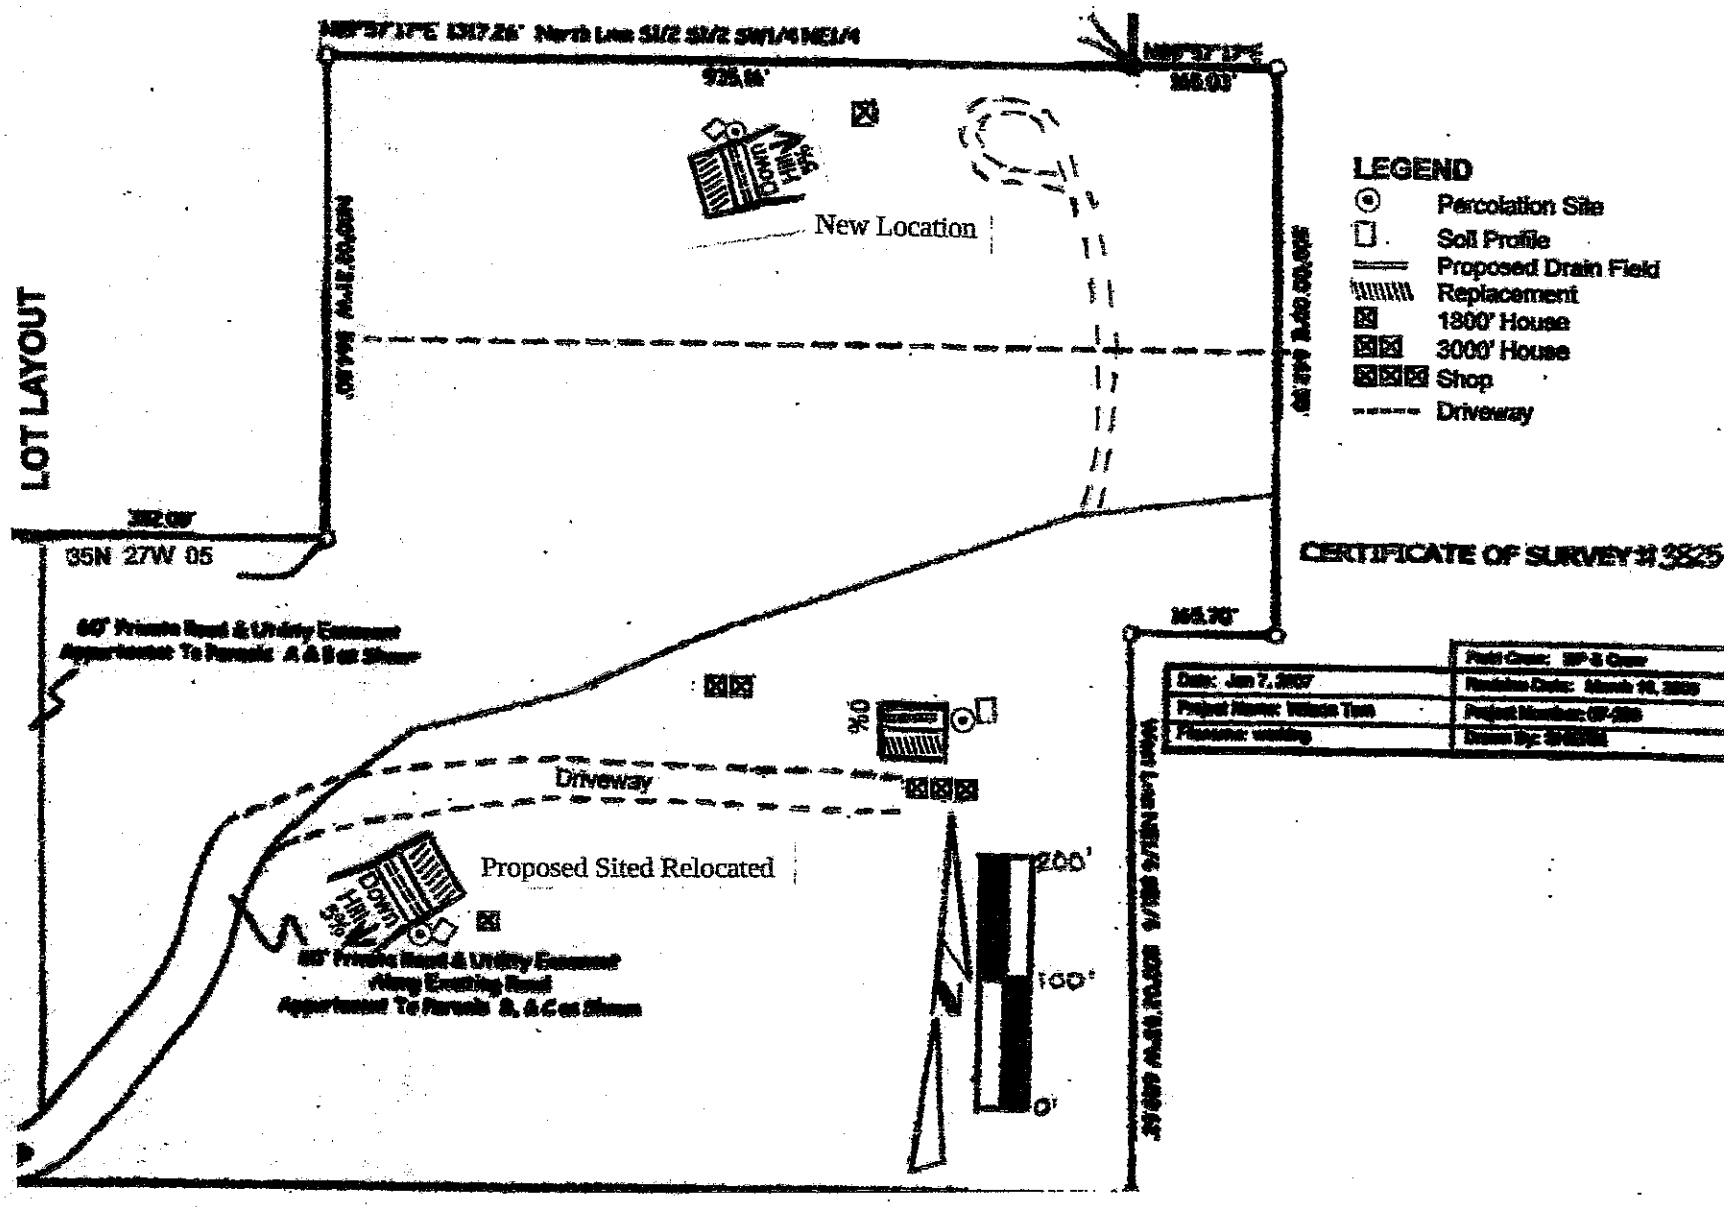
Signed: Maranda Davis *Date:* 10/13/22

X Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV


LOT LAYOUT
35N 27W 05
New Location
Proposed Sited Relocated
Driveway
LEGEND
Percolation Site
Soil Profile
Proposed Drain Field
Replacement
1800' House
3000' House
Shop
Driveway
CERTIFICATE OF SURVEY #3825