County

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/02/2022 Expiration Date: 05/02/2023

Property Owner: McNulty, James c/o:

Address: [redacted]

Telephone: [redacted]

Installer: Tally Hoe License No. 1

___ New Installation ____ Existing System

____ Repair _____ Replacement __XX__ Extension ____ Other

Describe: 1,500 gallon tank and 1,000 gallon tank, gravity feed system, 12 dry-wells. This permit is based on an approval issued by J. Mertes in 2021.

Parcel Description:

Legal: S03, T30 N, R31 W, ACRES 3.38, TR 2BB IN LOT 4

Address or Location: 658 W. 2nd. St.

Geo/Assessors code: 0000009003

Approved Design Criteria:

Bedrooms 6 trailers Septic Tank Size: 1,500 gallon + 1,000 gallon Drainfield Size: N/A

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3,. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Nicholas Raines

Original Approval By: Jake Mertes, R.S.

Closure Statement:

I, Thomas J Cole *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*


Signed: Thomas J Cole *Date:* 5-4-22


Title: owner operated

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.
406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

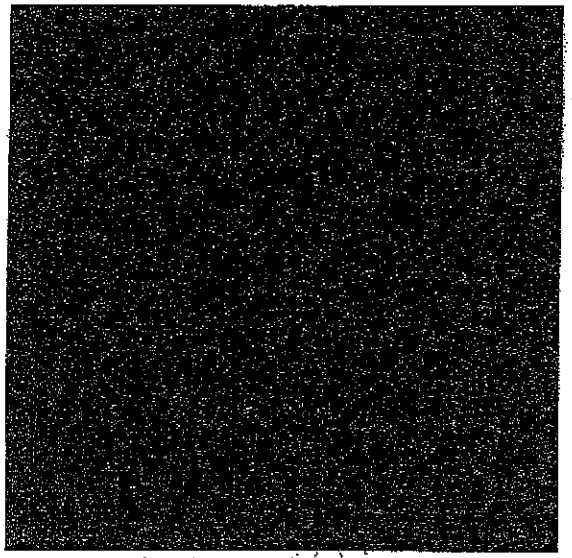

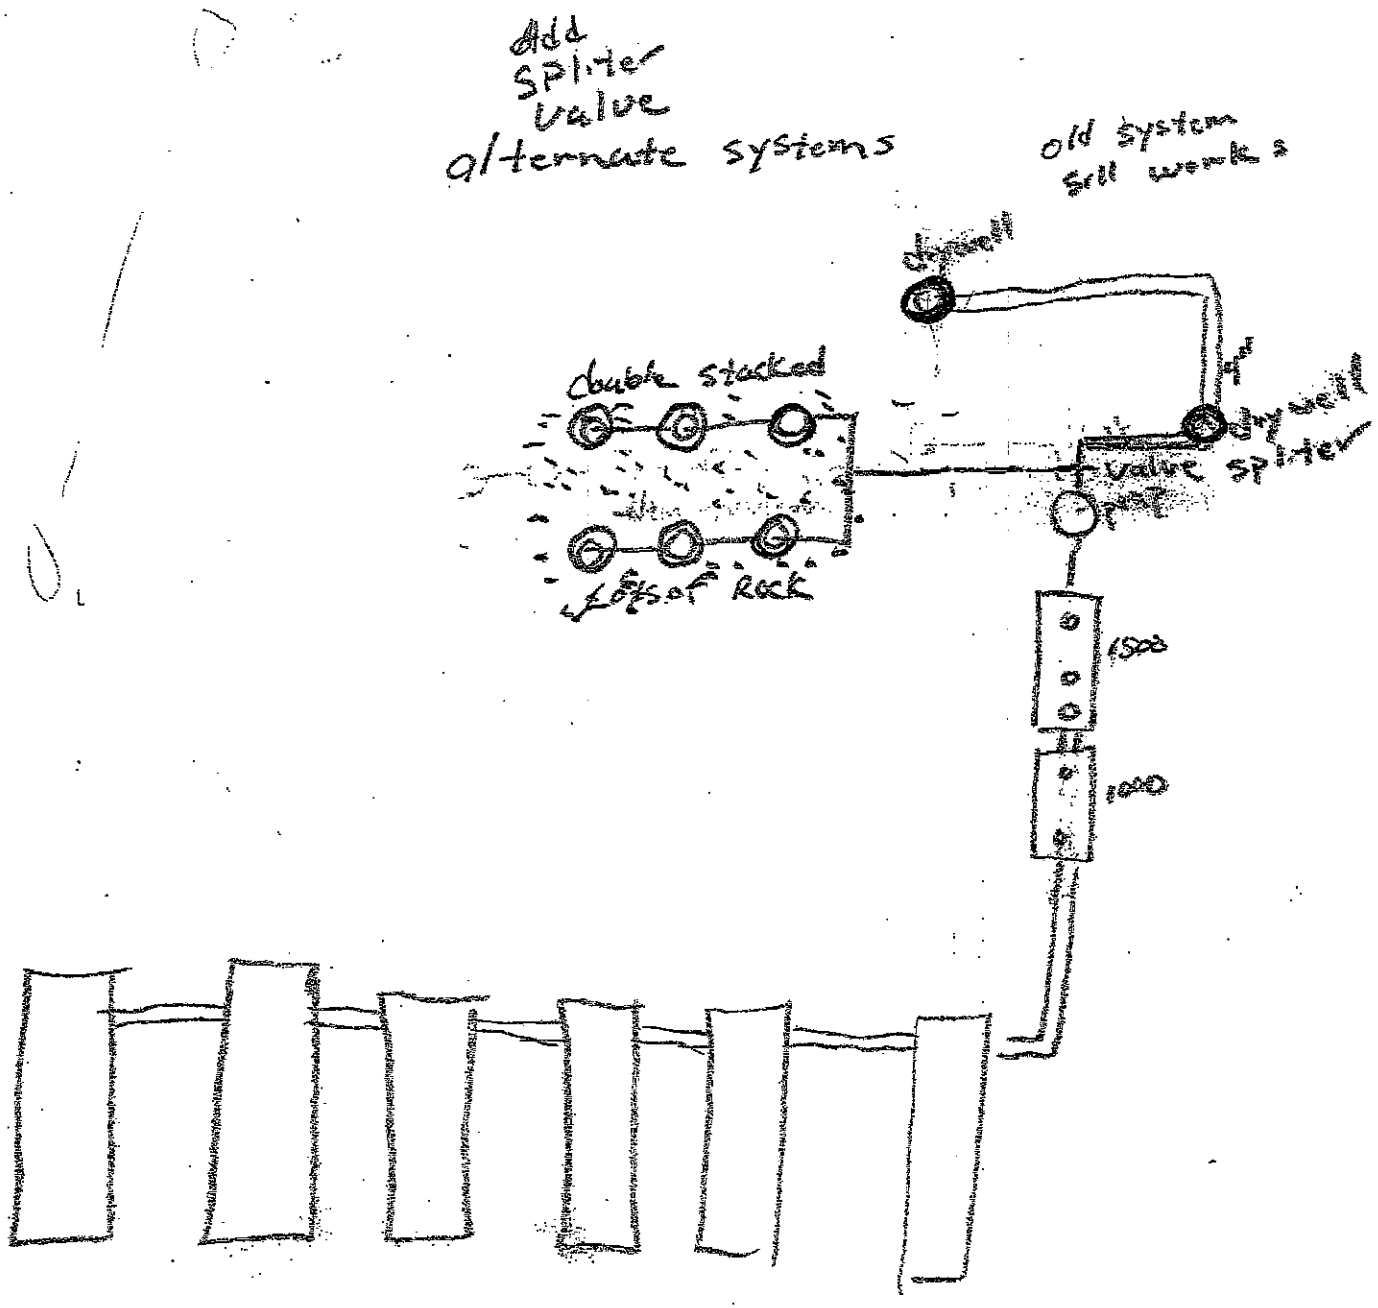
Add
Splitter
Valve
alternate systems
old system
still works
double stacked
Lots of Rock
valve splitter
1500
1000