LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 3/2/2023 Expiration Date: 3/1/2024

Property Owner: Robbie Newman

Mailing Address: [redacted]

Telephone: [redacted] E-mail:

Installer: Riley Excavating License #: 147

Approved Work: (Check One) ☐ New Installation ☒ Existing System

☒ Replace Drainfield ☒ Replace Tank ☐ Extension

Describe: Gravity system with standard 2' wide trenches, reduction given for chambers

Parcel Description:

Legal: S26 T31N R31W, COS 635, Parcel G, 2.088 acres

Property Address: 731 Florence Rd, Libby Assessment Code: 9308

Approved Design Criteria:

# of Bedrooms: 4	Septic Tank Size: 1500 gallons	Drainfield Size: 340 square feet
# of Laterals: 2	Length of Laterals: 85 lineal feet	Trench Depth: 24 - 36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:


This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____, RS *Date:* 3-16-23

X Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

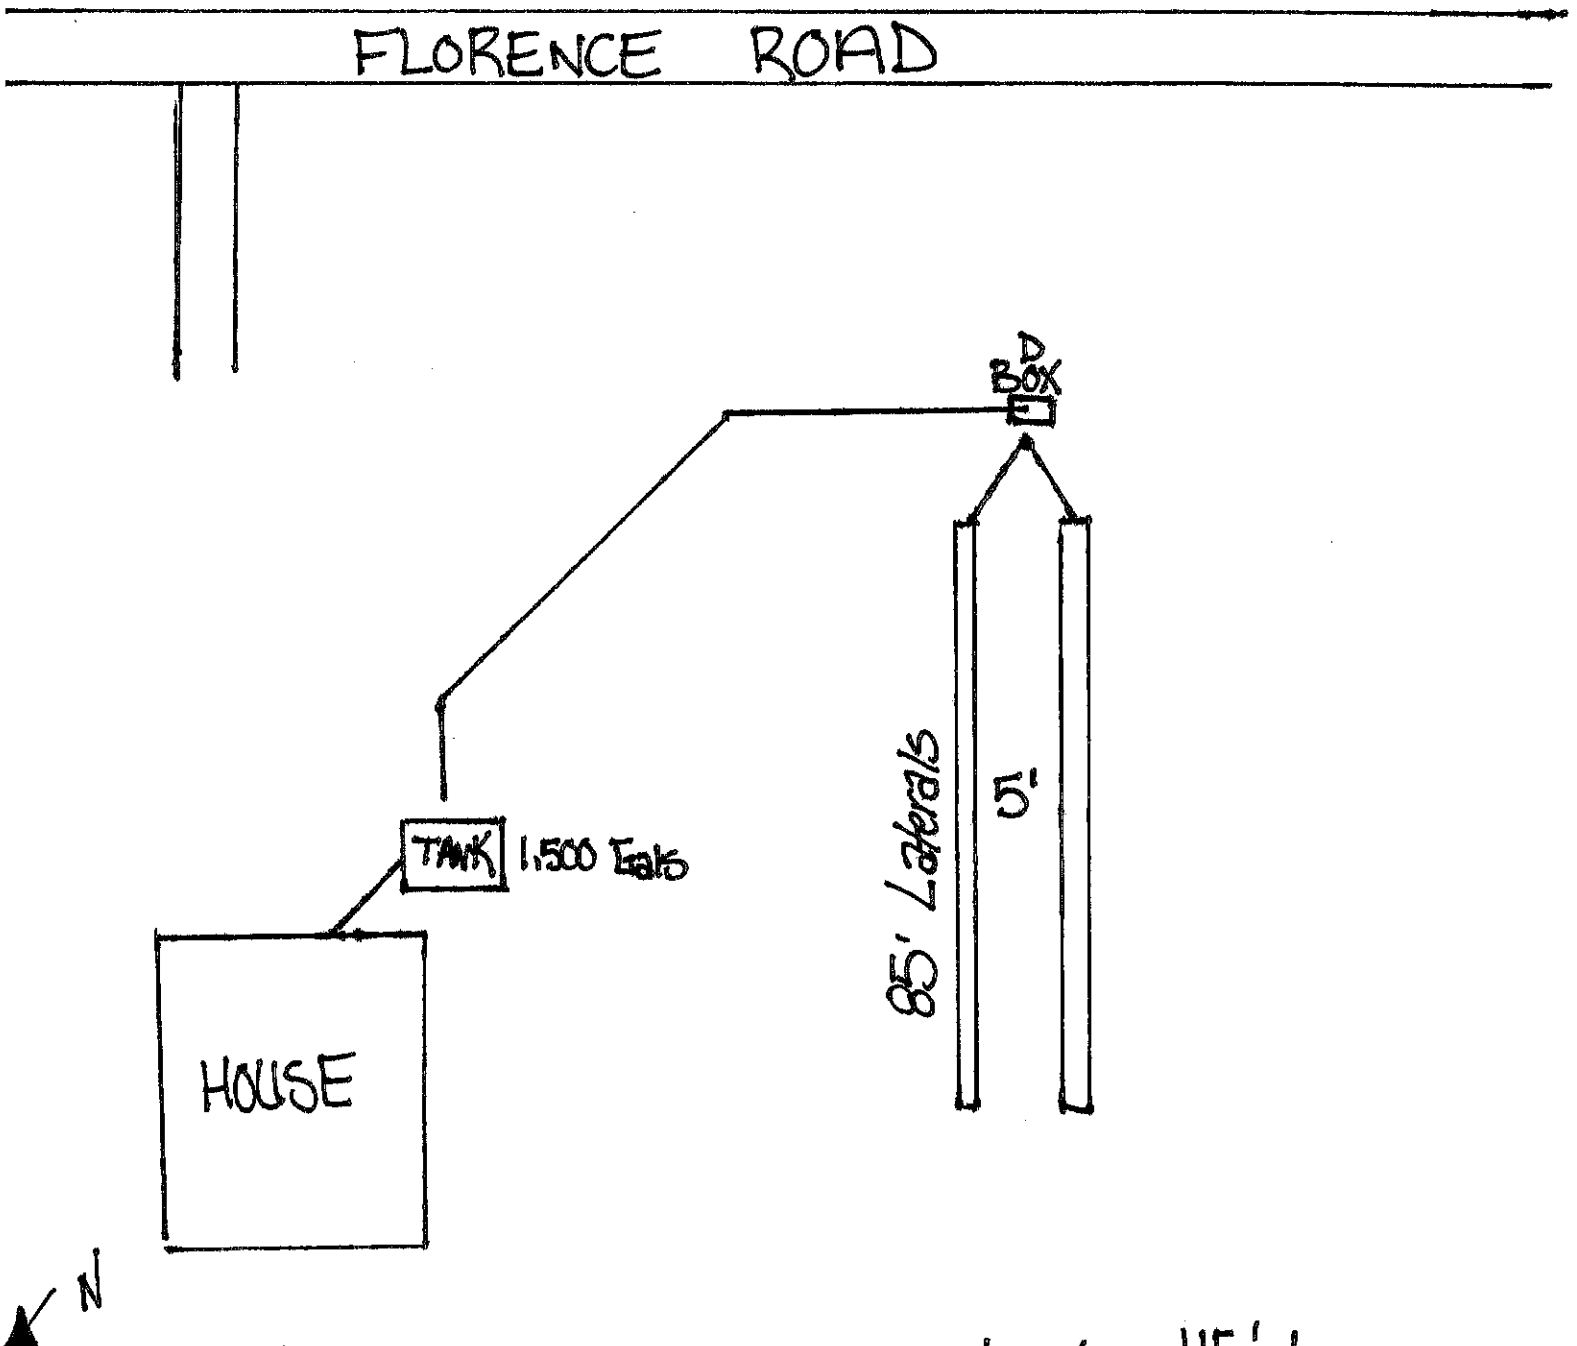

* Distance from well to septic tank 115' +
* Distance from well to drain field end 150'
* Distance from adjoining property 15'