LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/22/2022 Expiration Date: 07/21/2023

Property Owner: Gary Pershall

Mailing Address: [redacted]

Telephone:

Installer: Mountain Contracting License #: 3

Proposed Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Gravity system with 2' wide gravelless chambers

Parcel Description:

Legal: S10 T35N R26W, Parcel B, 58.599 acres

Property Address: 630 Mud Creek Rd, Eureka, MT Assessment Code: 942

Approved Design Criteria:

# of Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 800 square feet

# of Laterals: 4 Length of Laterals: 100 feet Trench Depth: 24-36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

I, Richard Wright, have inspected this system and found it to be in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

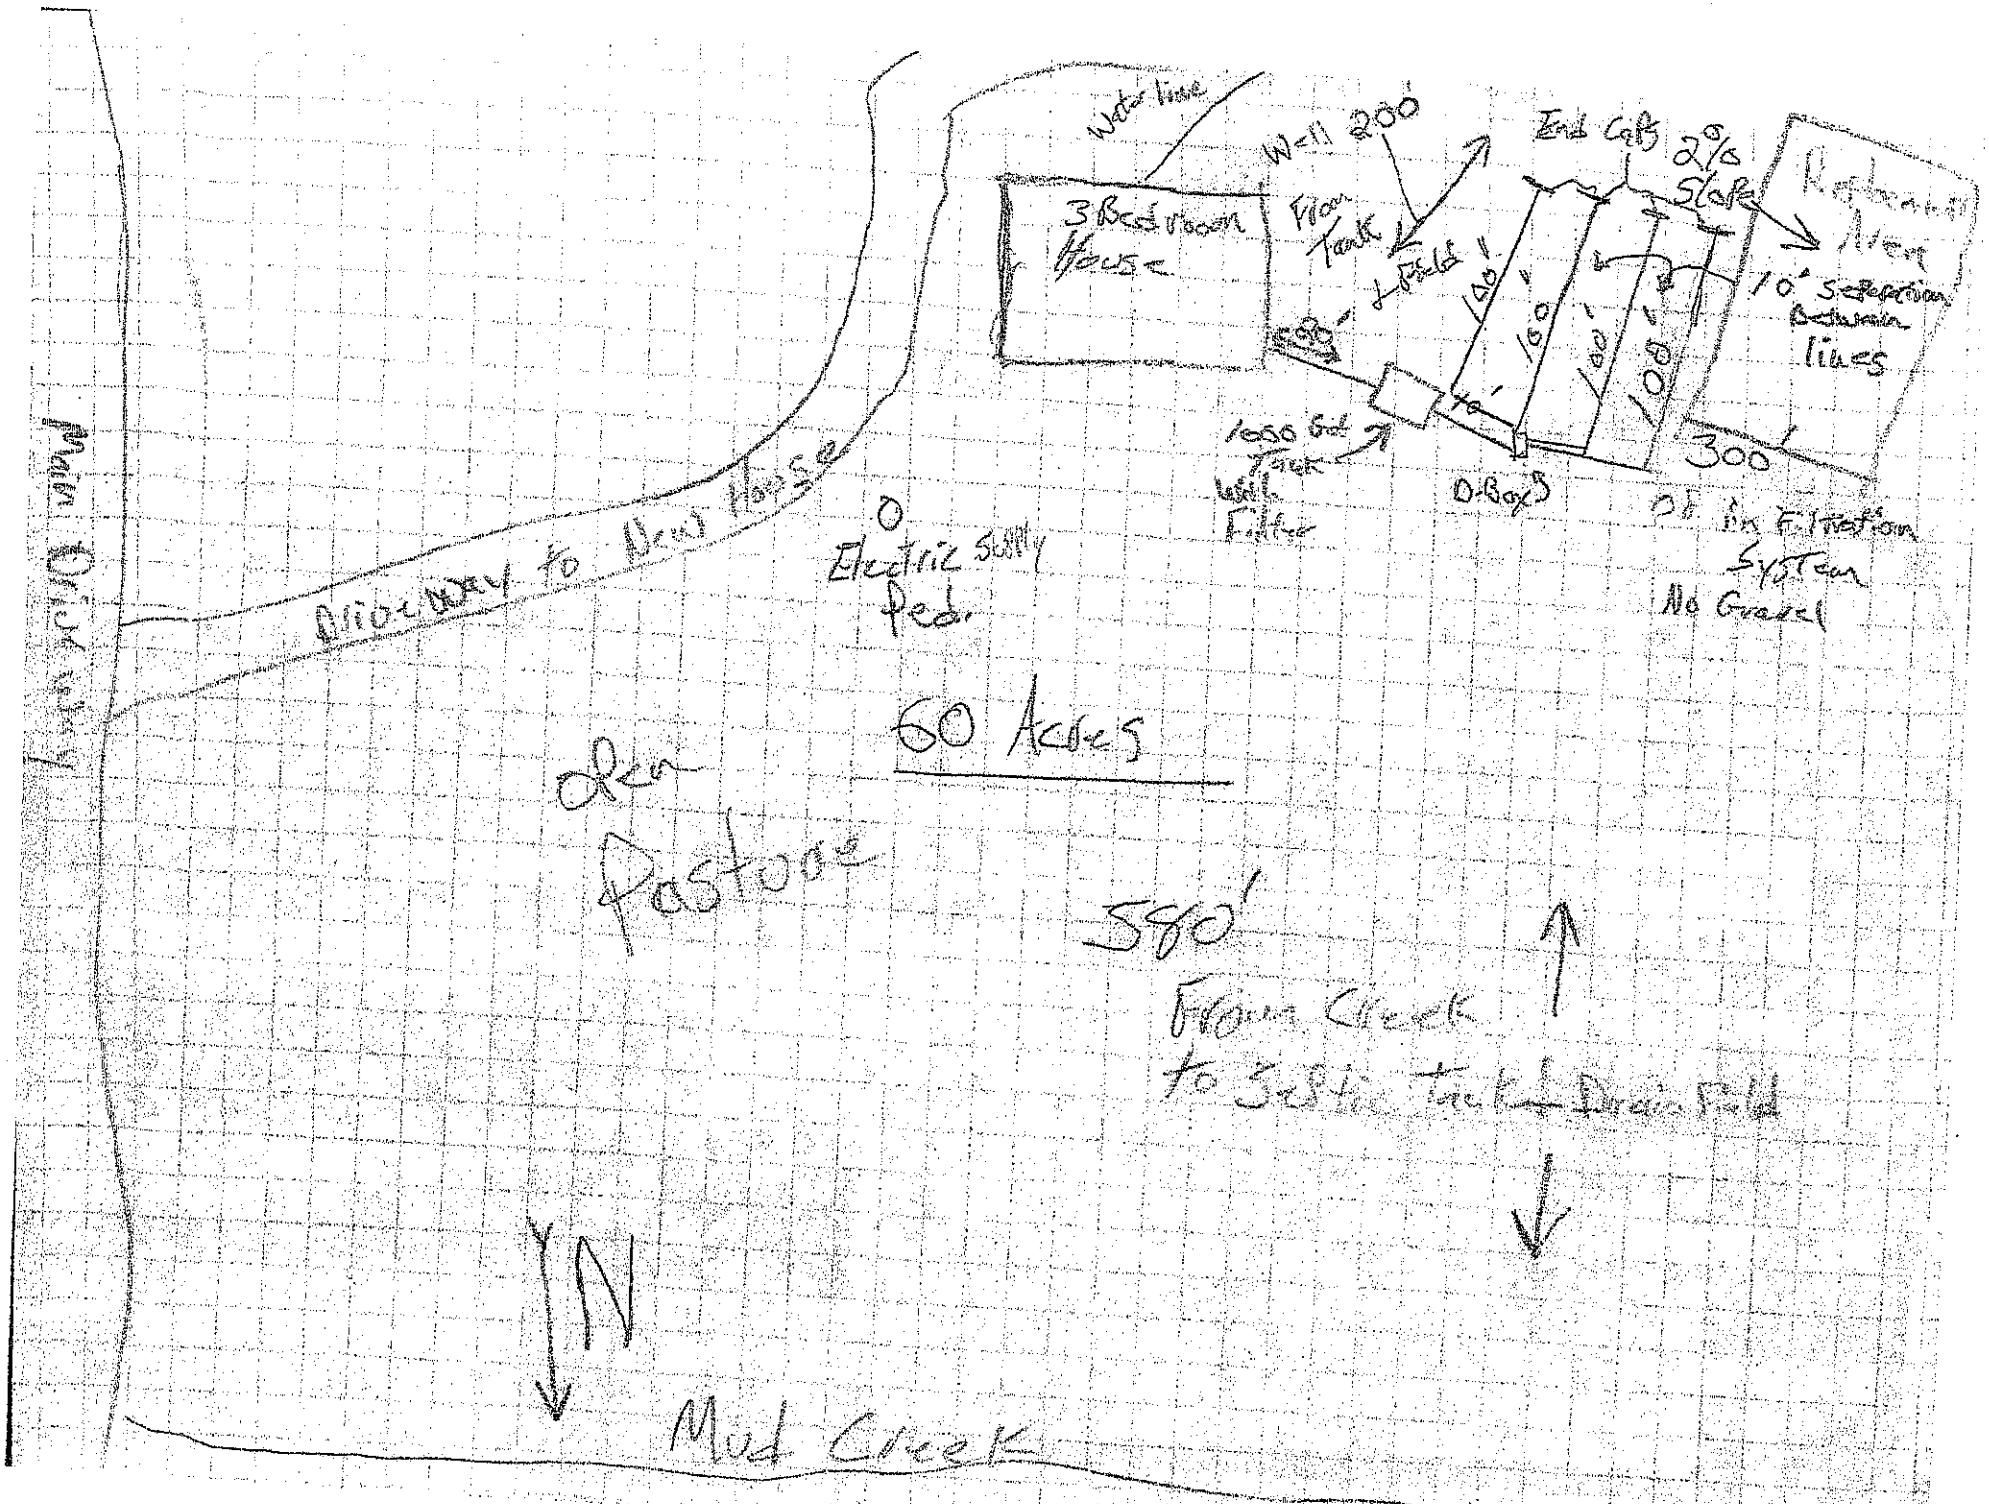
Signed: _____ Date: 11/23/2022

___ Lincoln County Health Department (LCHD) ✓ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV


Water line
Well 200'
3 Bedroom House
From Tank
4" Field
End Cap
2% Slope
Restaurant Area
10' Separation between lines
100'
100'
100'
100'
100'
100'
300'
1000 Gal Tank with Filter
4"
D-Box
25 in Filtration System No Gravel
Driveway to Next House
Electric Utility Ped.
60 Acres
Open Pasture
580'
From Creek to Septic Tank
Drain Field
N
Mud Creek