LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT #1823

Issue Date: 06/01/2022

Expiration Date: 06/01/2023 (RENEWAL)

Property Owner: Meldon Peterson

c/o:

Address: [redacted]

Telephone: (Home)

(Work)

Installer: Paul Dalziel

License No. 175

__XX__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 96' laterals in chambers.

Parcel Description:

Legal: S03, T35 N, R32 W, ACRES 2.53, TR-1E OF HES 274 PLAT 580 *253*

Address or Location: 336 Overdale Lodge Rd W Troy, MT 59935

Geo/Assessors code: 0000000253

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 192 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: *INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.*

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Paul Dalziel, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Paul Dalziel *Date:* 6/08/2022

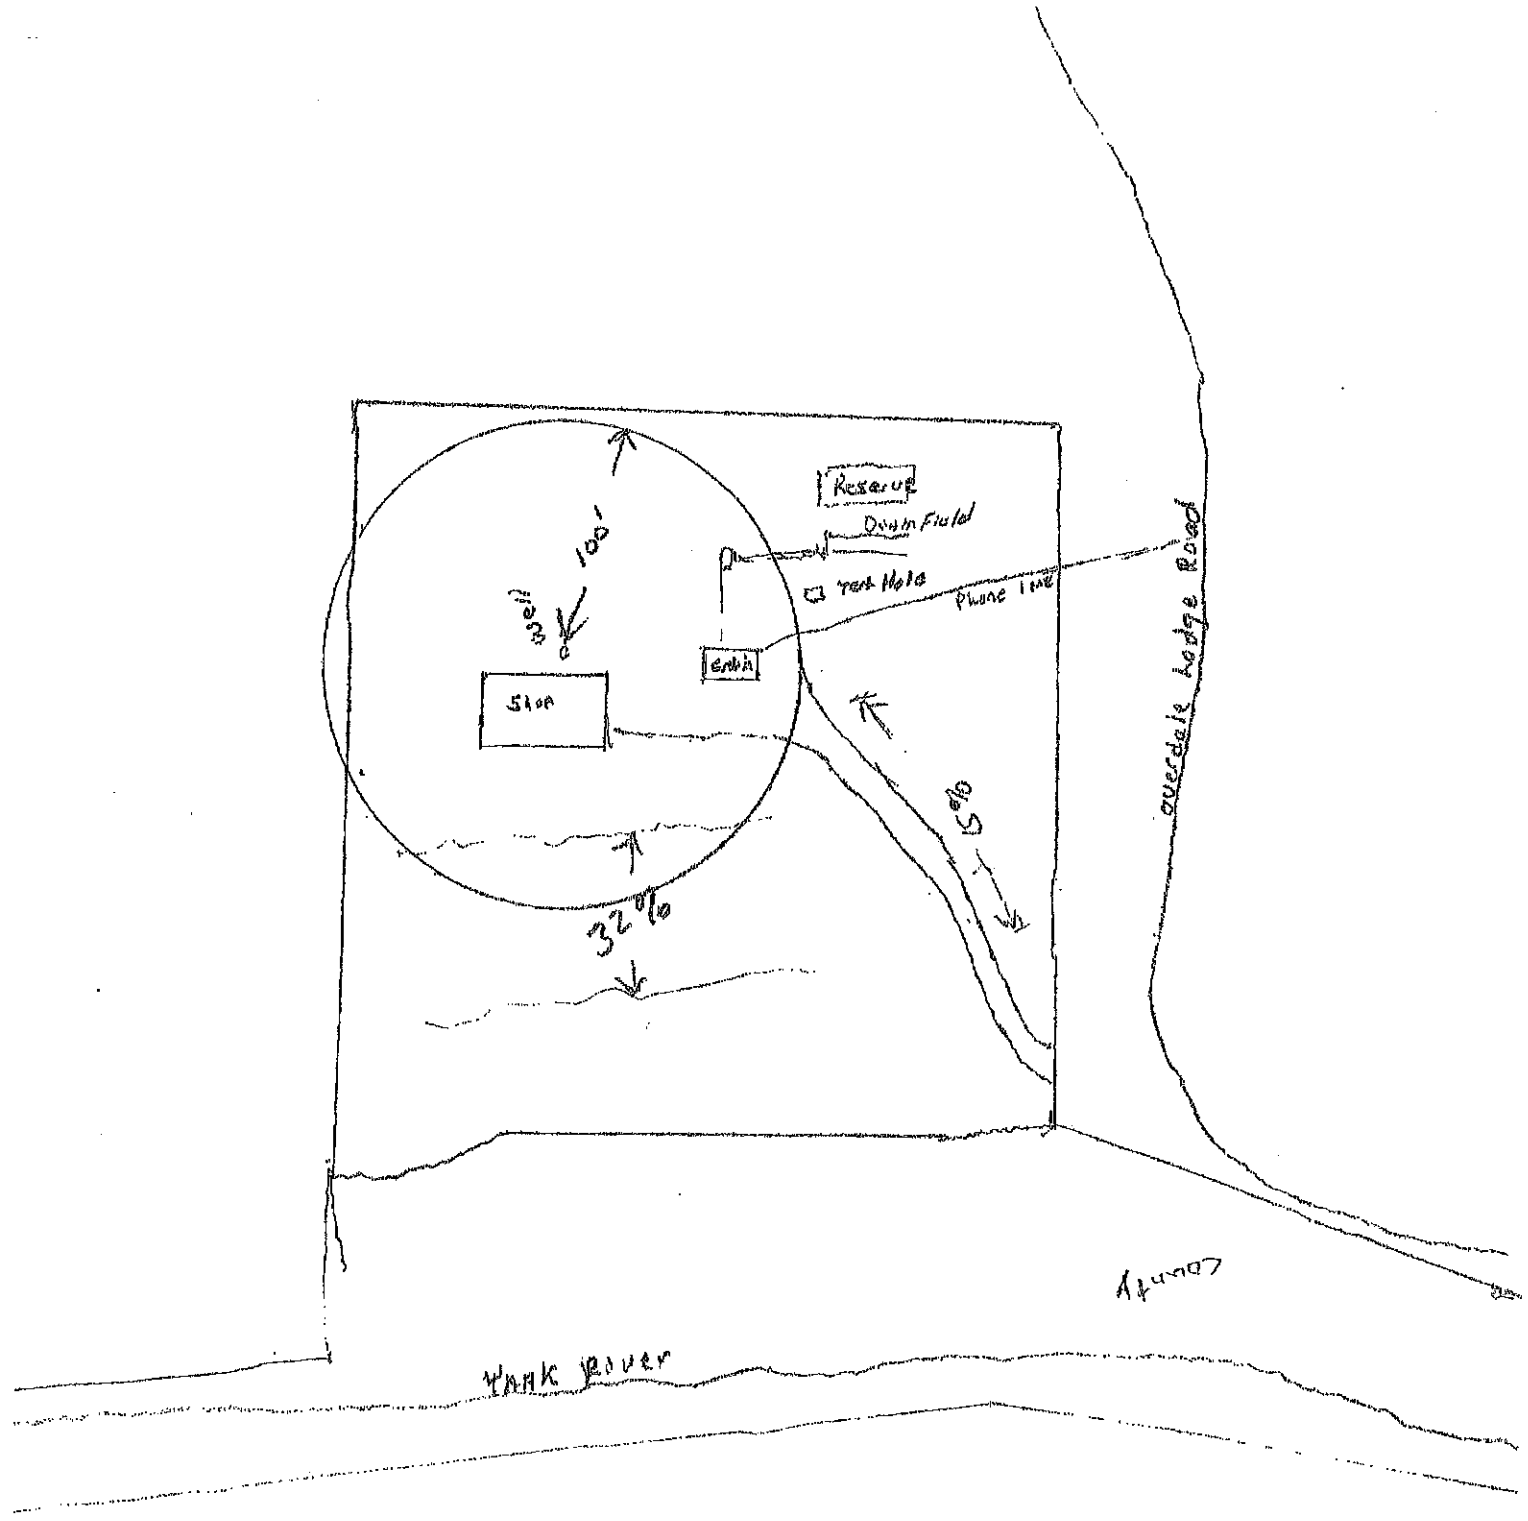
Title: Installer

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Reservoir
Drain Field
Test Hole
Phone Line
Cabin
Shed
100'
32%
5%
Overdale Lodge Road
Trail
York River