LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Permit #25-55425

Issue Date: 02/12/2025 Expiration Date: 02/11/2026

Property Owner: Joanna Poston

Mailing Address: [redacted]

Installer: Richard Luciano License #: 3

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system for 2 Bedroom House.

Legal: TOBACCO VALLEY VIEW, S23, T36 N, R27 W, LOT12, ACRES 5.889, COS 6898

Property Address: 641 Tobacco Valley View Rd., Eureka, MT 59917 Assessment Code: 55425

DEQ COSA: E.Q.#08-1026 Date: 11/20/2024

Approved Design Criteria: Installation of new gravity system for 2 Bedroom House with 3 Laterals @ 65' with reduction for chambers.

# of Bedrooms: 2 Septic Tank Size: 1000 gallons Trench Width: 24"

# of Laterals: 3 Length of Laterals: 65' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, RS

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 5/2/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

Name: RLL of LOT 12 of
Tobacco Valley View Subdivision
County: Lincoln
Location: sec.23-T36N-R27W
E.Q.#08-1026

Legend
- approved drainfield site
- approved replacement area
- existing well w/100'isolation zone
- mixing zone

Swale Cross Section

Roadway Ditch Diagram


Stone Filtration Dam

DRAINAGE DITCH & STORMWATER FLOW

**** NOTES ****

NO WELLS OR DRAINFIELDS WITHIN 100' OF PROPERTY BOUNDARY.

DRIVEWAYS ARE PROPOSED UNLESS OTHERWISE SPECIFIED.

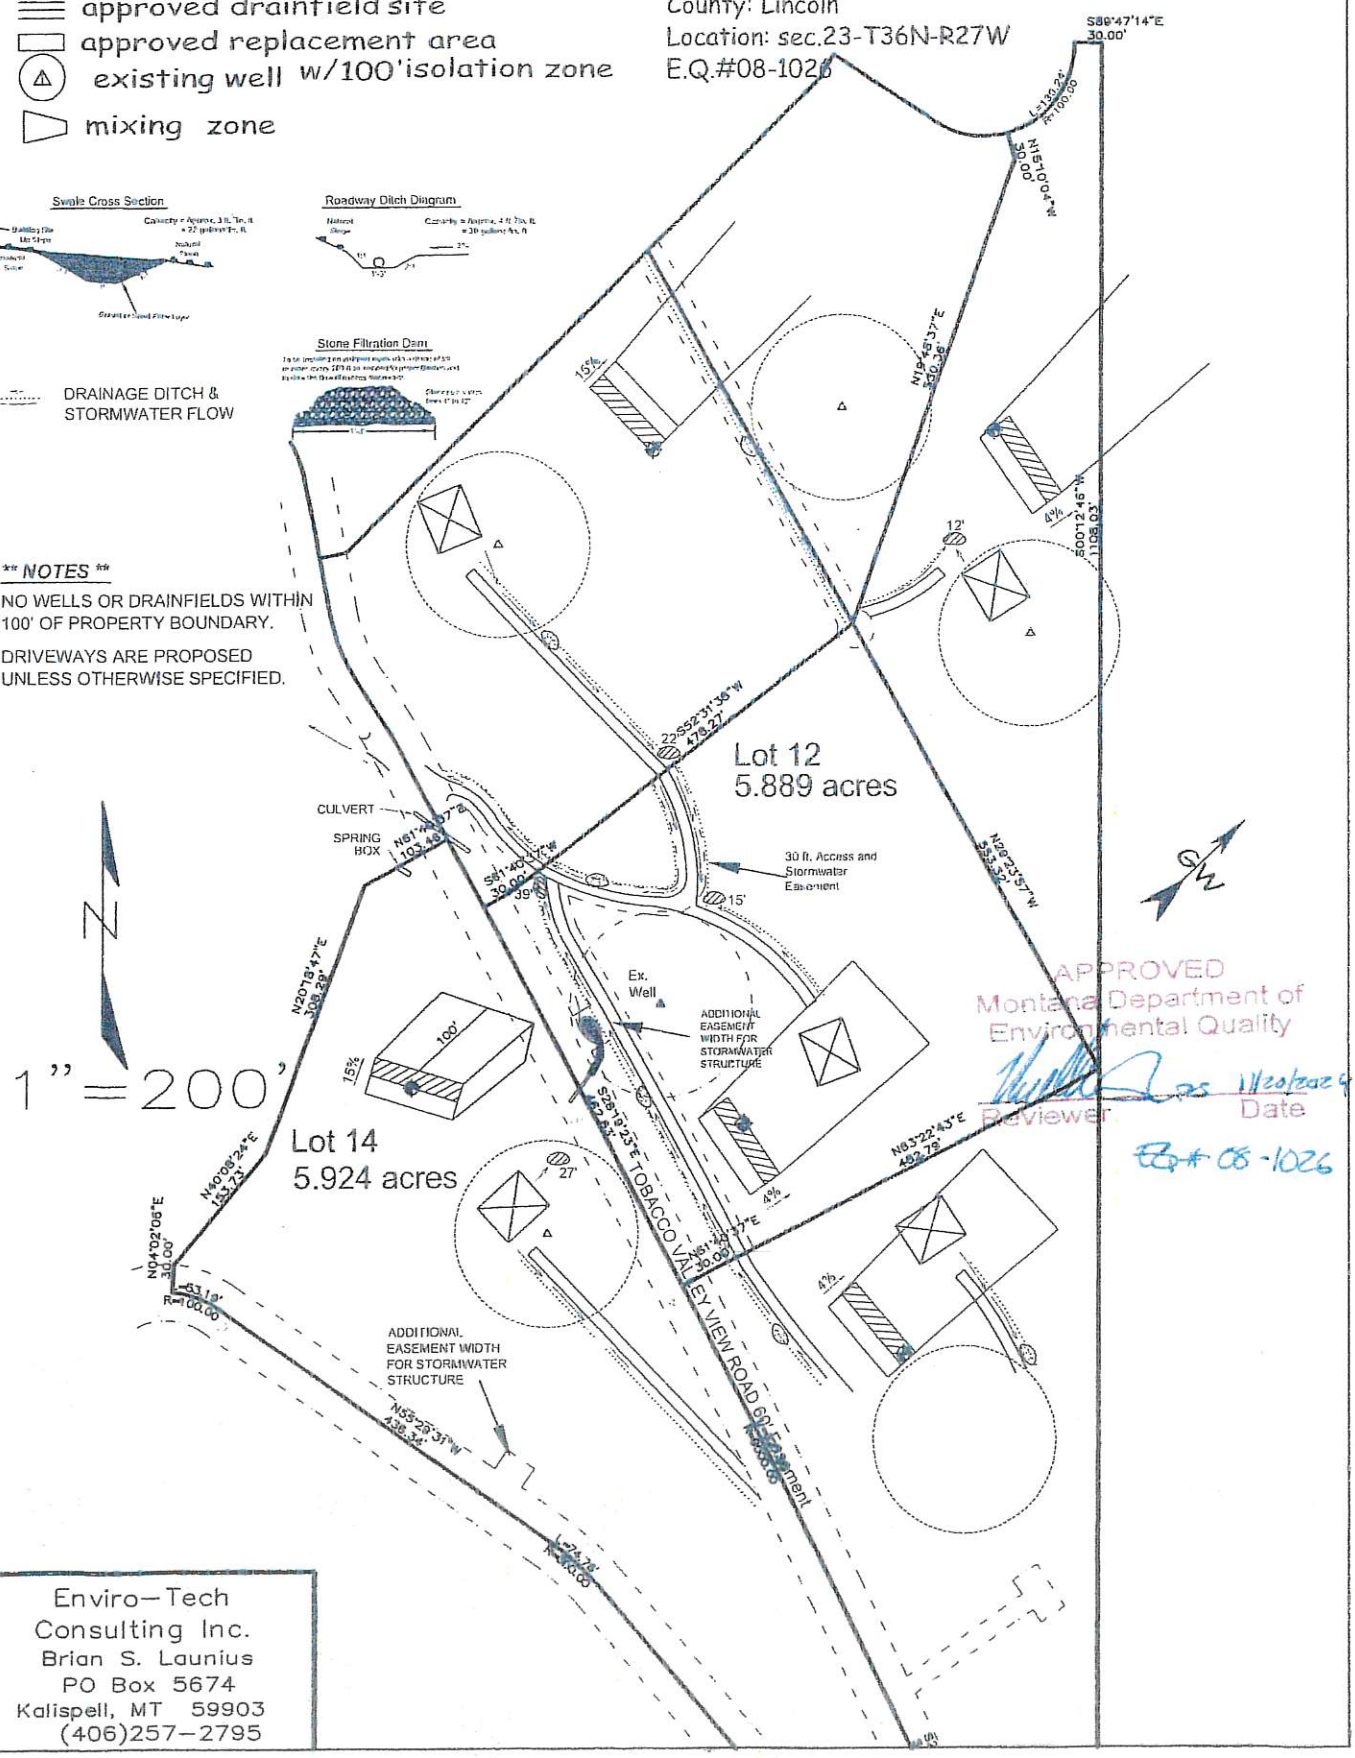

APPROVED
Montana Department of
Environmental Quality
Reviewer
Date
EQ# 08-1026

Enviro-Tech
Consulting Inc.
Brian S. Launius
PO Box 5674
Kalispell, MT 59903
(406)257-2795