LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/01/2022(Renewal 08/30/2023) Expiration Date: 08/29/2023

Property Owner: Dean Riely c/o:

Address: [redacted]

Telephone: [redacted] (Work)

Installer: Ivan Miller License No. 52

Proposed Work: (Check One) ☒ New Installation ☐ Existing System

☐ Repair ☐ Replacement ☐ Extension ☐ Other _____

Describe: Four 80 foot laterals, pump to gravity system, standard trenches

Parcel Description:

Legal: S14 T37N R28W, Wild Turkey Estates, Lot #4

Address or Location: 302 Snowshoe Trail, Rexford, MT

Approved Design Criteria:

Bedrooms: 4 Septic Tank Size: 1500/500 gallon Drainfield Size: 320 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

Closure Statement:

I, Robin Blumberg *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Robin Blumberg *Date:* 10/23/23

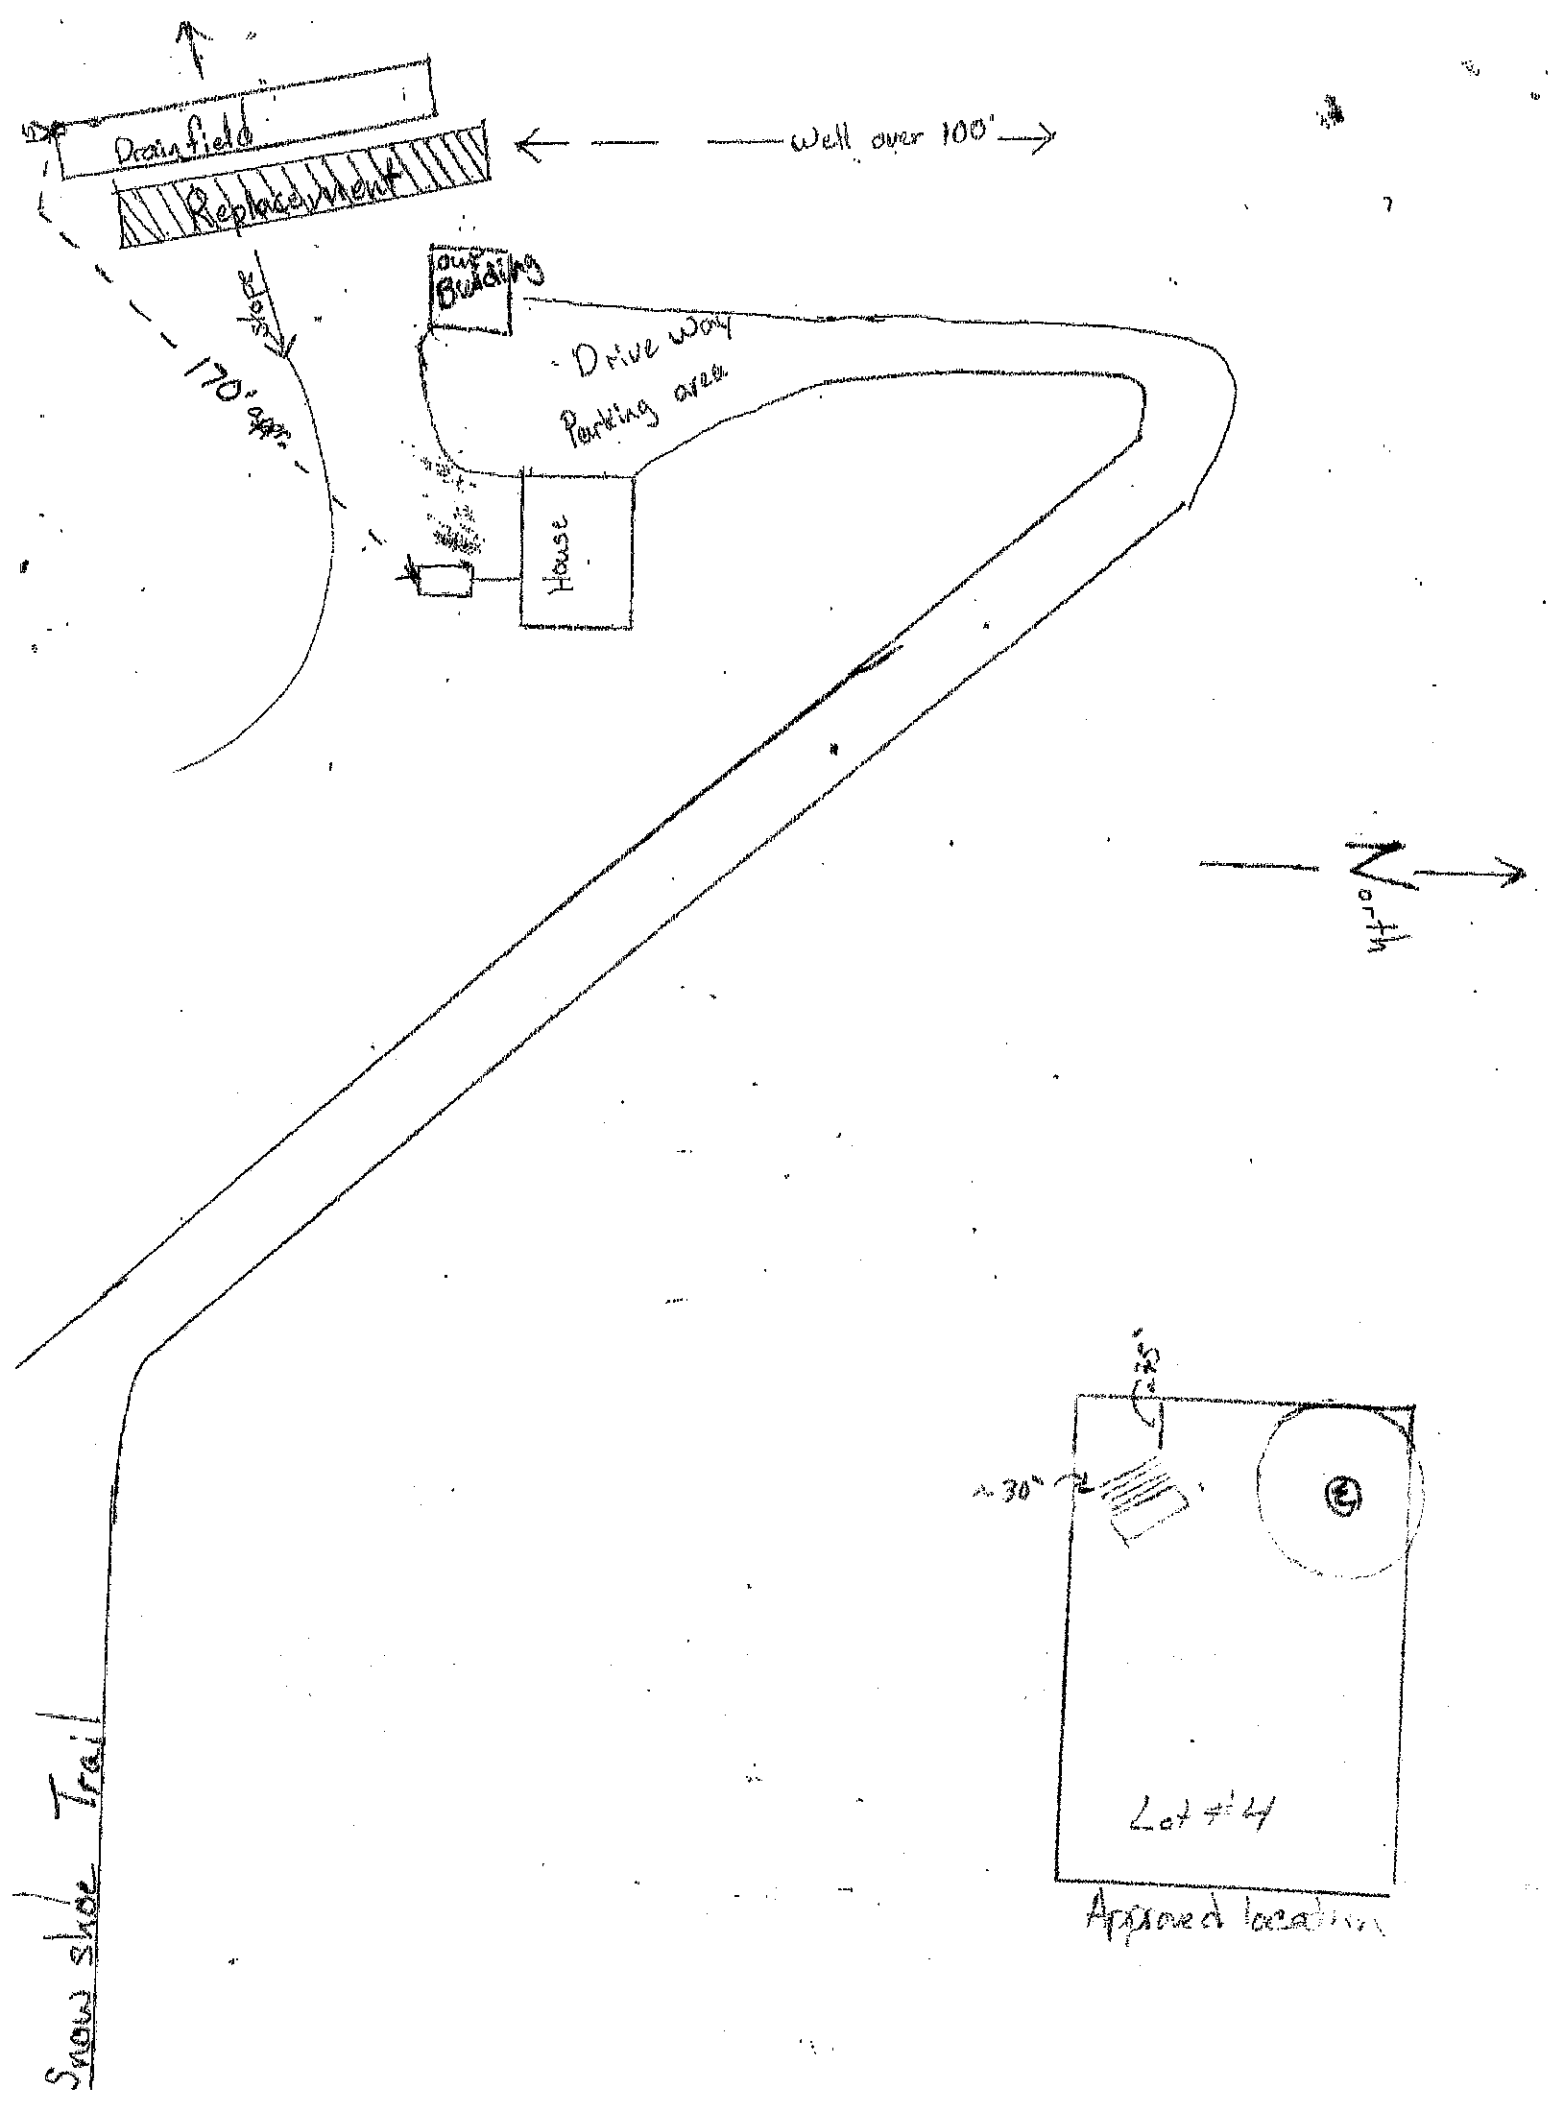
Title: SIT

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Drainfield
Replacement
Well over 100'
Shed
Out Building
Drive way
Parking area
170' approx.
House
North
Snow shoe Trail
25'
~30'
Lot #44
Approved location