LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/25/2022 Expiration Date: 05/24/2023

Property Owner: Jon Ross c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Tally Hoe License No. 1

Proposed Work: (Check One) ☐ New Installation ☒ Existing System

☐ Repair ☒ Replacement ☐ Extension ☐ Other _____

Describe: Gravity fed system using rockless chambers, four 84' laterals

Parcel Description:

Legal: S5 T31N R31W

Address or Location: 4805 Bobtail Rd

Approved Design Criteria: 4096 (RB)

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 336 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

Closure Statement:

I, Robin Blumberg *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Robin Blumberg *Date:* 9-14-23

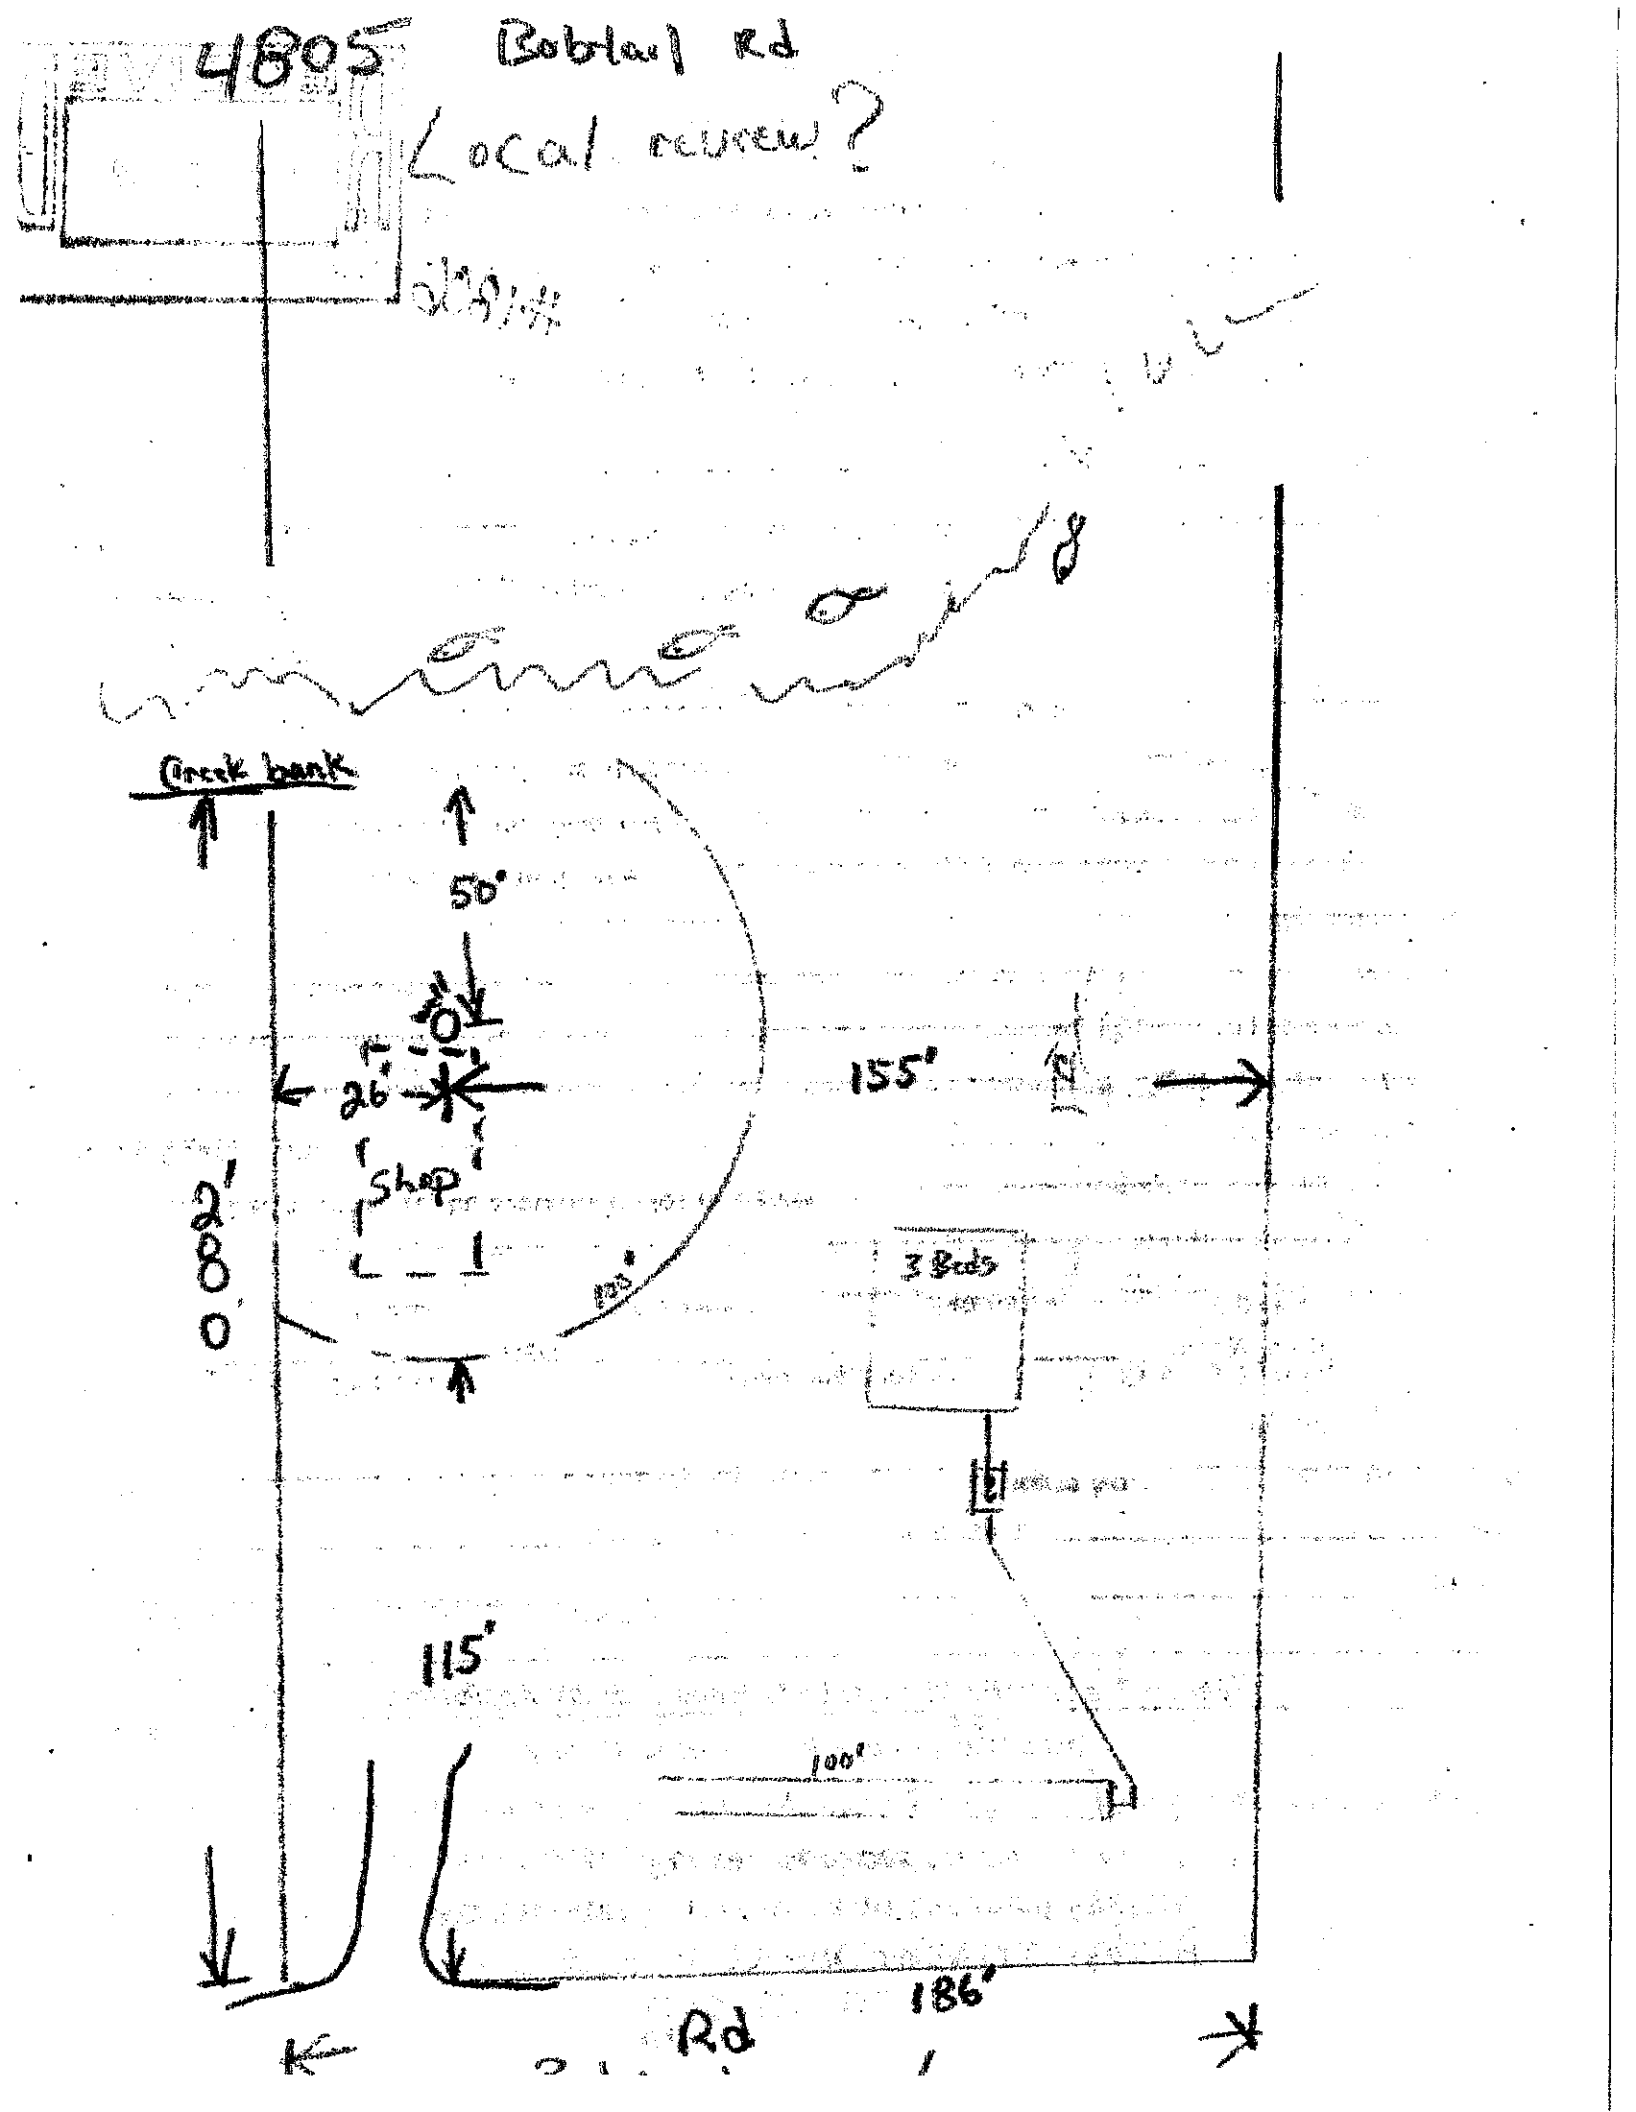
Title: STT

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


4805 Bobtail Rd
Local review?
Creek bank
50'
26'
Shop
280'
155'
3 Beds
115'
100'
186'
Rd