LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/16/2025 Expiration Date: 05/15/2026 Permit# 25-51103

Property Owner: Steven Schenck

Mailing Address: [redacted]

Installer: Ryan Blekkenk License #: 172

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system for 2 Bedroom House.

Legal: MONTANA LAKES 2, S19, T27 N, R27 W, LOT 13, ACRES 20.41, PM 7249

Property Address: 349 Klabo Dr., Libby, MT 59923 Assessment Code: 51103

DEQ COSA: E.Q.#22-2176 Date: 11/28/2022

Approved Design Criteria: Installation of new pressure dosed system for 2 Bedroom House with 2 Laterals @ 47'.

# of Bedrooms: 2 Septic Tank Size: 1000/500 Trench Width: 36"

# of Laterals: 2 Length of Laterals: 47' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, Circular DEQ-4, and COSA(If Applies). It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

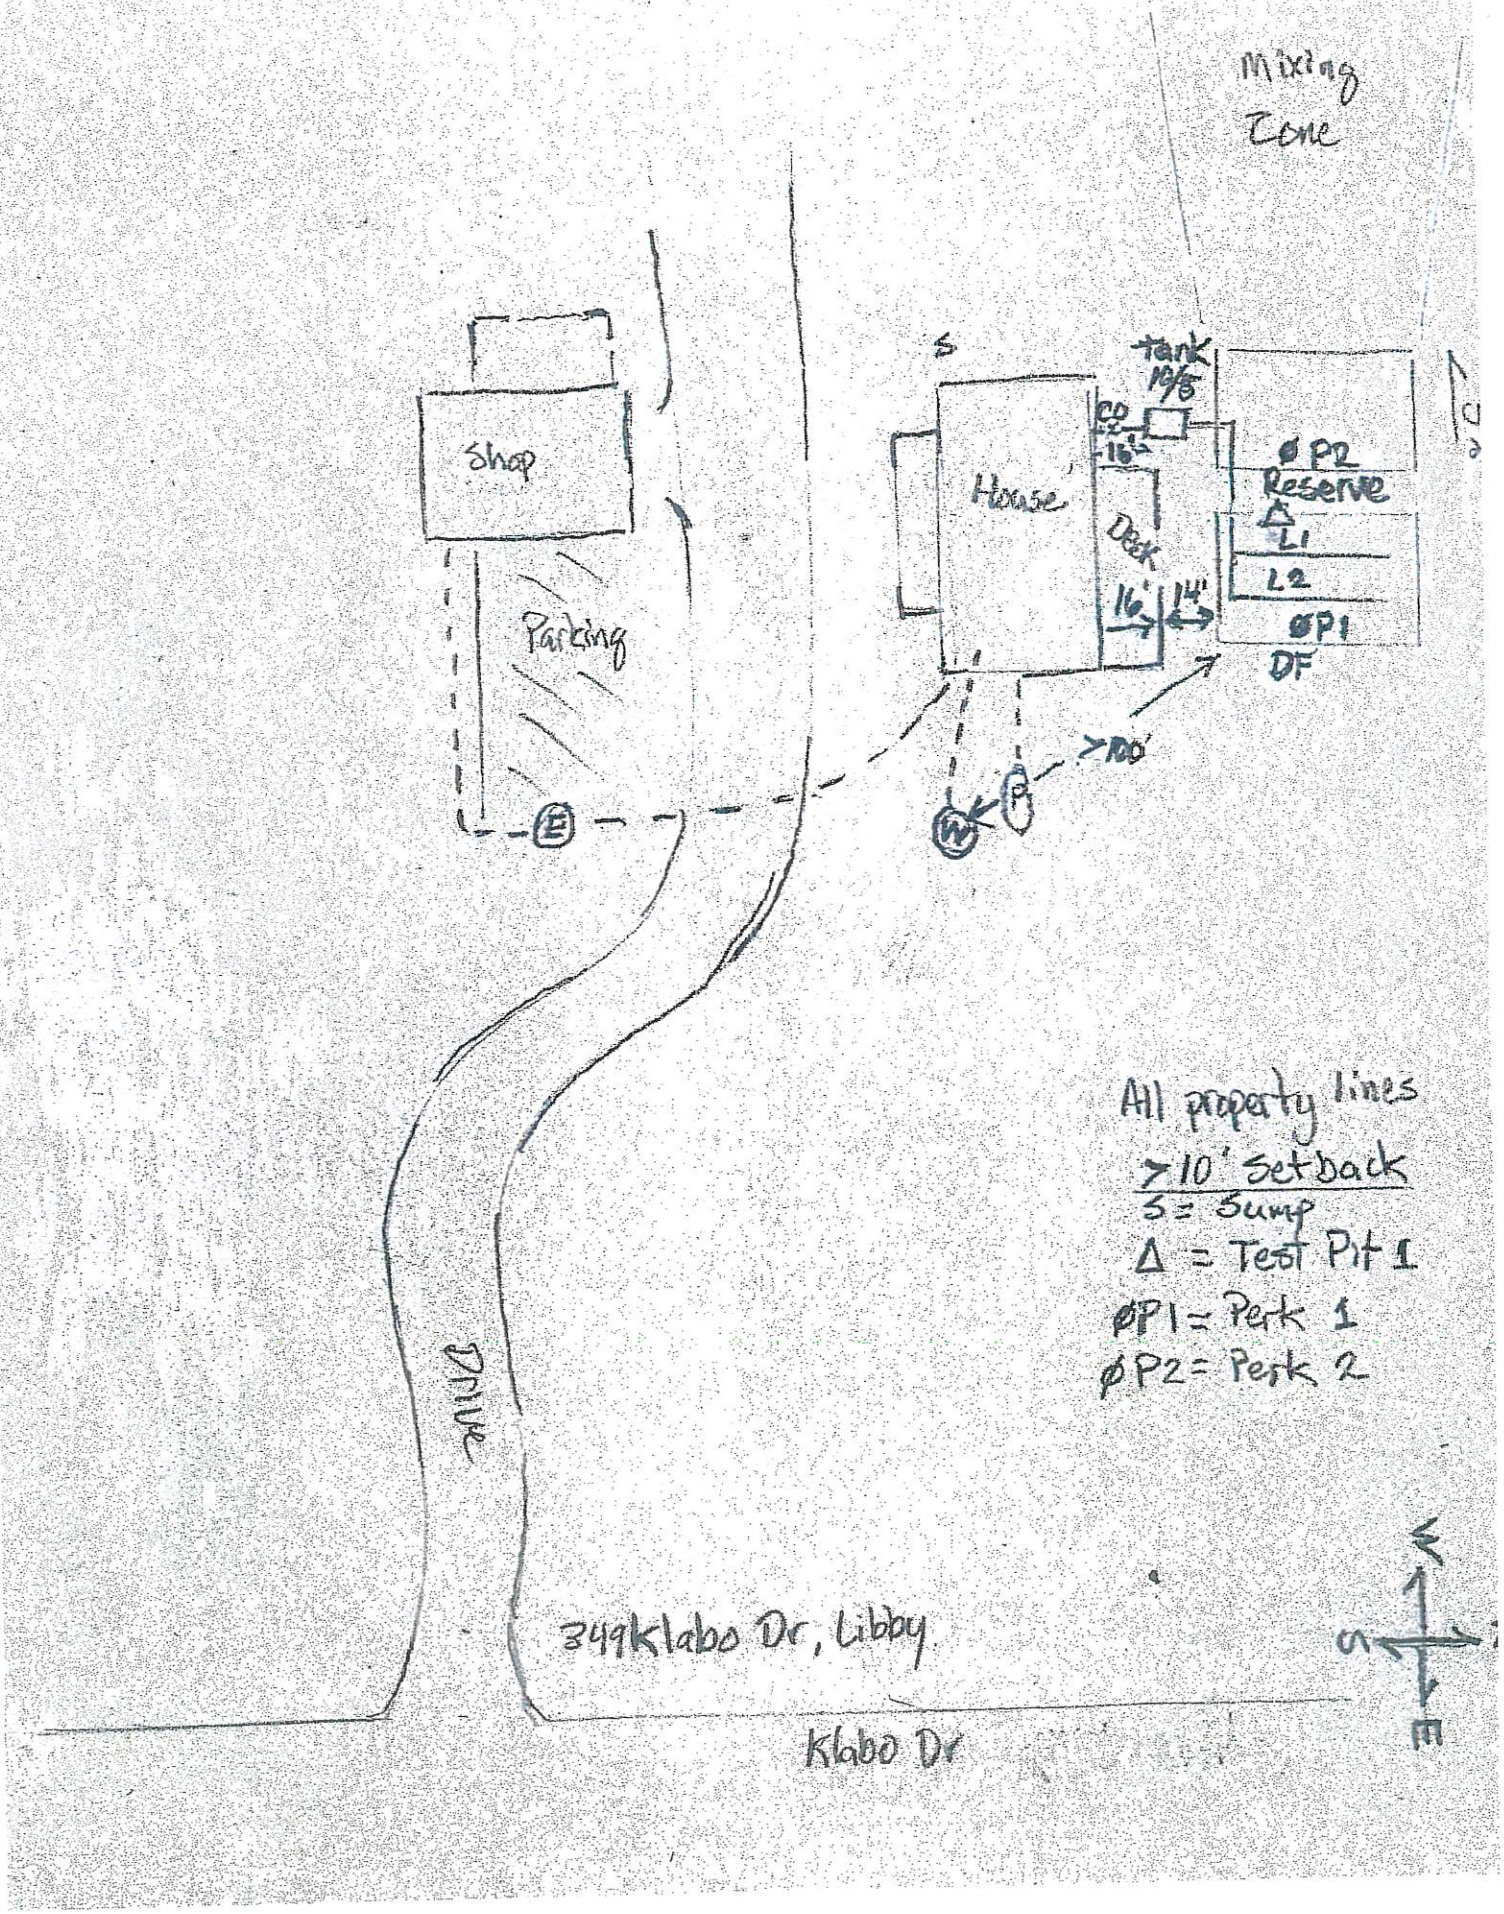
This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 5/23/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

Lot Layout


Mixing Zone
Shop
Parking
Drive
House
S
tank 1000
CO
16'
Deck
16'
14'
ØP2 Reserve
L1
L2
ØP1
DF
>100'
W
P
E
All property lines >10' setback
S = Sump
Δ = Test Pit 1
ØP1 = Perk 1
ØP2 = Perk 2
349 Klabo Dr, Libby
Klabo Dr
N
W
E
S