LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Owner

Issue Date: 8/4/2022 Expiration Date: 8/3/2023

Property Owner: William & Katie Schmucker c/o Ivan Miller Jr

Mailing Address: [redacted]

Telephone: [redacted] Email:

Installer: Ivan Miller License #: 52

Proposed Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: standard trenches, 10' apart, pump to d-box

Parcel Description:

Legal: Mountain Lion Estates Lot 1CC, S14, T37N R28W, 10.57 acres

Property Address: 4571 West Kootenai Rd, Rexford Assessment Code: 54929

Approved Design Criteria:

# of Bedrooms: 3 Septic Tank Size: 1000/500 gallons Drainfield Size: 510 square feet

# of Laterals: 3 Length of Laterals: 85 lineal feet Trench Depth: 28-32 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

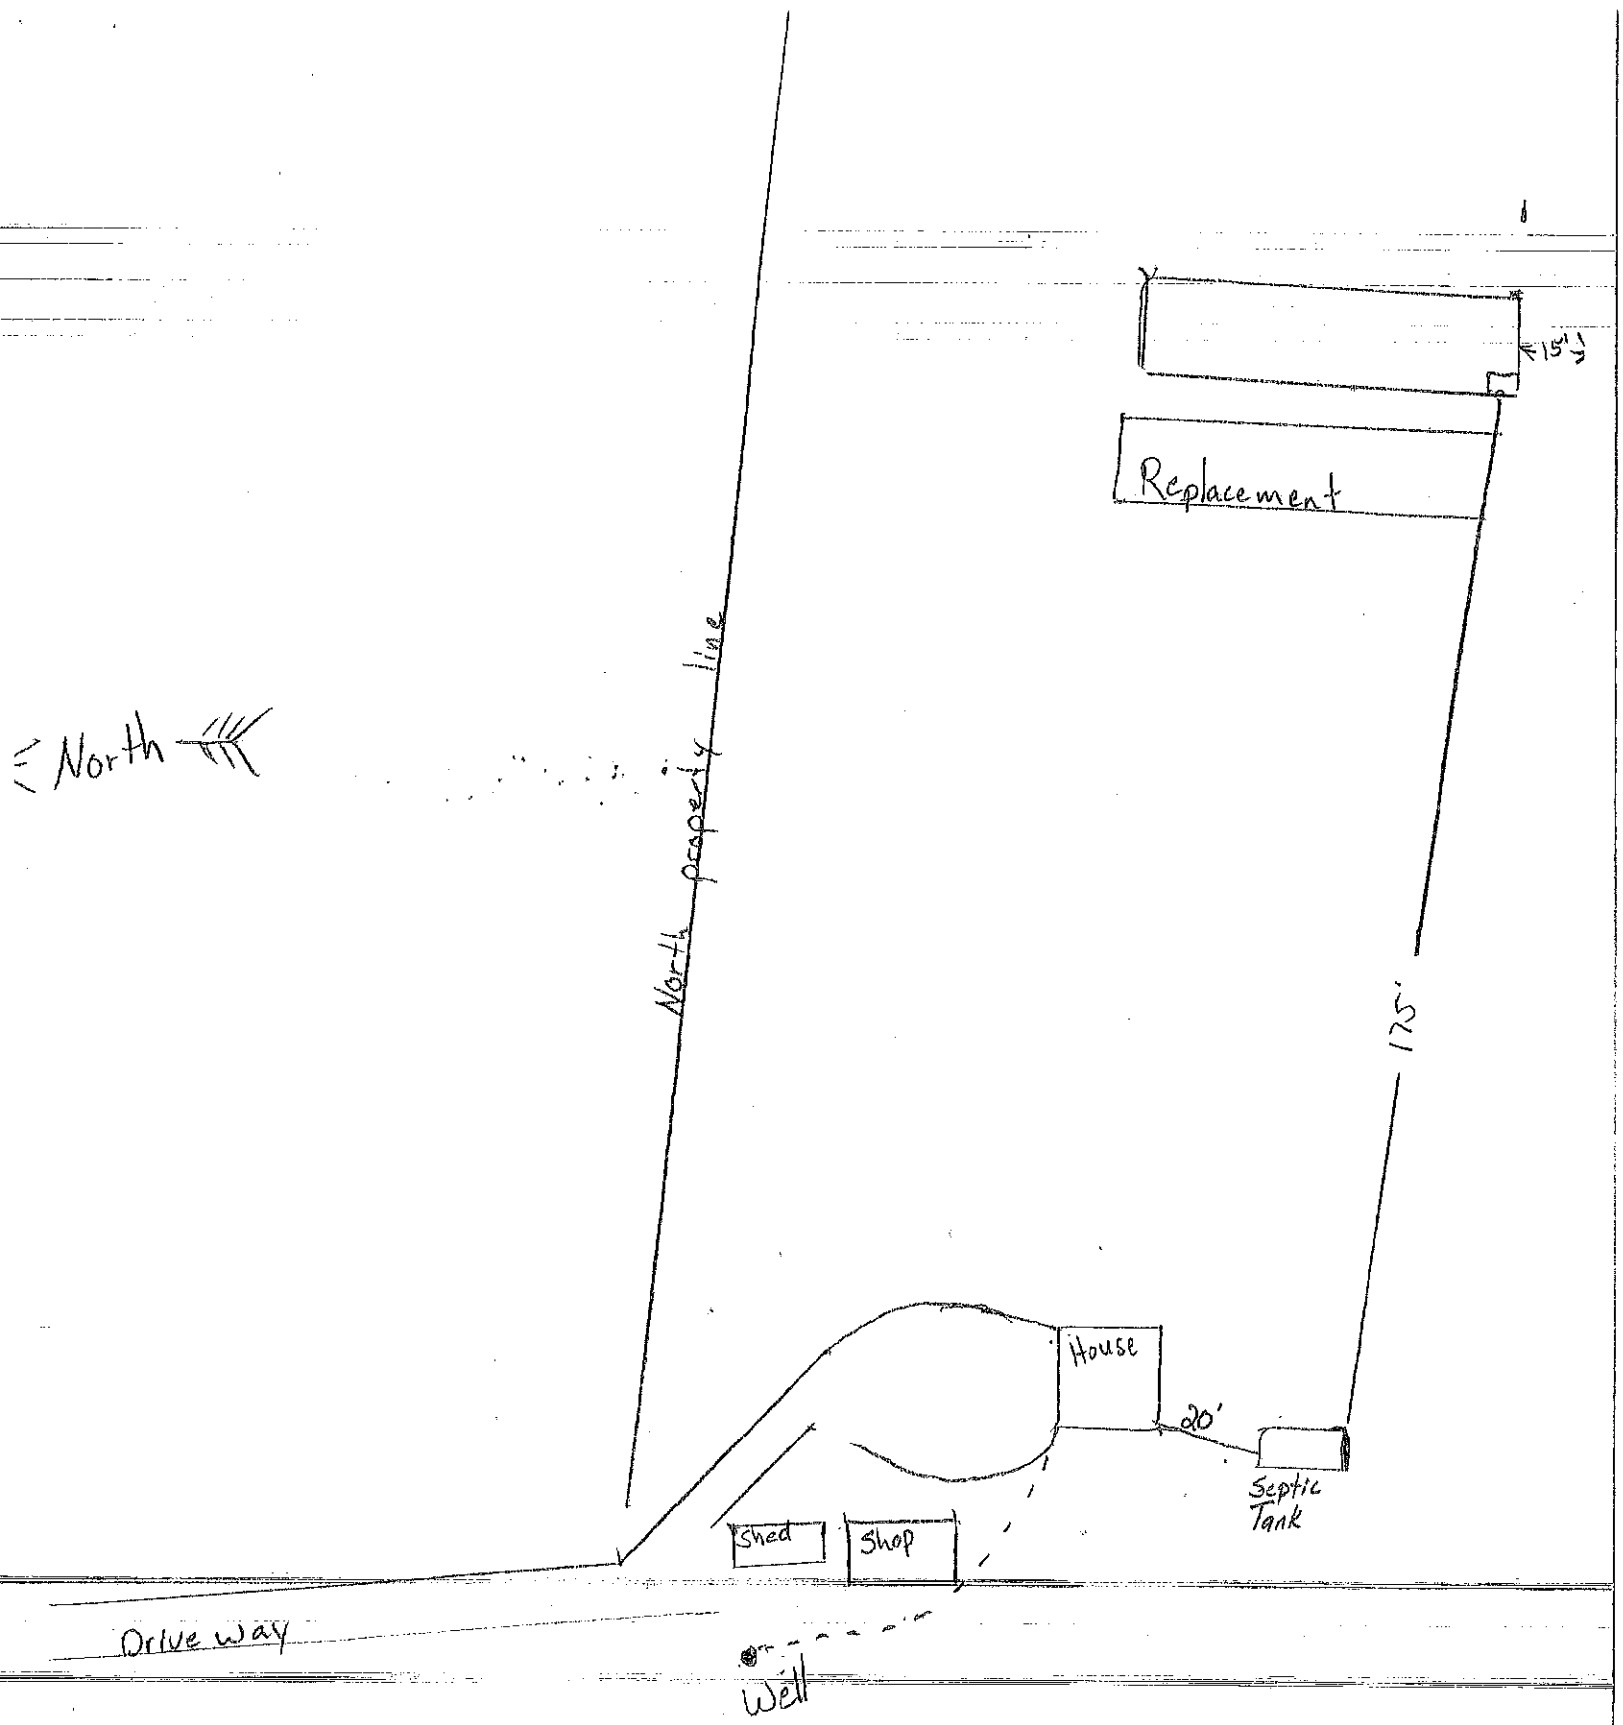
This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Ivan Miller *Date:* 8-31-2022

_____ Lincoln County Health Department (LCHD) Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


15'
Replacement
North property line
North
125'
House
20'
Septic Tank
Shed
Shop
Drive way
Well