LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 12/06/2022 Expiration Date: 12/05/2023

Property Owner: Mark S Schrank

Mailing Address: [redacted]

Telephone: [redacted] Email: [redacted]

Installer: Clason Enterprises License #: 181

Proposed Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Gravity system with standard 2' wide trenches, drain rock & perf pipe

Parcel Description:

Legal: S21 T36N R27W, COS 1370, Tract 2, 10.04 acres

Property Address: 310 Twin Lake Heights Rd, Rexford Assessment Code: 13846

Approved Design Criteria: One single family dwelling only

# of Bedrooms: 3 Septic Tank Size: 1000 gallons Trench Width: 24 inches

# of Laterals: 3 Length of Laterals: ~~95~~ 80 (RB) feet Trench Depth: 24 – 36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

I, Allen Clason, have inspected this system and found it to be in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.


Signed: Allen Clason Date: 8/29/23

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV

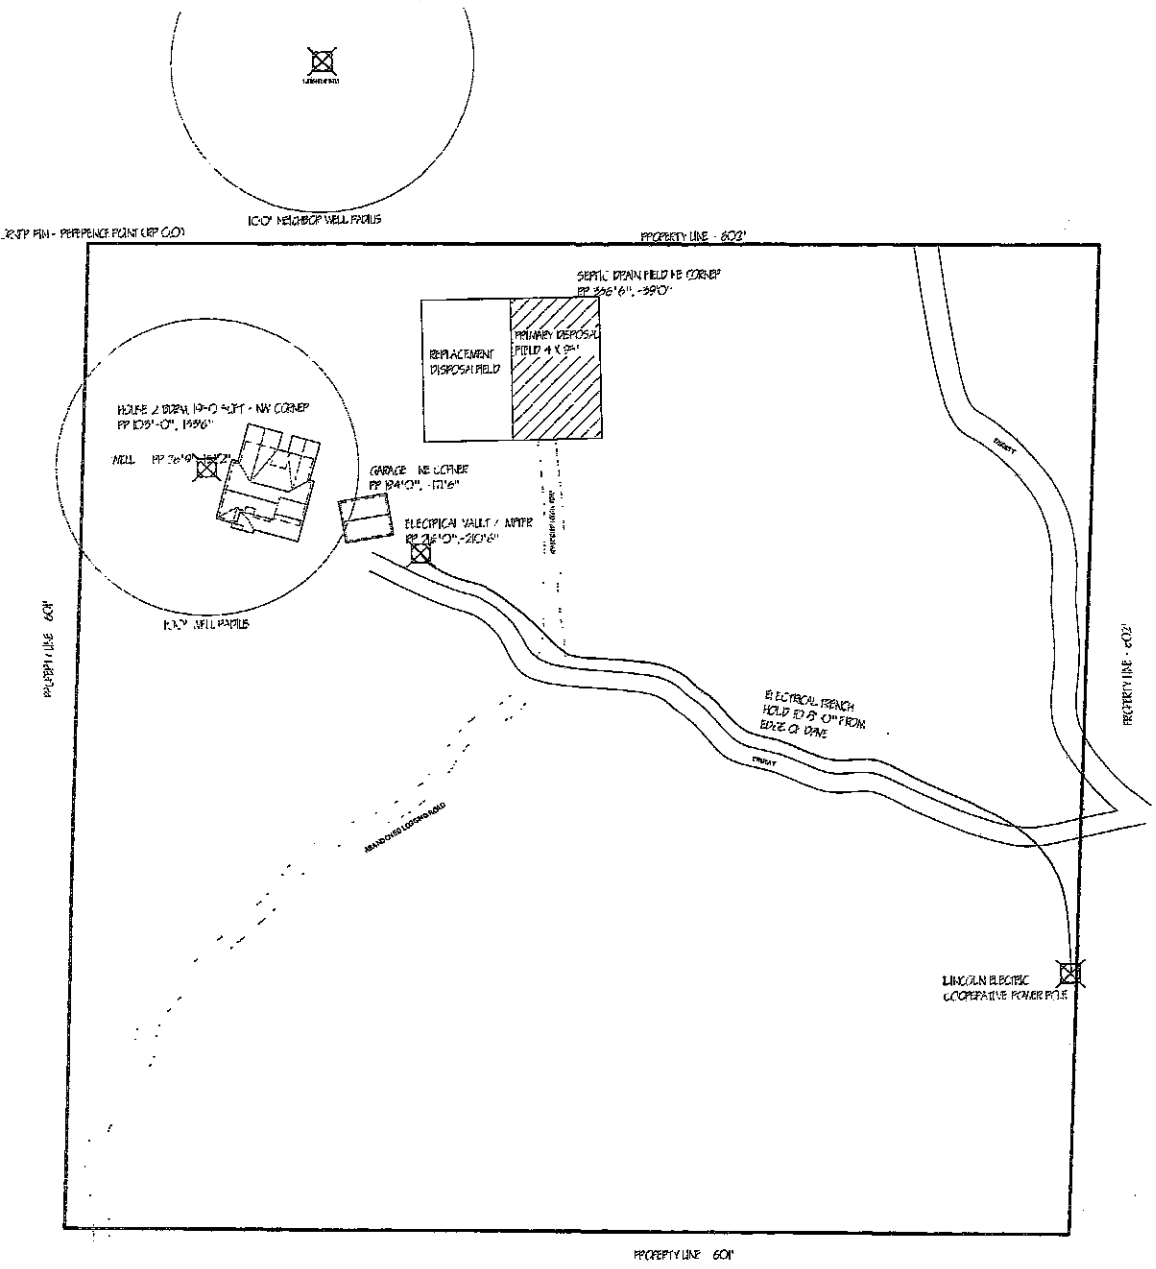

N

SITE MAP FOR:

310 TWIN LAKE HEIGHTS RD, REXFORD MT 59930
S21, T36 N, R27 W, C.O.S. 1370, ACRES 10.04, TR 2 or SWSESW
ASSR#0000013846

SCALE: 1" = 80'-0"

5' 20' 80' 300'
10' 40' 150'