LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/11/22 Expiration Date: 8/10/23

Property Owner: Mark Spehar

Mailing Address: [redacted]

Telephone: [redacted] Email: [redacted]

Installer: Rupert Schreiner License #: 19

Proposed Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Gravelless trenches/infiltrators, 2 one bed cabins for parttime use on single system

Parcel Description:

Legal: Clark Heights, Lot 1A, CS 4271, S19 T33N R26W, 35.03 acres

Property Address: 2828 Lake Creek Rd, Trego Assessment Code: 10255

Approved Design Criteria:

# of Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 336 square feet

# of Laterals: 2 Length of Laterals: 84 feet Trench Depth: 30 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. 10% reduction given for chambers. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

I, Rupert Schreiner have inspected this system and found it to be in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

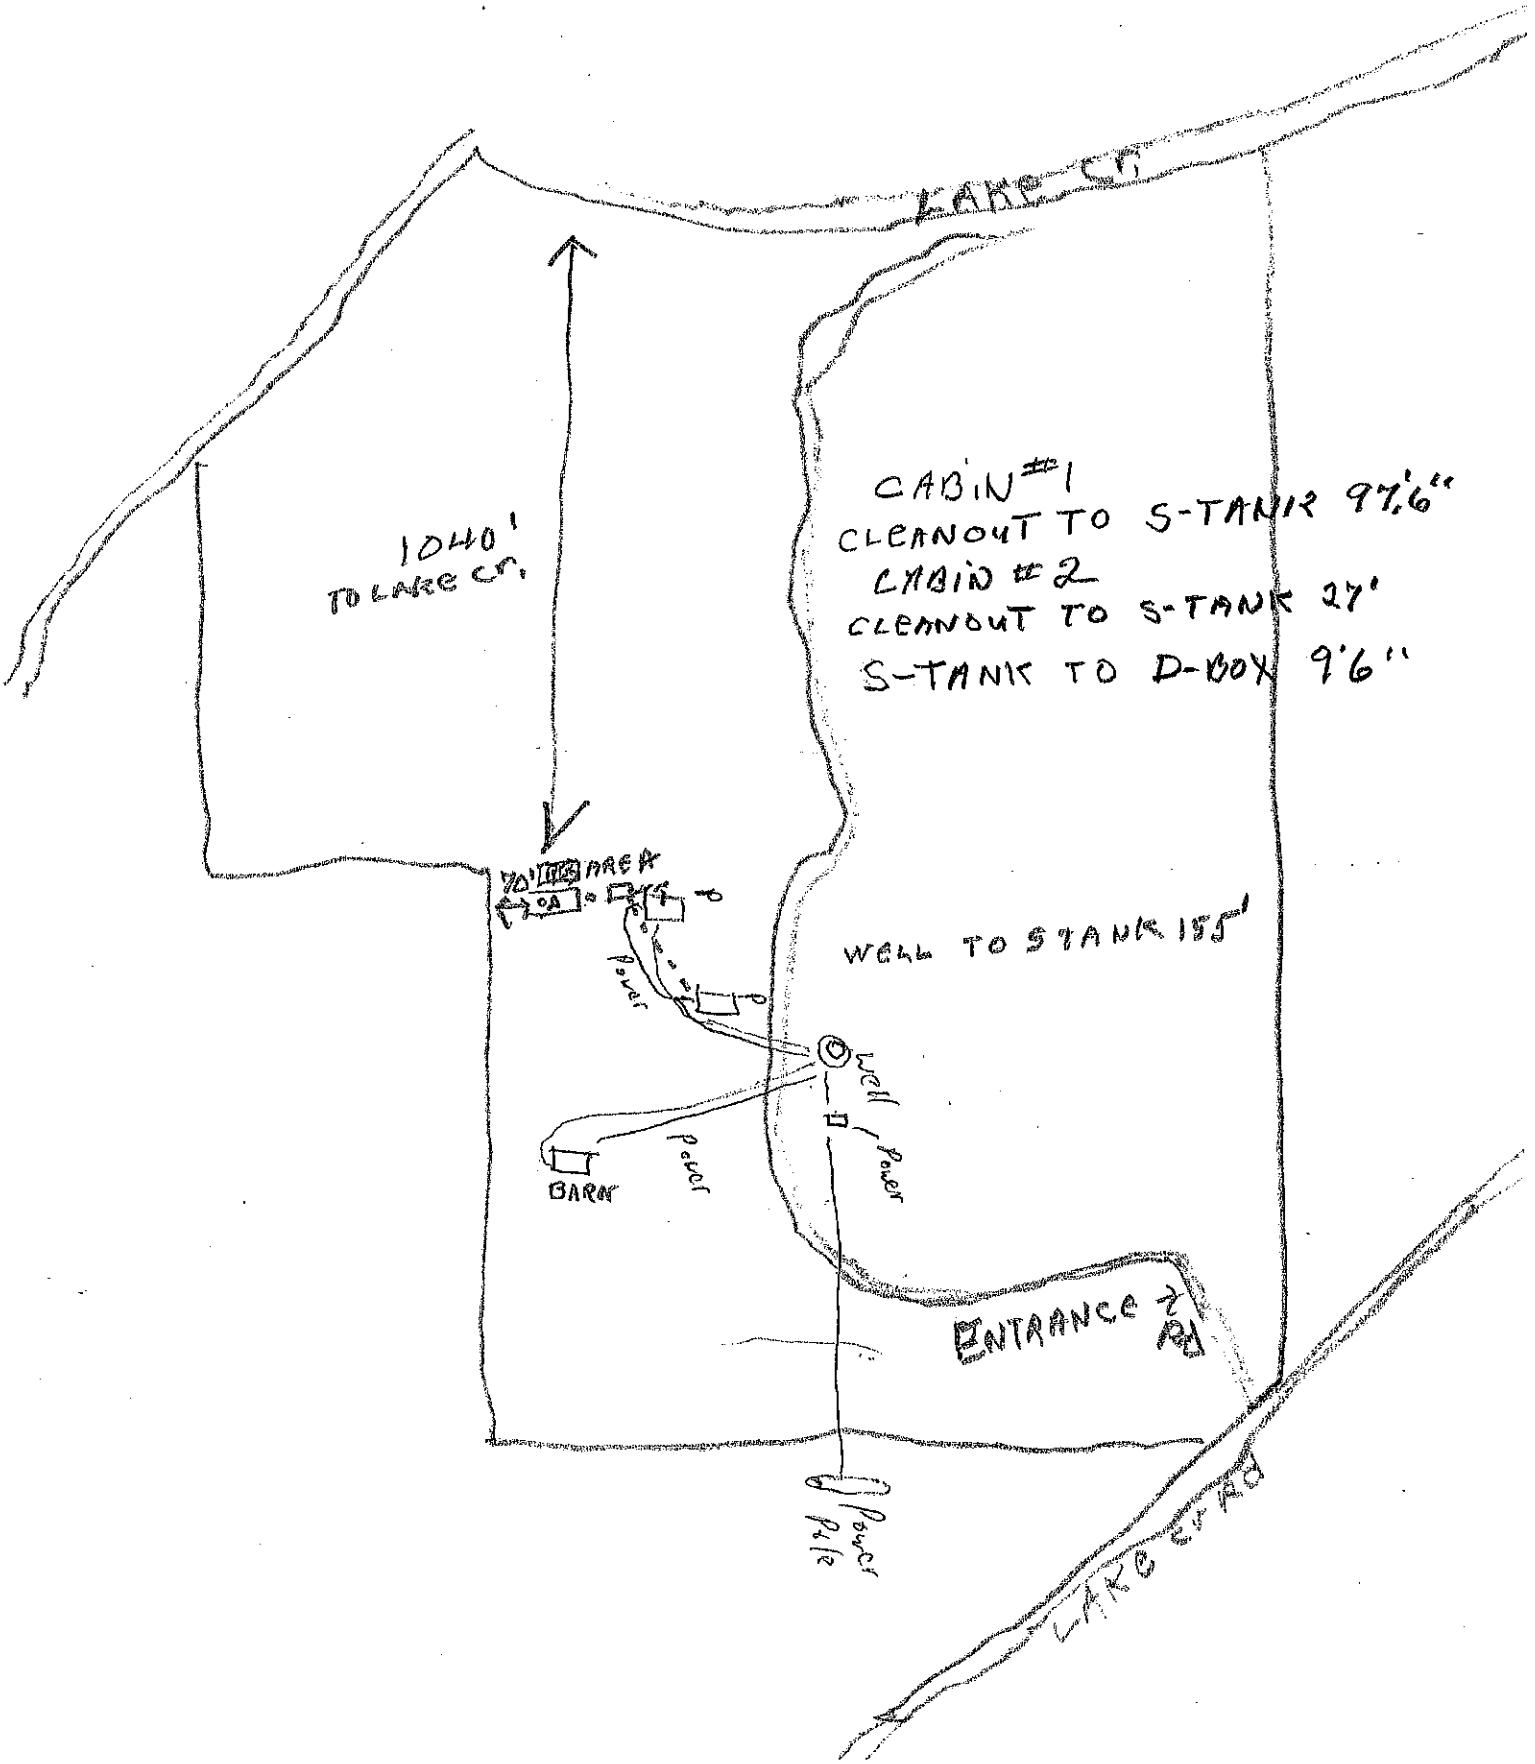
Signed: Rupert Schreiner *Date:* 9-10-22

____ Lincoln County Health Department (LCHD) 19 Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

MARK Shehar


LAKE CR
1040'
TO LAKE CR.
CABIN #1
CLEANOUT TO S-TANK 97.6"
CABIN #2
CLEANOUT TO S-TANK 27'
S-TANK TO D-BOX 9'6"
WELL TO STANK 155'
Power
Well
Power
BARN
Power
ENTRANCE
Power Pole
LAKE ROAD