LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 04/22/2022 Expiration Date: 04/22/2023

Property Owner: Spence, David/Forrest c/o:

Address: [redacted]

Telephone: [redacted]

Installer: Miller Excavaitng (I. Miller) License No. 52

___ New Installation ____ Existing System

____ Repair __XX__ Replacement ____ Extension ____ Other

Describe: 1,000-gallon septic tank with effluent filter. Gravity feed system with standard absorption trenches. 2 laterals at 50-feet in length each.

Parcel Description:

Legal: PINE VALLEY ACRES, S13, T37 N, R28 W, ACRES 1, LOT 13

Address or Location: 416 Pine Valley Dr, Rexfor, MT 59930

Geo/Assessors code: 0000005472

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1,000 gallon Drainfield Size: 100 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Nicholas Raines*

Closure Statement:

I, Ivan Miller *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Ivan Miller *Date:* 5-23-2022

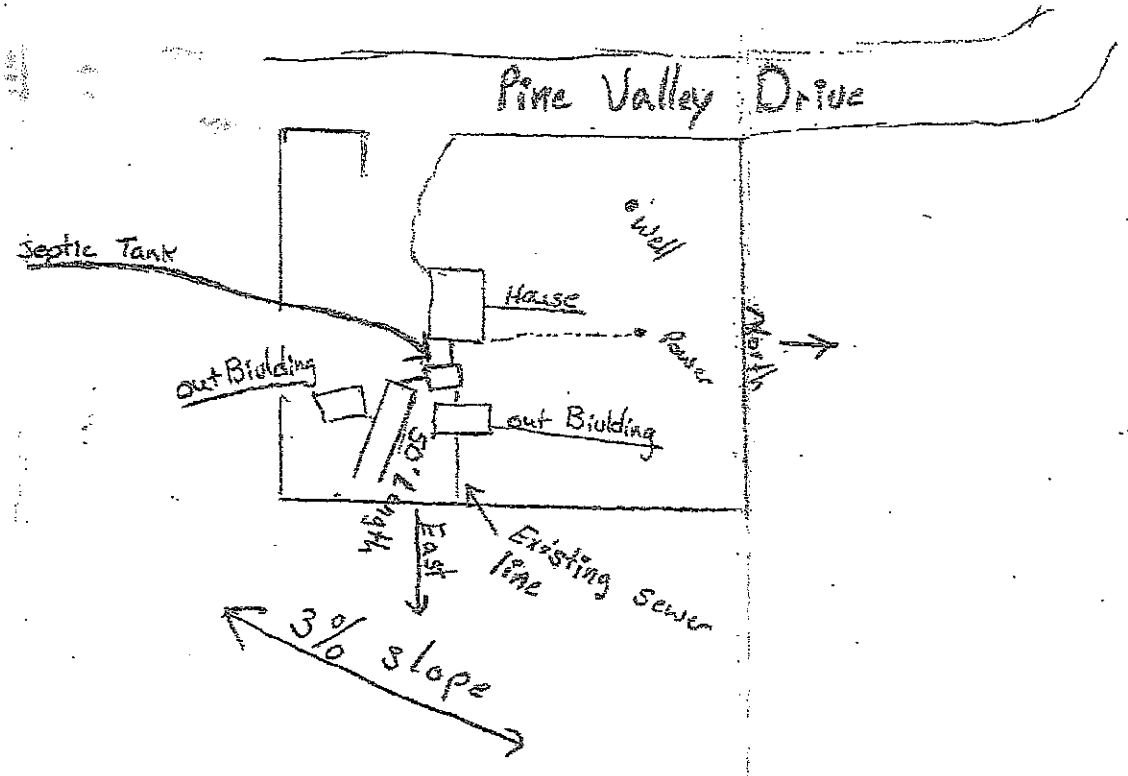
Title: installer

NOTICE: The Department must be notified at least 48 business hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Pine Valley Drive
Septic Tank
House
well
Power
North
out Building
out Building
70'
4" drain
Test
Existing sewer line
3% slope