LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 7/13/2022 Expiration Date: 7/13/2023

Property Owner: Craig Stark

Mailing Address: [redacted]

Telephone: [redacted] Email: [redacted]

Installer: Terry Oedewaldt License #: 02

Proposed Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Install (3) 70' chambers

Parcel Description:

Legal: S35, T31 N, R31 W, C.O.S. 4671FC, PARCEL B, ACRES 1.65

Property Address: Parcel B Assessment Code: 14615

Approved Design Criteria:

# of Bedrooms: 2 (Each side) Septic Tank Size: (2)1000 gallons Drainfield Size: 210 square feet

# of Laterals: 3 Length of Laterals: 70 lineal feet Trench Depth: 24-36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Kathi J. Hooper. R.S.

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* 11/9/2022


____ Lincoln County Health Department (LCHD) ✓ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV

STARIC SEPTIC 11/9/2022

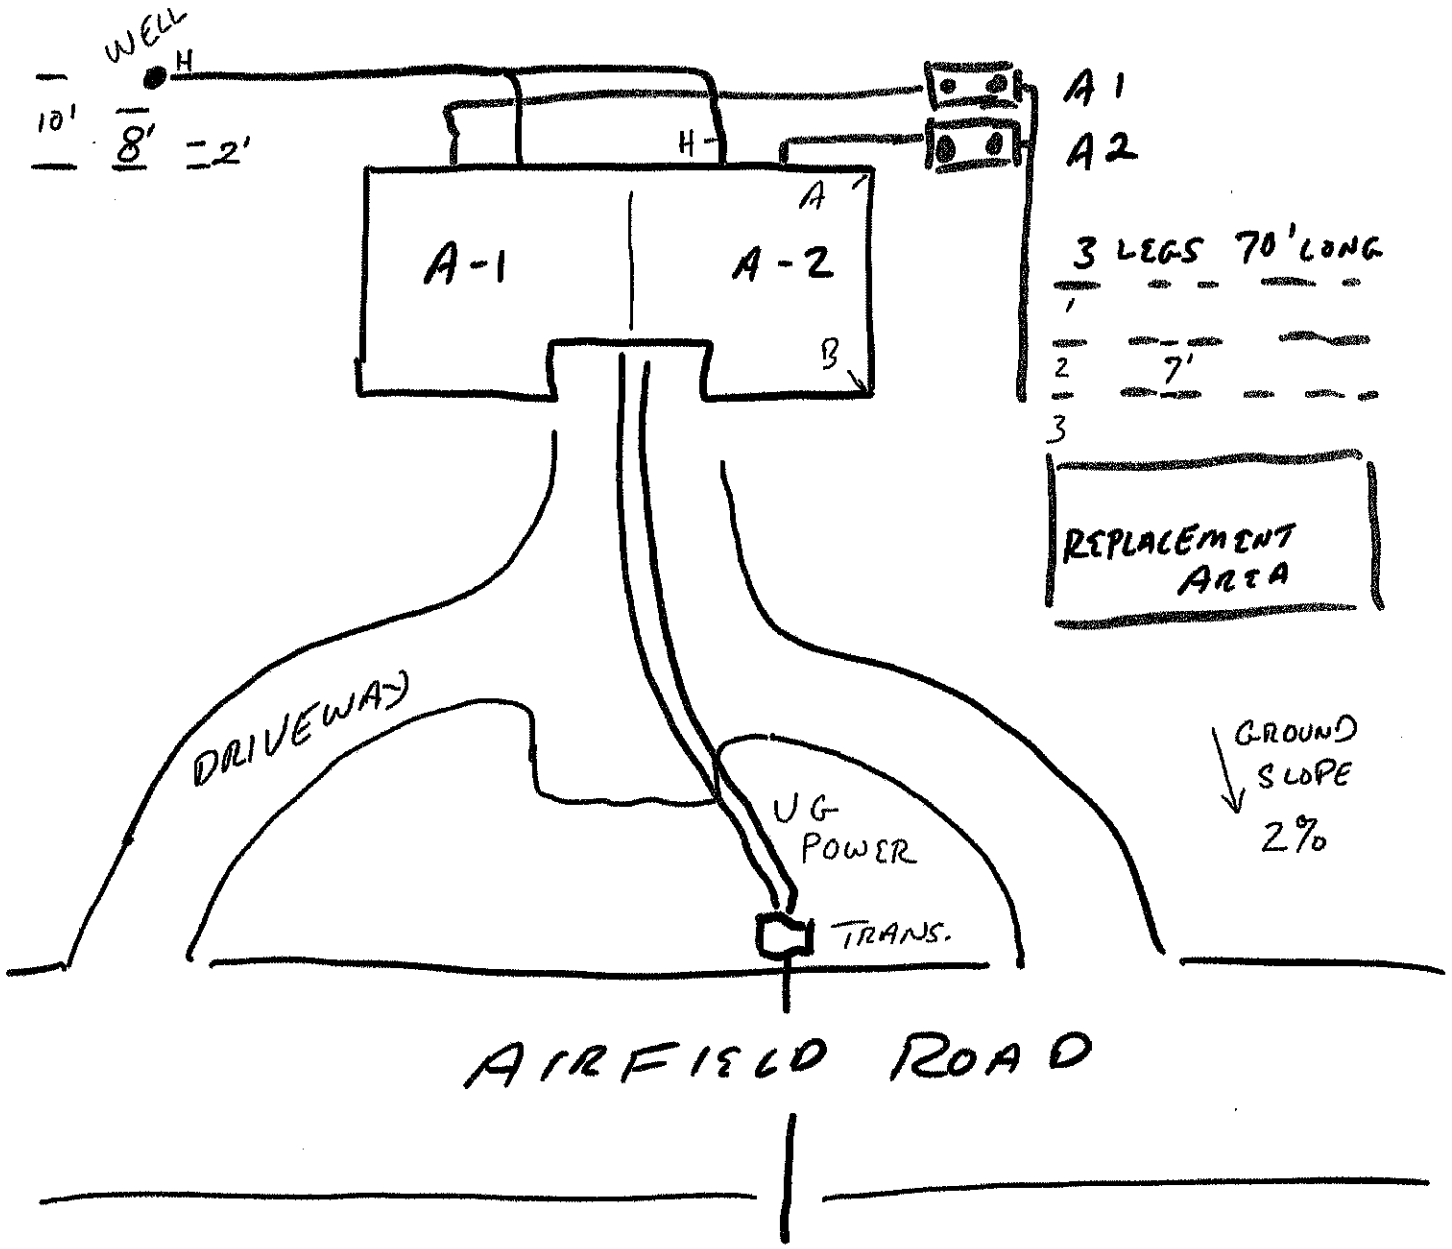

LOCATIONS:	A	B
A-1 INLET	12'9	41'6
A-1 FILTER/OUTLET	18'3	43'4
A-2 INLET	10'	35'2
A-2 FILTER/OUTLET	16'4	37'10
LEG 1	21'9	28'
LEG 2	26'	24'6