County

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 04/15/2022 Expiration Date: 04/15/2023

Property Owner: Strope Holdings LLC c/o:

Address: [redacted]

Telephone: [redacted]

Installer: Tally Hoe License No. 1

___ New Installation ____ Existing System

____ Repair __XX__ Replacement ____ Extension ____ Other

Describe: 1,000-gallon septic tank with effluent filter. Gravity feed system with graveless trenches (infiltrators). 4 laterals at 40-feet in length each.

Parcel Description:

Legal: RIVERSIDE DRIVE, S32, T31 N, R31 W, ACRES 6.65, TRS 10 & 11 OR PARCELS A & B CS 3333

Address or Location: 12 Lewis Loop Lot 12

Geo/Assessors code: 0000008513

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1,000 gallon Drainfield Size: 160 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Nicholas Raines

Closure Statement:

I, Thomas J Cole *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

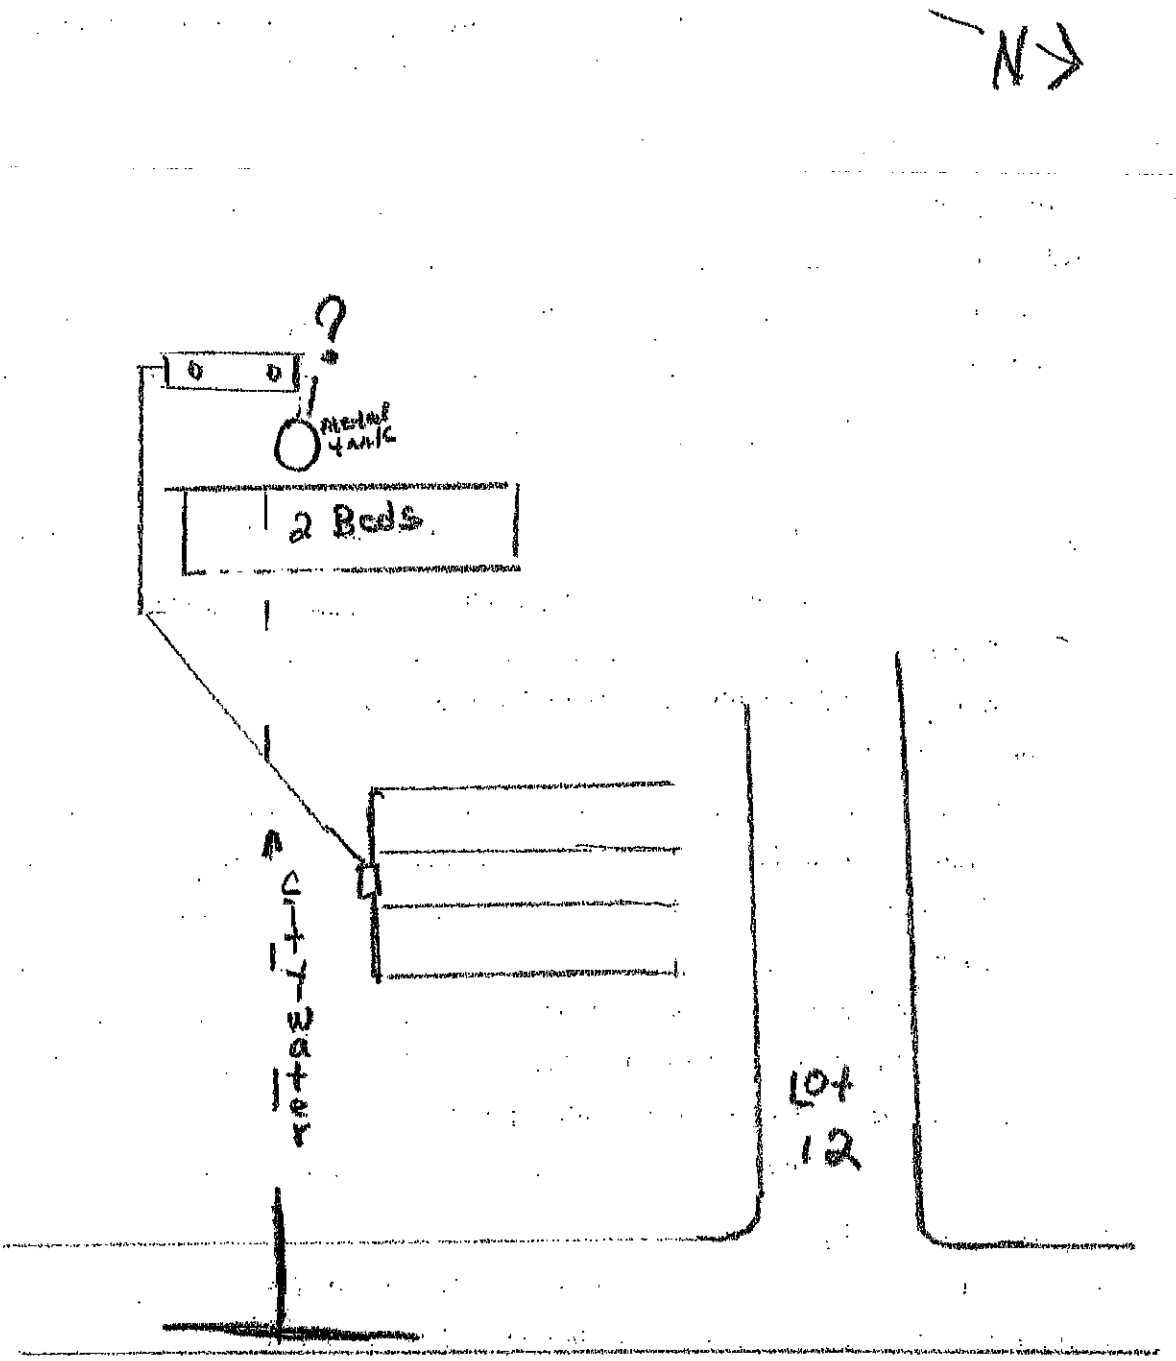
Signed: Thomas J Cole *Date:* 4-16-22

Title: owner operator

NOTICE: **The Department must be notified at least 48 business hours prior to backfilling the system**. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.
406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


N
?
Electric
4 amp
2 Beds
City water
Lot
12