LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Sign * return

Issue Date: 06/02/2022 Expiration Date: 06/01/2023

Property Owner: Strope Holding LLC c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Tally Hoe License No. 1

Proposed Work: (Check One) ☐ New Installation ☒ Existing System

☐ Repair ☒ Replacement ☐ Extension ☐ Other _____

Describe: Replace tank and install three 70' laterals with infiltrators

Parcel Description:

Legal: S32 T31N R31W, Trs 10 & 11, Parcel A & B

Address or Location: 12 Lewis Loop Rd, Trailer #31

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1000 gallon Drainfield Size: 210 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

Closure Statement:

I, Thomas J Cole, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: Thomas J Cole *Date:* 6-3-22

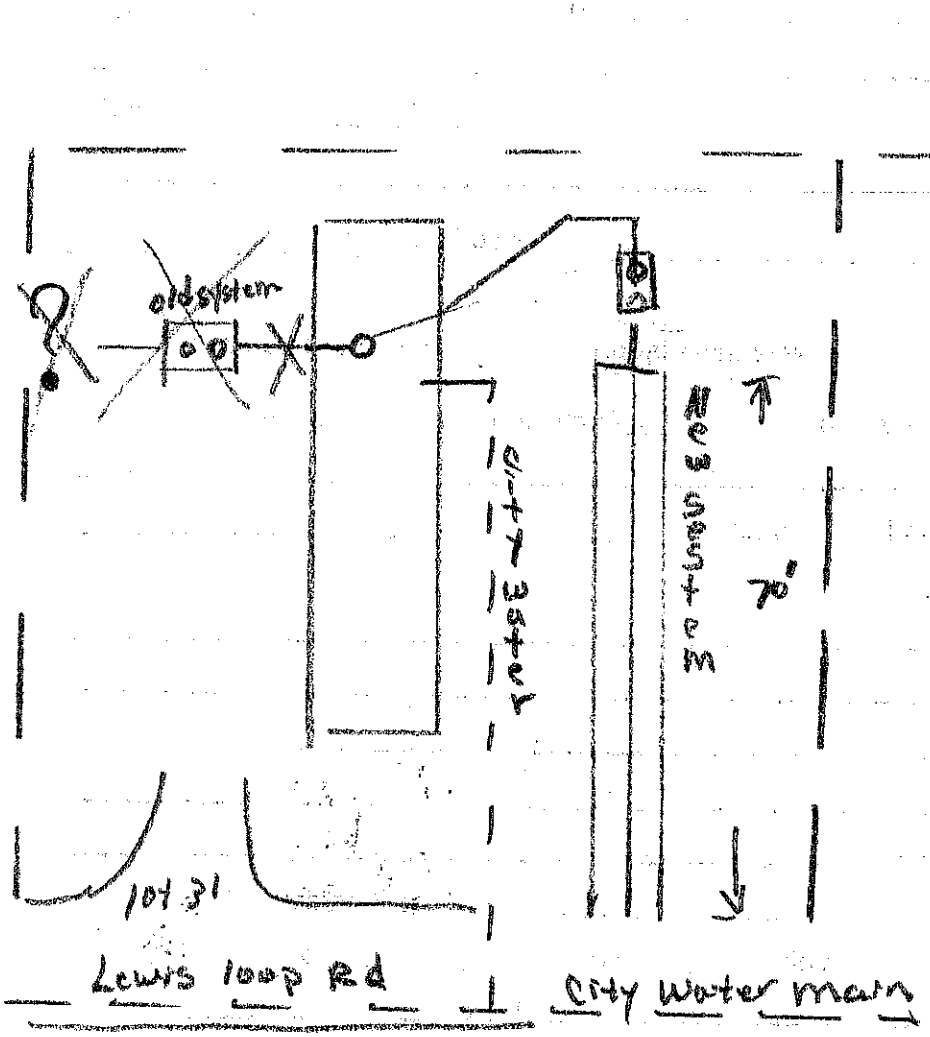
Title: owner operator

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442 you did come and see

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


N
old system
clean water
new septic
70'
104.31
Lewis loop Rd
City water main