LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/25/2022 Expiration Date: 06/24/2023

Property Owner: Tim & Melinda Thompson c/o Evensen Engineering

Mailing Address: [redacted]

Telephone: [redacted] Email:

Installer: Dustin Welch License #: 155

Proposed Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Commercial system for RV sites per EQ #21-2205, pressure dosed

Parcel Description:

Legal: S17 T29N R33W, Route 56 RV Subdivision

Property Address: 12686 Bull Lake Rd, Troy Assessment Code: 5801

Approved Design Criteria:

Max Discharge: 2000 gpd Septic Tank Size: 2@2500g &1500g dose Drainfield Size: 2520 square feet

# of Laterals: 10 (2 zones @ 5 each) Length of Laterals: 84 feet Trench Depth: 24-36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:


I, _____, have inspected this system and found it to be in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

_____ Lincoln County Health Department (LCHD) _____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

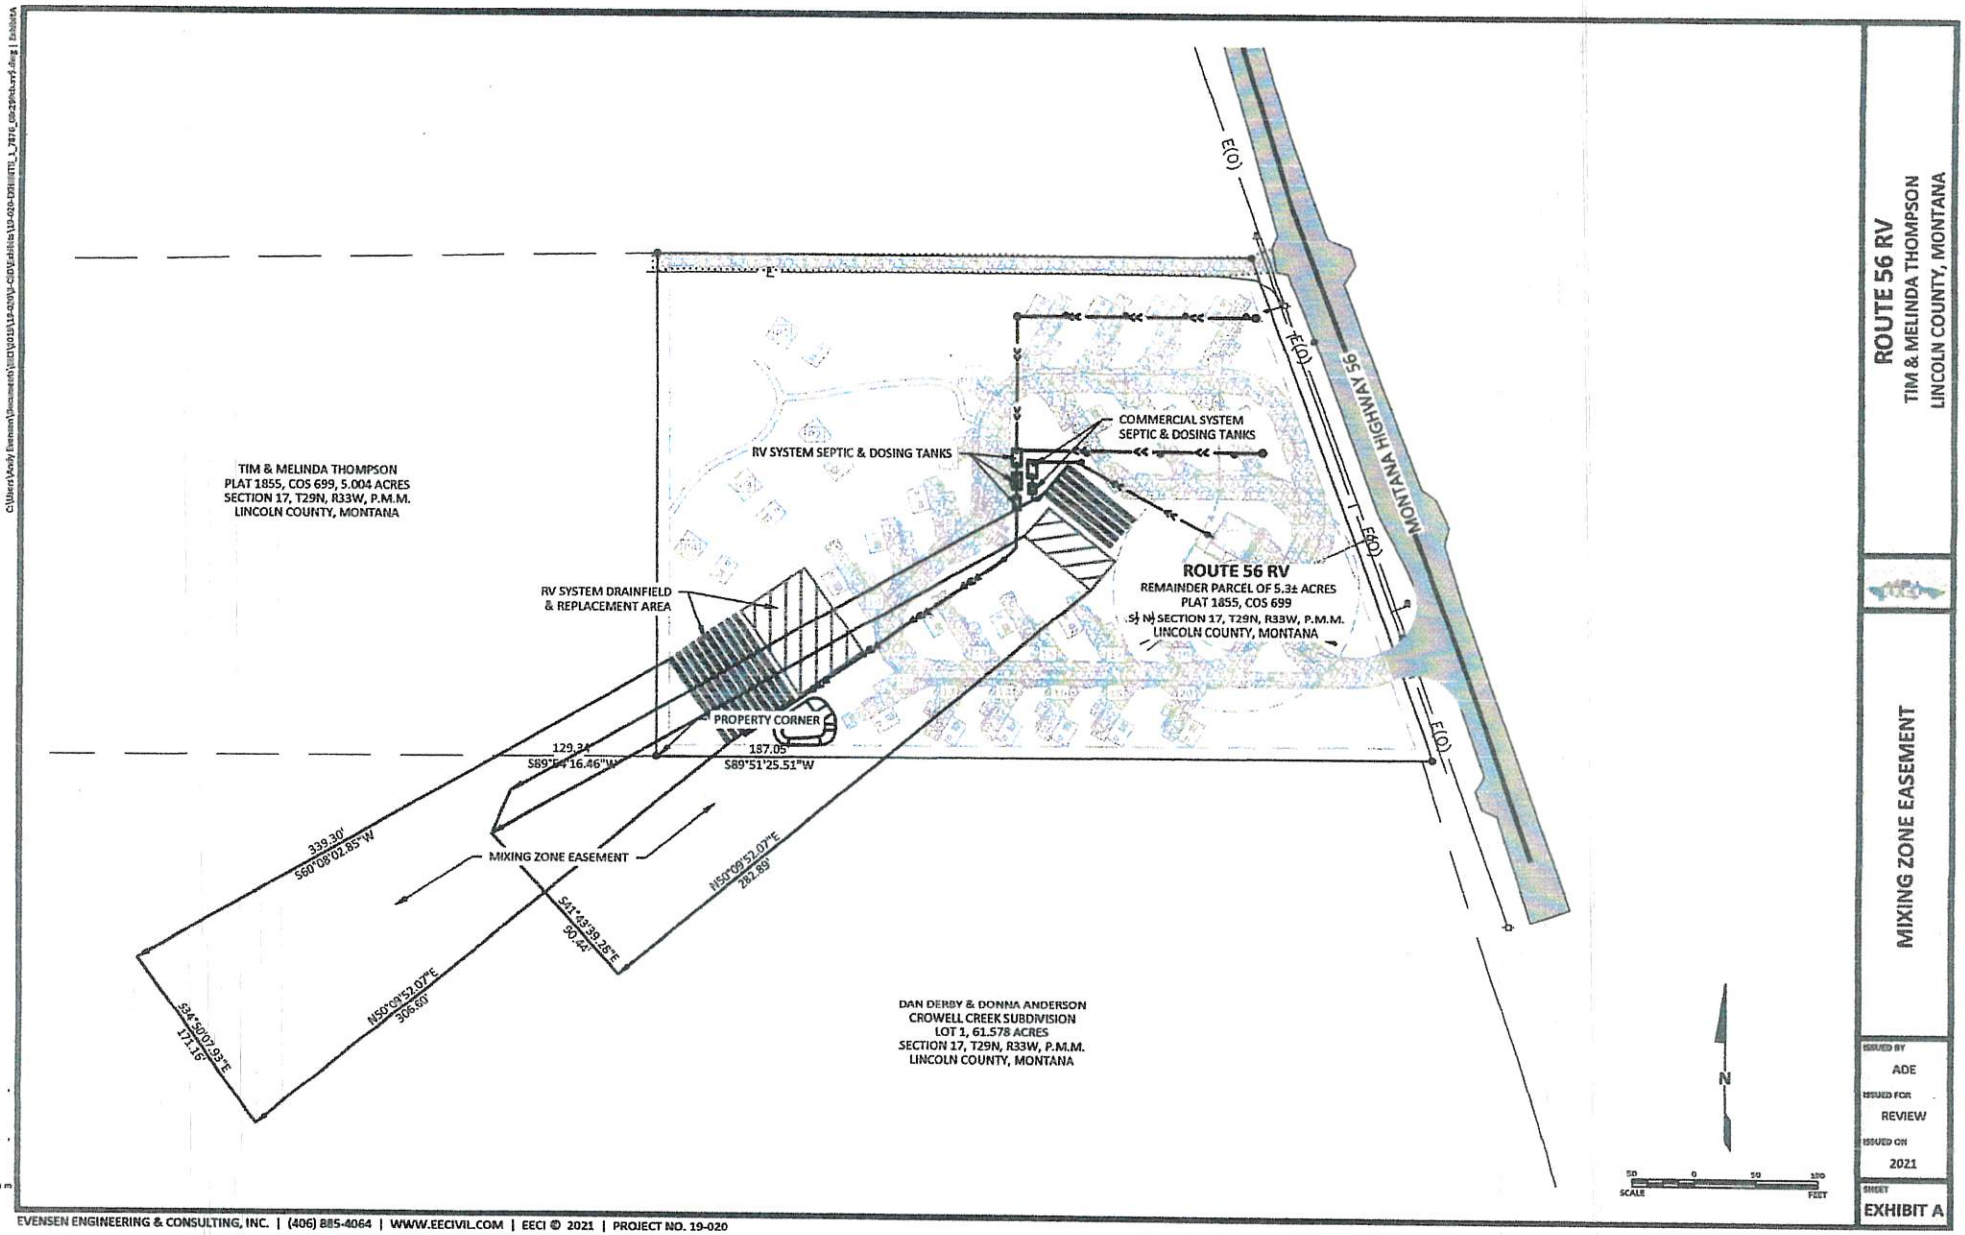

ROUTE 56 RV
TIM & MELINDA THOMPSON
LINCOLN COUNTY, MONTANA

MIXING ZONE EASEMENT

ISSUED BY
ADE
ISSUED FOR
REVIEW
ISSUED ON
2021
SHEET
EXHIBIT A

REVISION	DATE	MODIFICATION
1		
2		
3		

EVENSEN ENGINEERING & CONSULTING, INC. | (406) 885-4064 | WWW.EECIVIL.COM | EECI © 2021 | PROJECT NO. 19-020