LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 9/6/2022 Expiration Date: 9/5/2023

Property Owner: Sue L. Utter

Mailing Address: [redacted]

Telephone: [redacted] Email: [redacted]

Installer: Bradley S Persson License #: 159

Approved Work: ☐ New Installation ☒ Existing System

☒ Replace Drainfield ☒ Replace Tank ☐ Extension

Describe: Old tank will be filled with sand and abandoned, gravity system with chambers

Parcel Description:

Legal: Minor 5053, Lot 1, S35 T37N R27W, 3 acres

Property Address: 456 Lindsay Rd, Eureka Assessment Code: 16879

Approved Design Criteria:

# of Bedrooms: 3 Septic Tank Size: 1500 gallons Drainfield Size: 450 sq ft

# of Laterals: 4 Length of Laterals: 56.25 feet Trench Depth: 28 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

I, Miranda Davis, have inspected this system and found it to be in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

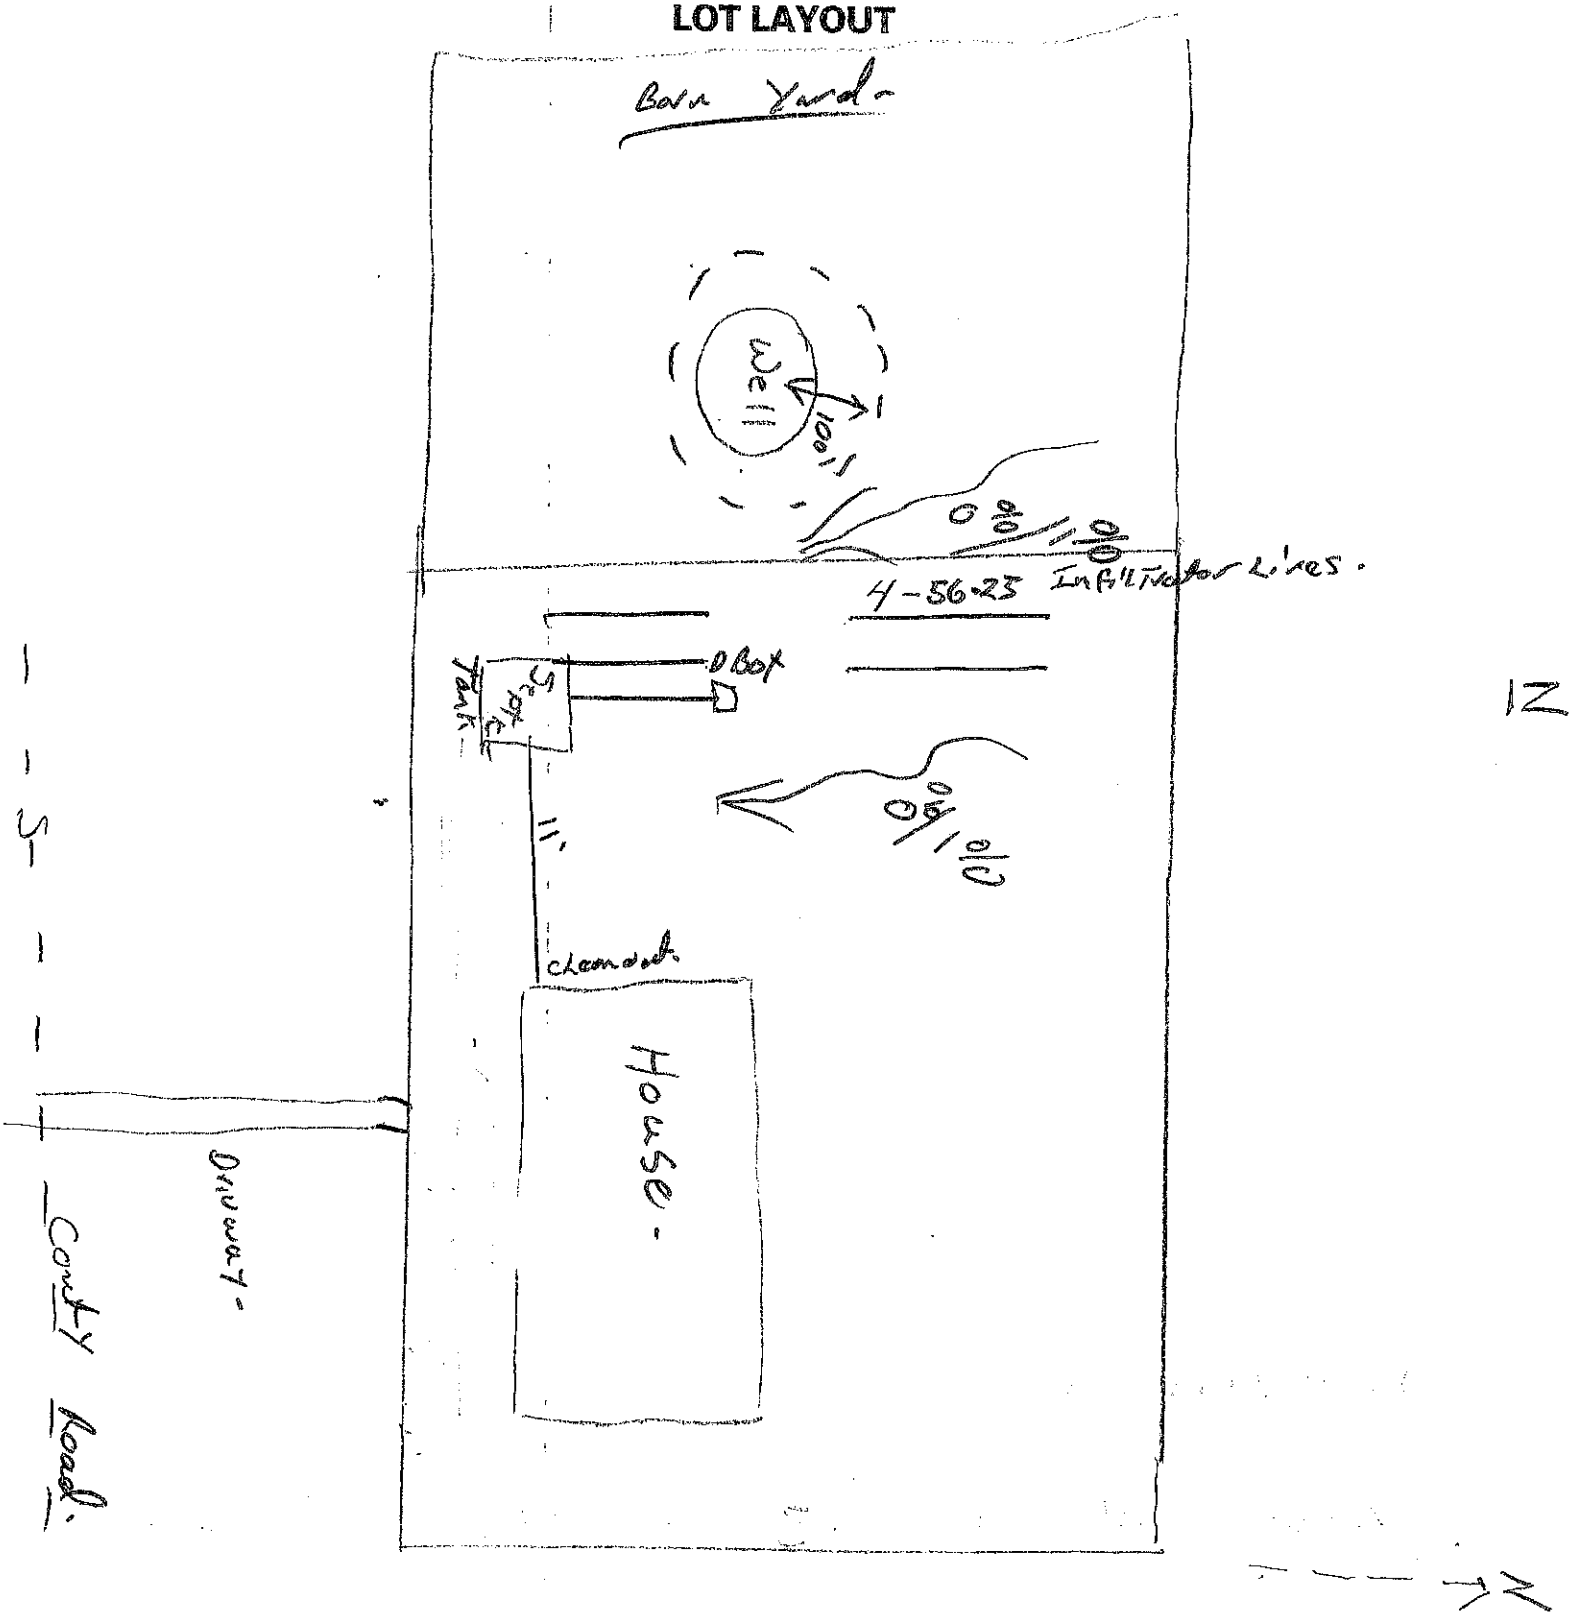
Signed: Miranda Davis, Enviro. Health Tech. *Date:* 9/16/22

X Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


Barn Yard.
Well
100'
4-56-23 Infiltrator Lines.
Box
Tank
11'
Clean out
House.
Driveway
County Road.
N