Permit #25-7532A

LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 02/12/2025 Expiration Date: 02/11/2026

Property Owner: Edric W Vredenburg III

Mailing Address: [redacted]

Installer: Donavan Truman License #: 109

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new pressure dosed system for (2) 3 Bedroom Houses.

Legal: S11, T36 N, R27 W, COS 2711, PARCEL 2, ACRES 78.75, LESS PM 5715 KSANKA

Property Address: Windmill Road, Eureka, MT 59917 South Location Assessment Code: 7532

DEQ COSA: E.Q.# Date:

Approved Design Criteria: Installation of new pressure dosed system for (2) 3 Bedroom Houses with 5 Laterals @ 100'. If 4 Buildings for Lease or Rent are proposed, BLR review is required. These are Buildings 1+2. Building 3 is to the North.

# of Bedrooms: (2) 3 Bedroom Septic Tank Size: 1000+1000/500 gallons Trench Width: 36"

# of Laterals: 5 Length of Laterals: 100' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Robin Blumberg, RS*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:


This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg *Date:* 4/17/25

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.

SOUTH SITE—MODIFIED

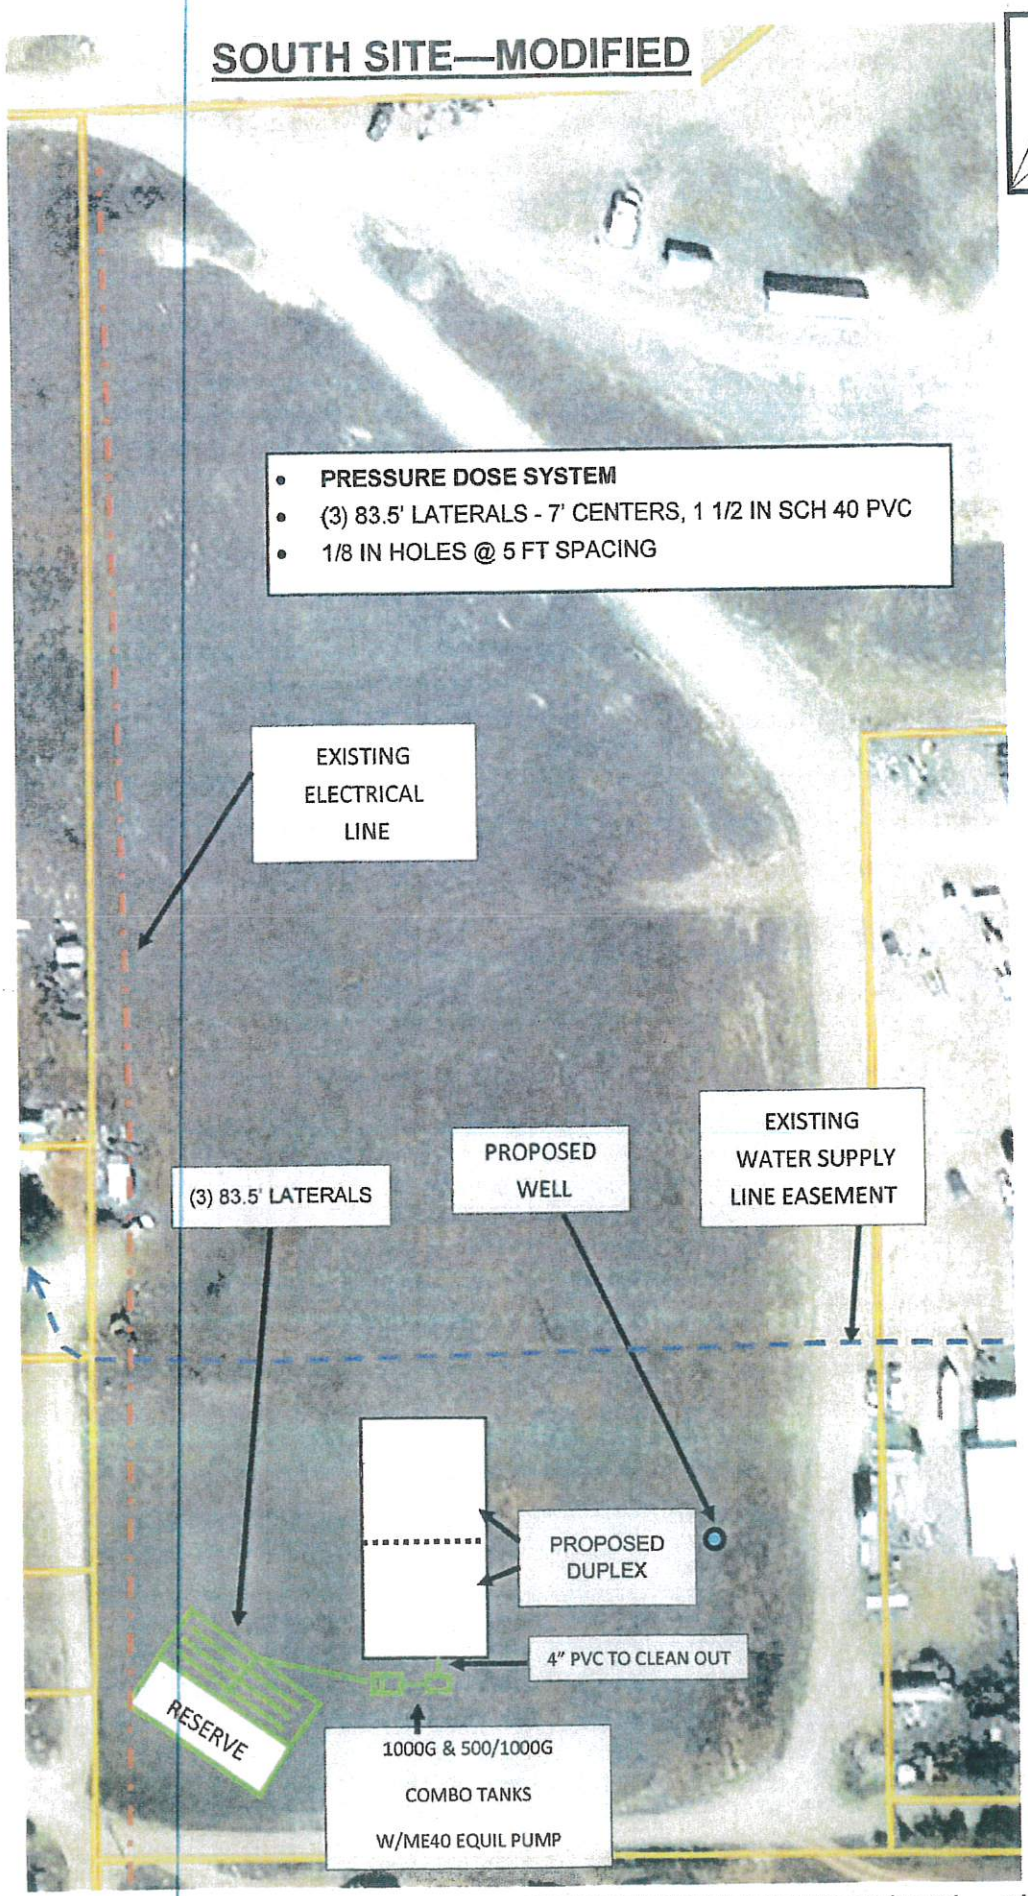

S11, T36 N, R27 W, C.O.S. 2711, PARCEL 2, ACRES 78.75, LESS PM 5715 KSANKA CRK LOT 2B *7532* 2/6/2025