LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 04/11/2022 Expiration Date: 04/11/2023

Property Owner: WFMT Properties, LLC c/o: Lodestone Adventures, LLC

Address: [redacted]

Telephone: (Home) (Work)

Installer: Royden Caldwell License No. 171

___ Direct Connection ___ Grinder Pump Connection XX Effluent Lift Tank Connection

Describe: Sewer line connection to sewer main for approved Drainfield

Parcel Description:

Legal: MARINERS HAVEN PH 1, S11, T36 N, R28 W, Lot 42

Address or Location: 77 Kamloop Ct, Rexford, MT 59930

Geo/Assessors code: 0000055981

Approved Design Criteria:

Per the application this lot is approved for a 3-bedroom house. This structural size may not be exceeded and wastewater flows are prohibited from exceeding 300 gallons per day. Any activity that increases wastewater flows without prior review and approval is in violation of the conditions of approval and subject to enforcement action.

Special Instructions: INSTALL 1,000 GALLON SEPTC TANK, 500 GALLON PUMP TANK/CHAMBER, AND SEWERLINE CONNECTION TO THE SEWER MAIN LINE FOR DRAINFIELD ACCORDING TO THE ATTACHED LOT LAYOUT AND DEQ APPROVAL STATEMENT EQ#12-1352. ANY DEVIATIONS FROM APPROVED PLAN MUST HAVE PRIOR AUTHORIZATION FROM DEQ AND THE DEPARTMENT.

Issued By: Nicholas Raines

Closure Statement:

I, Royden Caldwell III, *have inspected this system and found it to be in compliance with the conditions of the permit, and the DEQ Approval Statement requirements.*

Signed: Royden Caldwell *Date:* 1/25/24

Title:

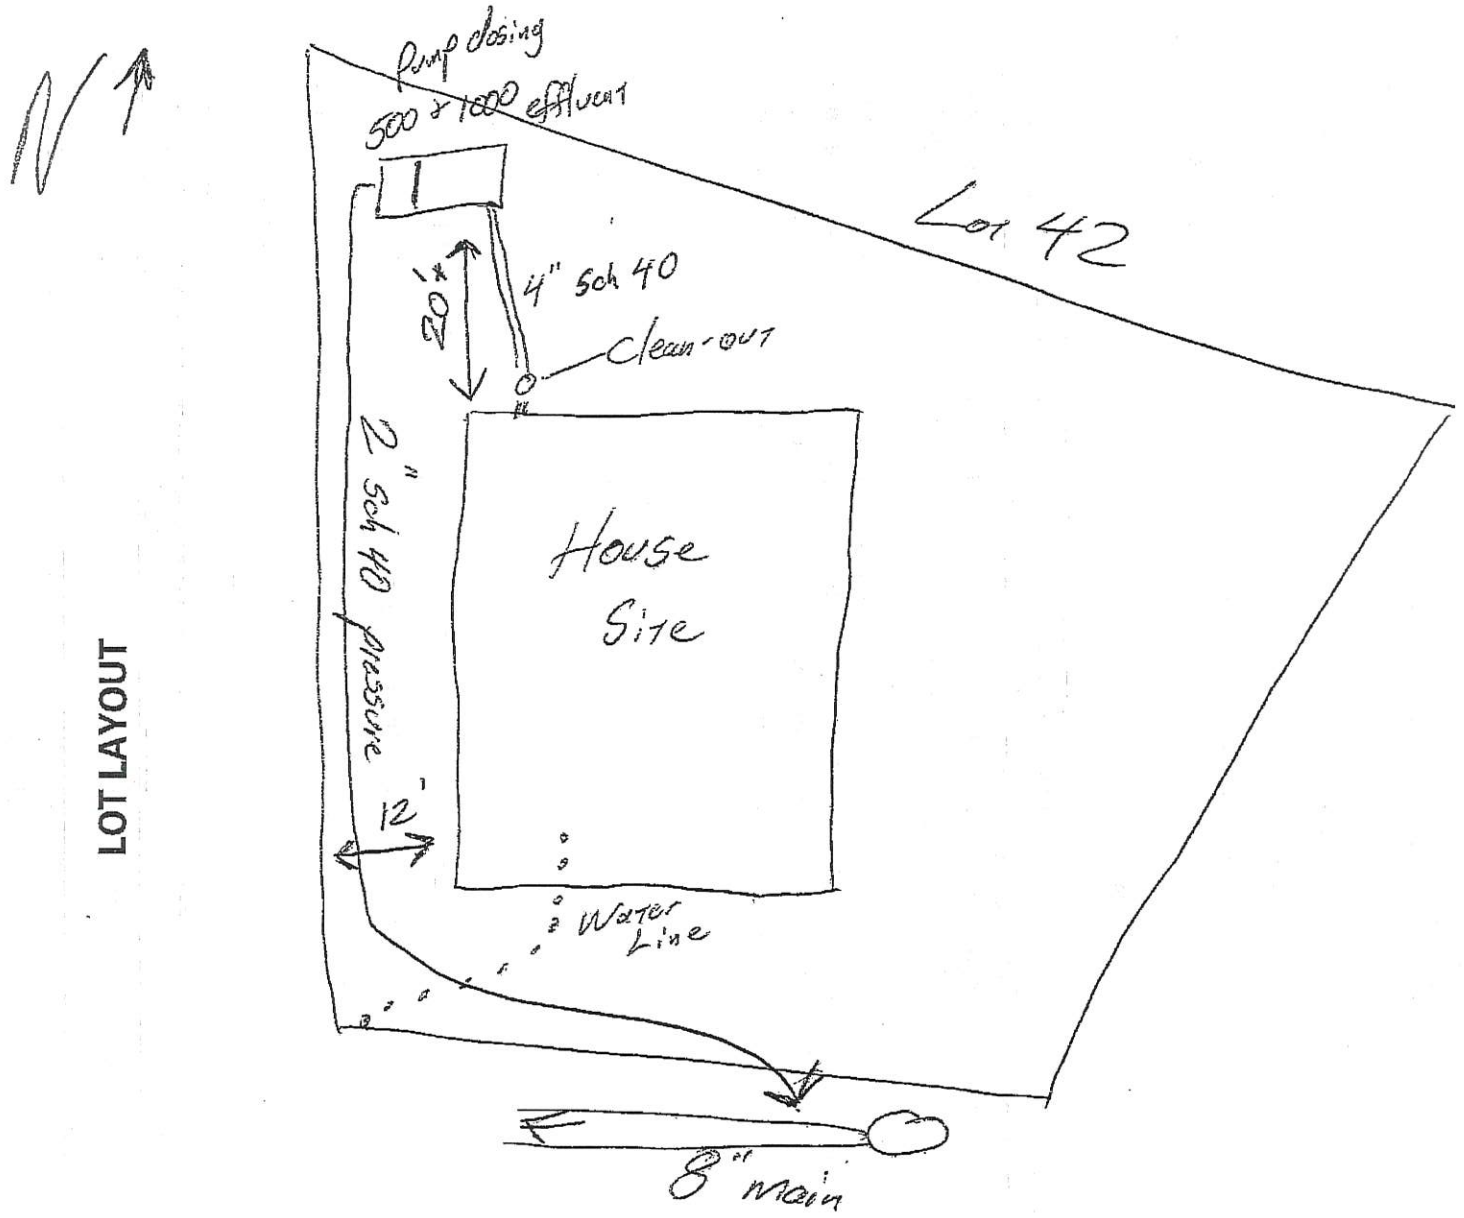
NOTICE: The Department must be notified at least 48 hours prior to installation of the connection. Any connection installation not inspected by the Department or its designated representative is considered an illegal connection and may be subject to fines and/or requirements to remove or reconstruct the connection.

DISCLAIMER

This permit is not a guarantee by the Department that this connection will function properly for a prescribed period of time.

5

LOT LAYOUT


N
Pump dosing
500 x 1000 effluent
1
Lot 42
20'
4" sch 40
clean-out
2" sch 40 pressure
12'
House
Site
Water
Line
8" main