County

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/02/2022 Expiration Date: 05/02/2023

Property Owner: Watson, Steve c/o: Tally Hoe

Address: [redacted]

Telephone:

Installer: Tally Hoe License No. N/A

___ New Installation __XX__ Existing System

____ Repair __XX__ Replacement ____ Extension ____ Other

Describe: 1,000-gallon septic tank with effluent filter. Gravity feed system with gravelless absorption trenches (infiltration chambers), 2 laterals at ~~XX~~ 100' feet in length each.

Parcel Description:

Legal: EM KAYAN VILLAGE 1ST ADDN, BLOCK 1 LOT 2, 0.713 ACRES, S04, T30 N, R30 W

Address or Location: 1063 Greers Ferry Rd. Libby, MT 59923

Geo/Assessors code: 0000008633

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1,000 gallon Drainfield Size: ~~144~~ 200 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Nicholas Raines

Closure Statement:

I, Thomas J Cole *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

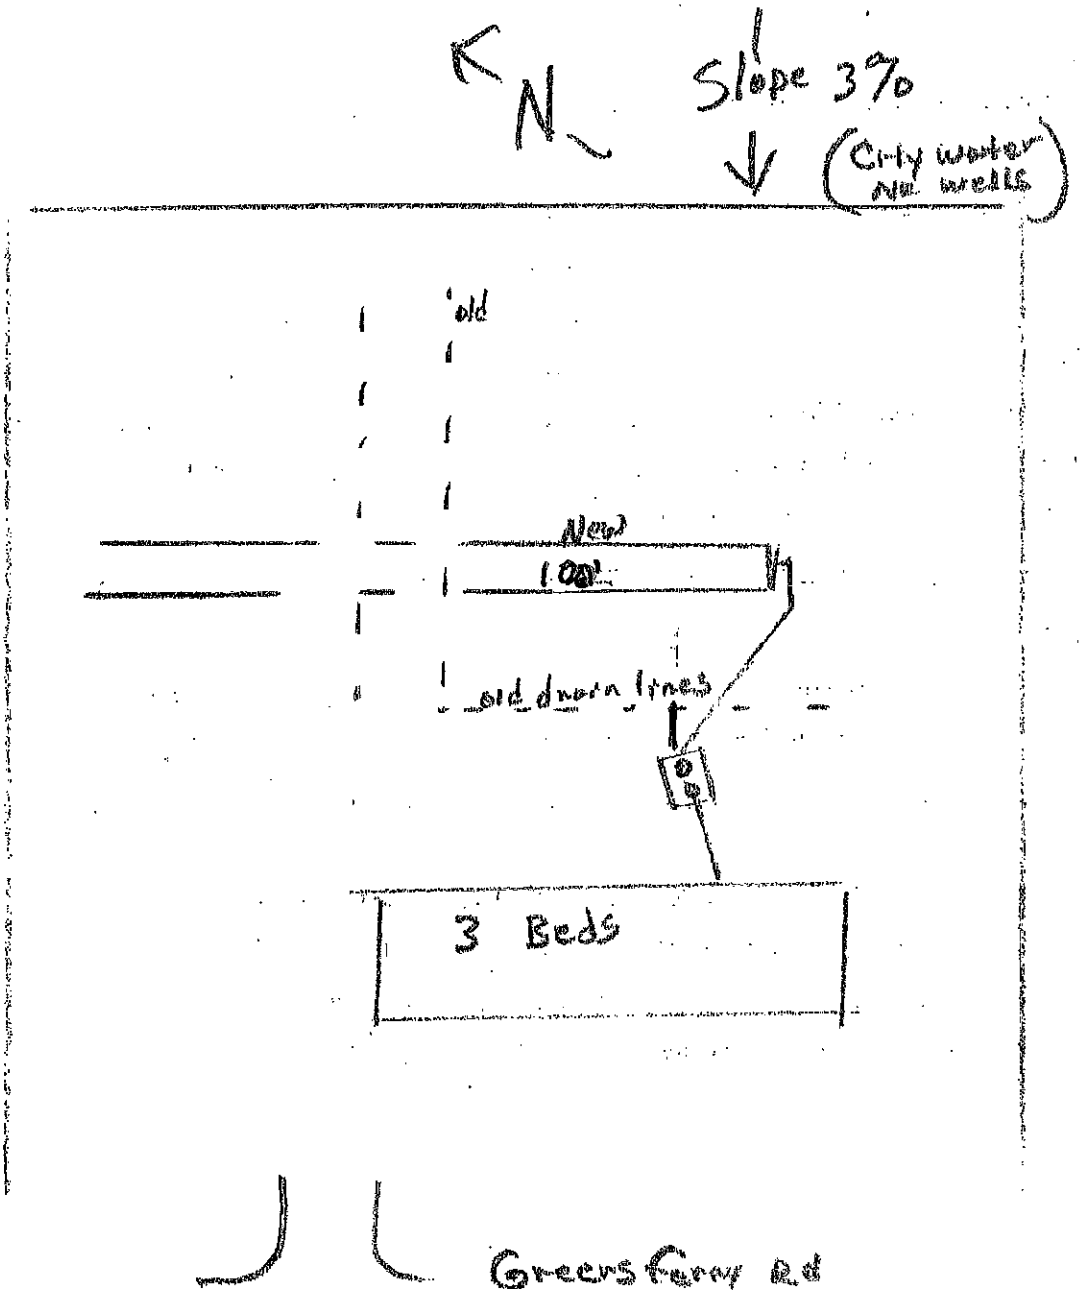
Signed: Thomas J Cole *Date:* 5-6-22

Title: owner operator

NOTICE: The Department must be notified at least 48 business hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.
406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


N
Slope 3%
(City water
NW wells)
old
New
100'
old drain lines
3 Beds
Greens Ferry Rd