LINCOLN COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 12/5/2022 (rev 2/1/2023) Expiration Date: 12/04/2023

Property Owner: Jonus & Amber Wengerd

Mailing Address:

Telephone: [redacted]

Email: NA

Installer: Elmer Brenneman

License #: 170

Proposed Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Pressure dosed system with sand lined trenches

Parcel Description:

Legal: Esker Subdivision, Lot 3, S13 T37N R27W, 0.9 acres

Property Address: Moraine Drive, Eureka Assessment Code: 56066

Approved Design Criteria: 3 bedroom house + bathroom only in shop

# of Bedrooms: 3+1 Septic Tank Size: 1500/500 gallons Trench Width: 36 inches

# of Laterals: 3 Length of Laterals: 49 feet Trench Depth: 24 – 36 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. ANY CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: *Kathi J. Hooper, R.S.*

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

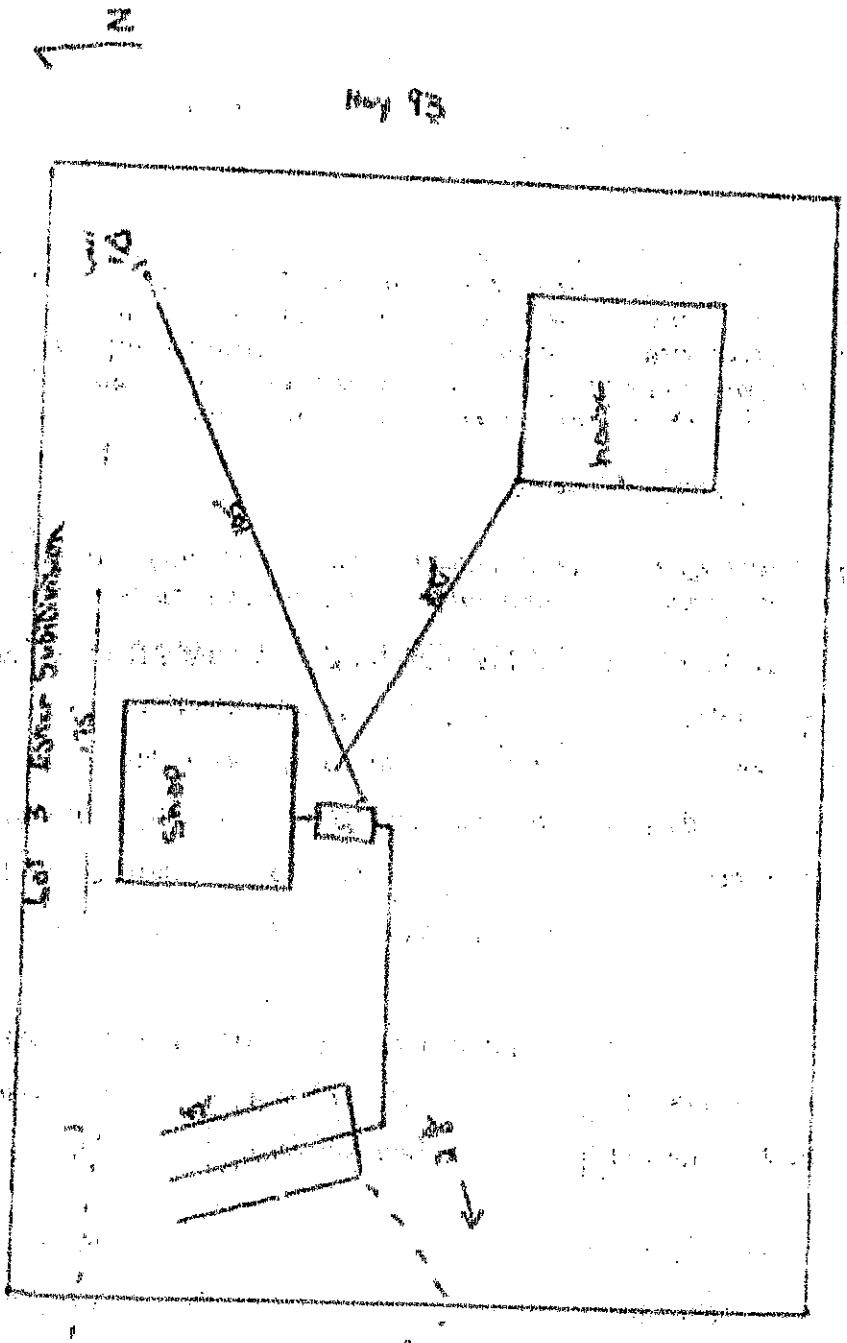
Signed: _____ *Date:* 4-17-23

X Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV


N
Hwy 93
Lot 3 Eyer Subdivision
Shed
house
10'
50'
50'
15'
20'