LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/18/2021 Expiration Date: 08/18/2022

Property Owner: Jeff Witbrod c/o:

Address: [redacted]

Telephone: (Home) (Work)

Installer: Koocanusa Plumbing & Electirc License No. 169

___ New Installation ____ Existing System

____ Repair __XX__ Replacement ____ Extension ____ Other

Describe: Drain field is saturated.

Parcel Description:

Legal: S25, T36 N, R26 W, C.O.S. 1011, ACRES 19.953, E2SWSE or TR 5CB

Address or Location: TR 5CB

Geo/Assessors code: 0000010882

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 180 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kathi Hooper, R.S.

Closure Statement:

I, Dan Mc Kay, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: Dan Mc Kay *Date:* 9-15-21

Title: Licensed Installer

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER


This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

5

LOT LAYOUT

House and septic are in the middle of a 20 acre parcel

There is no surface water

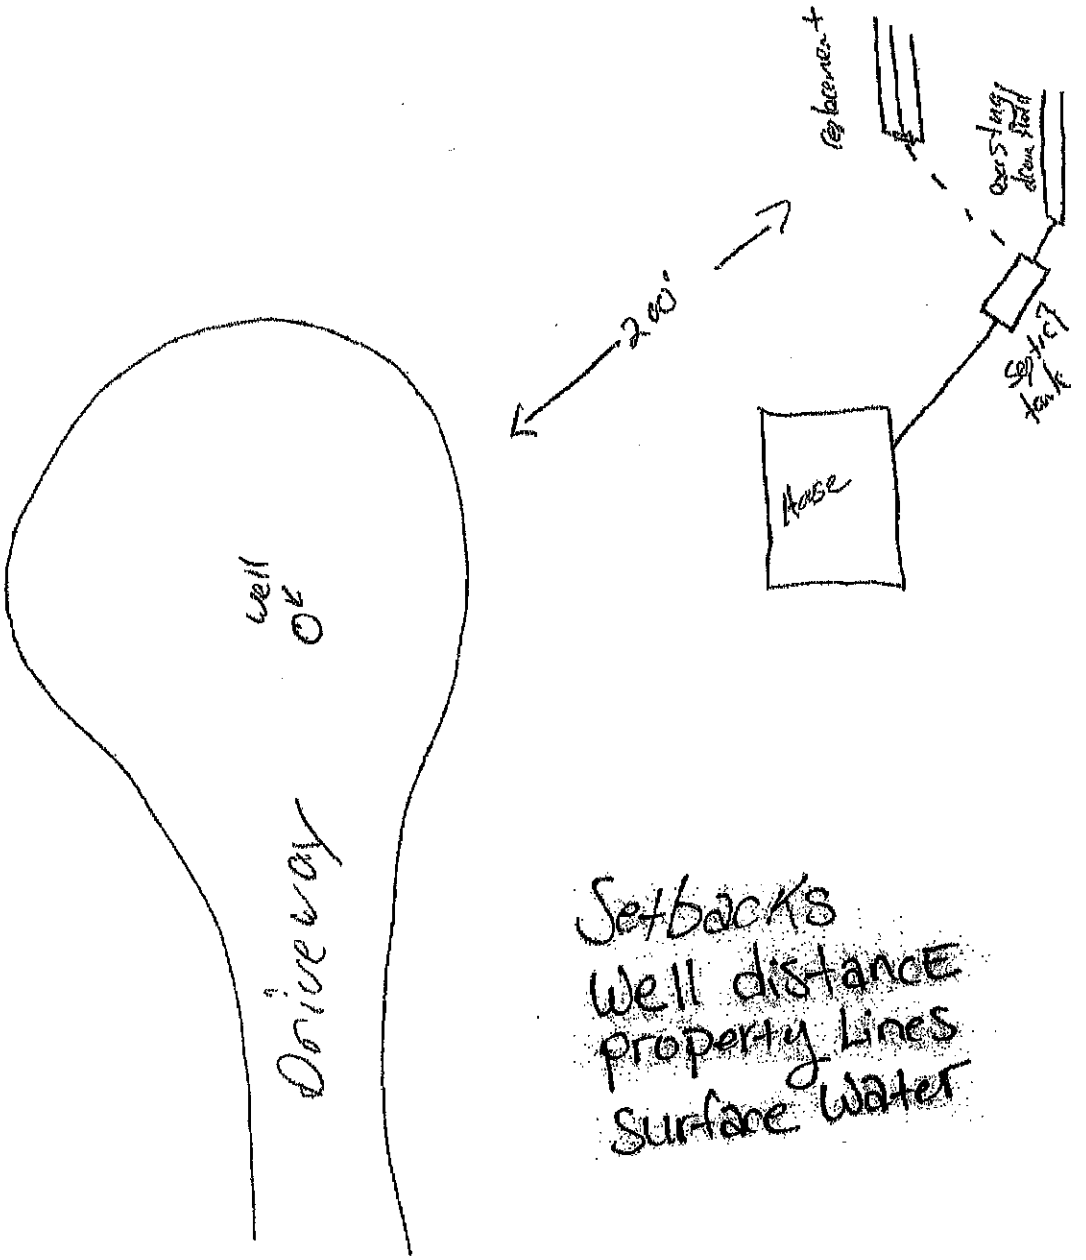

Setbacks
Well distance
property lines
Surface water