LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 11/9/2021 Expiration Date: 11/9/2022

Property Owner: Rodney Allen c/o:

Address: [redacted]

Telephone: [redacted] (Work)

Installer: Koocanusa Excavating, LLC License No.: 135

Proposed Work: (Check One) XXX New Installation ___ Existing System

___ Repair ___ Replacement ___ Extension ___ Other

Describe:

Parcel Description:

Legal: S24, T36N, R27W, Coyote Acres, Lot 1

Address or Location: 186 Arrowhead Ln., Eureka, MT 59917

Assessment Code: 0000054517

Approved Design Criteria: 1000-gallon tank and 2 72' laterals

Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: 144 Linear ft.

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: *Dustin Webb, RS*

Closure Statement:

I, Buck Schemmerhorn have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: [signature] *Date:* 11/15/21

Title: President

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442


DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


NORTH

DRAINFIELD SIZING

(2) BEDROOM= 225 GPD
225 GPD/0.8 APP= 281 SQFT
281 SQ FT/2' CHAMBERS= 141 LF
141 LF/ 2 LATERALS= 72' FOR 4' INCREMENT

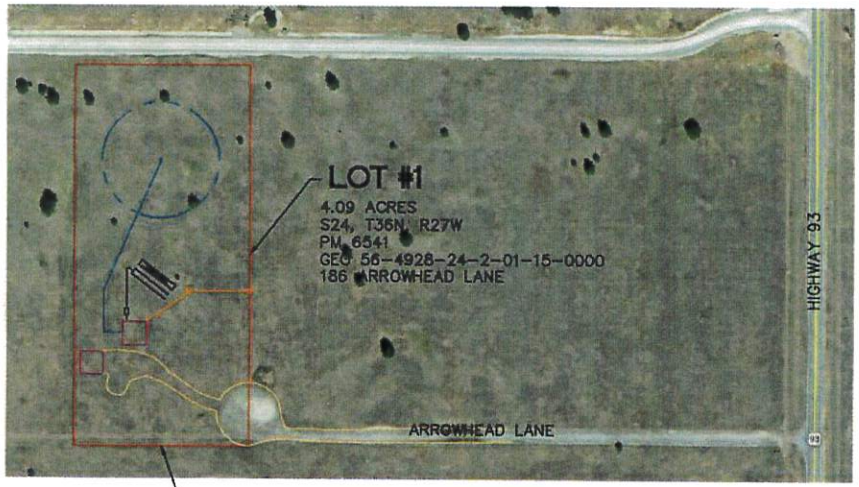

OVERALL SITE LAYOUT

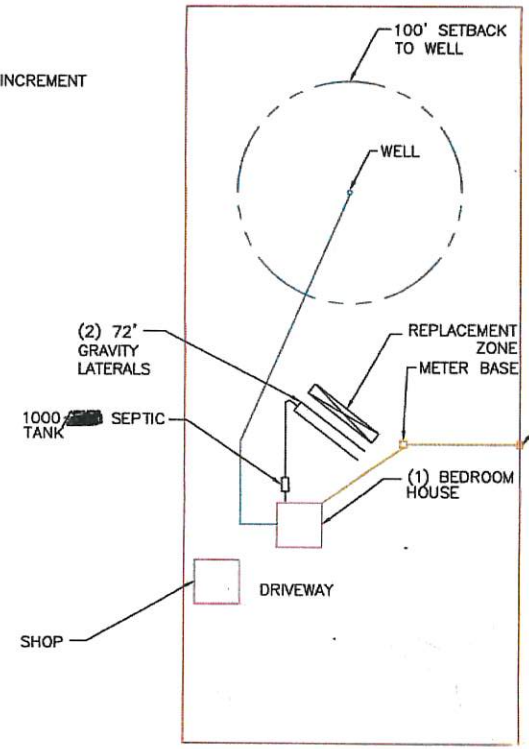

HOUSE SITE LAYOUT

ALLEN SITE LAYOUT

REV	DATE	COMPANY	SCALE:
		KEI	1/16 = 1'-0"
		CONTRACT:	DATE:
		VERBAL	6/2021
		PLOT FILE:	WEIGHT
		PML-0001	

THIS DRAWING IS PROPERTY OF KEI UNTIL CONTRACT HAS BEEN SECURED BETWEEN OWNER & KEI. IT CAN NOT BE SUBMITTED TO ANY OTHER PARTIES WITHOUT WRITTEN APPROVAL FROM KEI MANAGEMENT

DWG TOLERANCES: FINISH

6 5 4 3 2