sign + return to LCHO

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 10/22/2021 Expiration Date: 10/22/2022

Property Owner: Mark & Patricia Appleby c/o:

Address: [redacted]

Telephone: (Work)

Installer: Mountain Contracting License No. 3

_XX_ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other- Renewal (MD)

Describe: Two 83' laterals 3' wide infiltrators pressure dosed.

Parcel Description:

Legal: S08, T36 N, R26 W, C.O.S. 4275, PARCEL D, ACRES 8.29

Address or Location: Parcel D

Geo/Assessors code: 0000056025

Approved Design Criteria:

Bedrooms: 1 Septic Tank Size: 1000/500 gallons Drainfield Size: 100 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kathi Hooper, R.S.

Closure Statement:

I, Richard Luciano, *have inspected this system and found it to be in compliance with the conditions of the permit and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: _____ *Date:* Dec 3rd 2021

Title: Installer

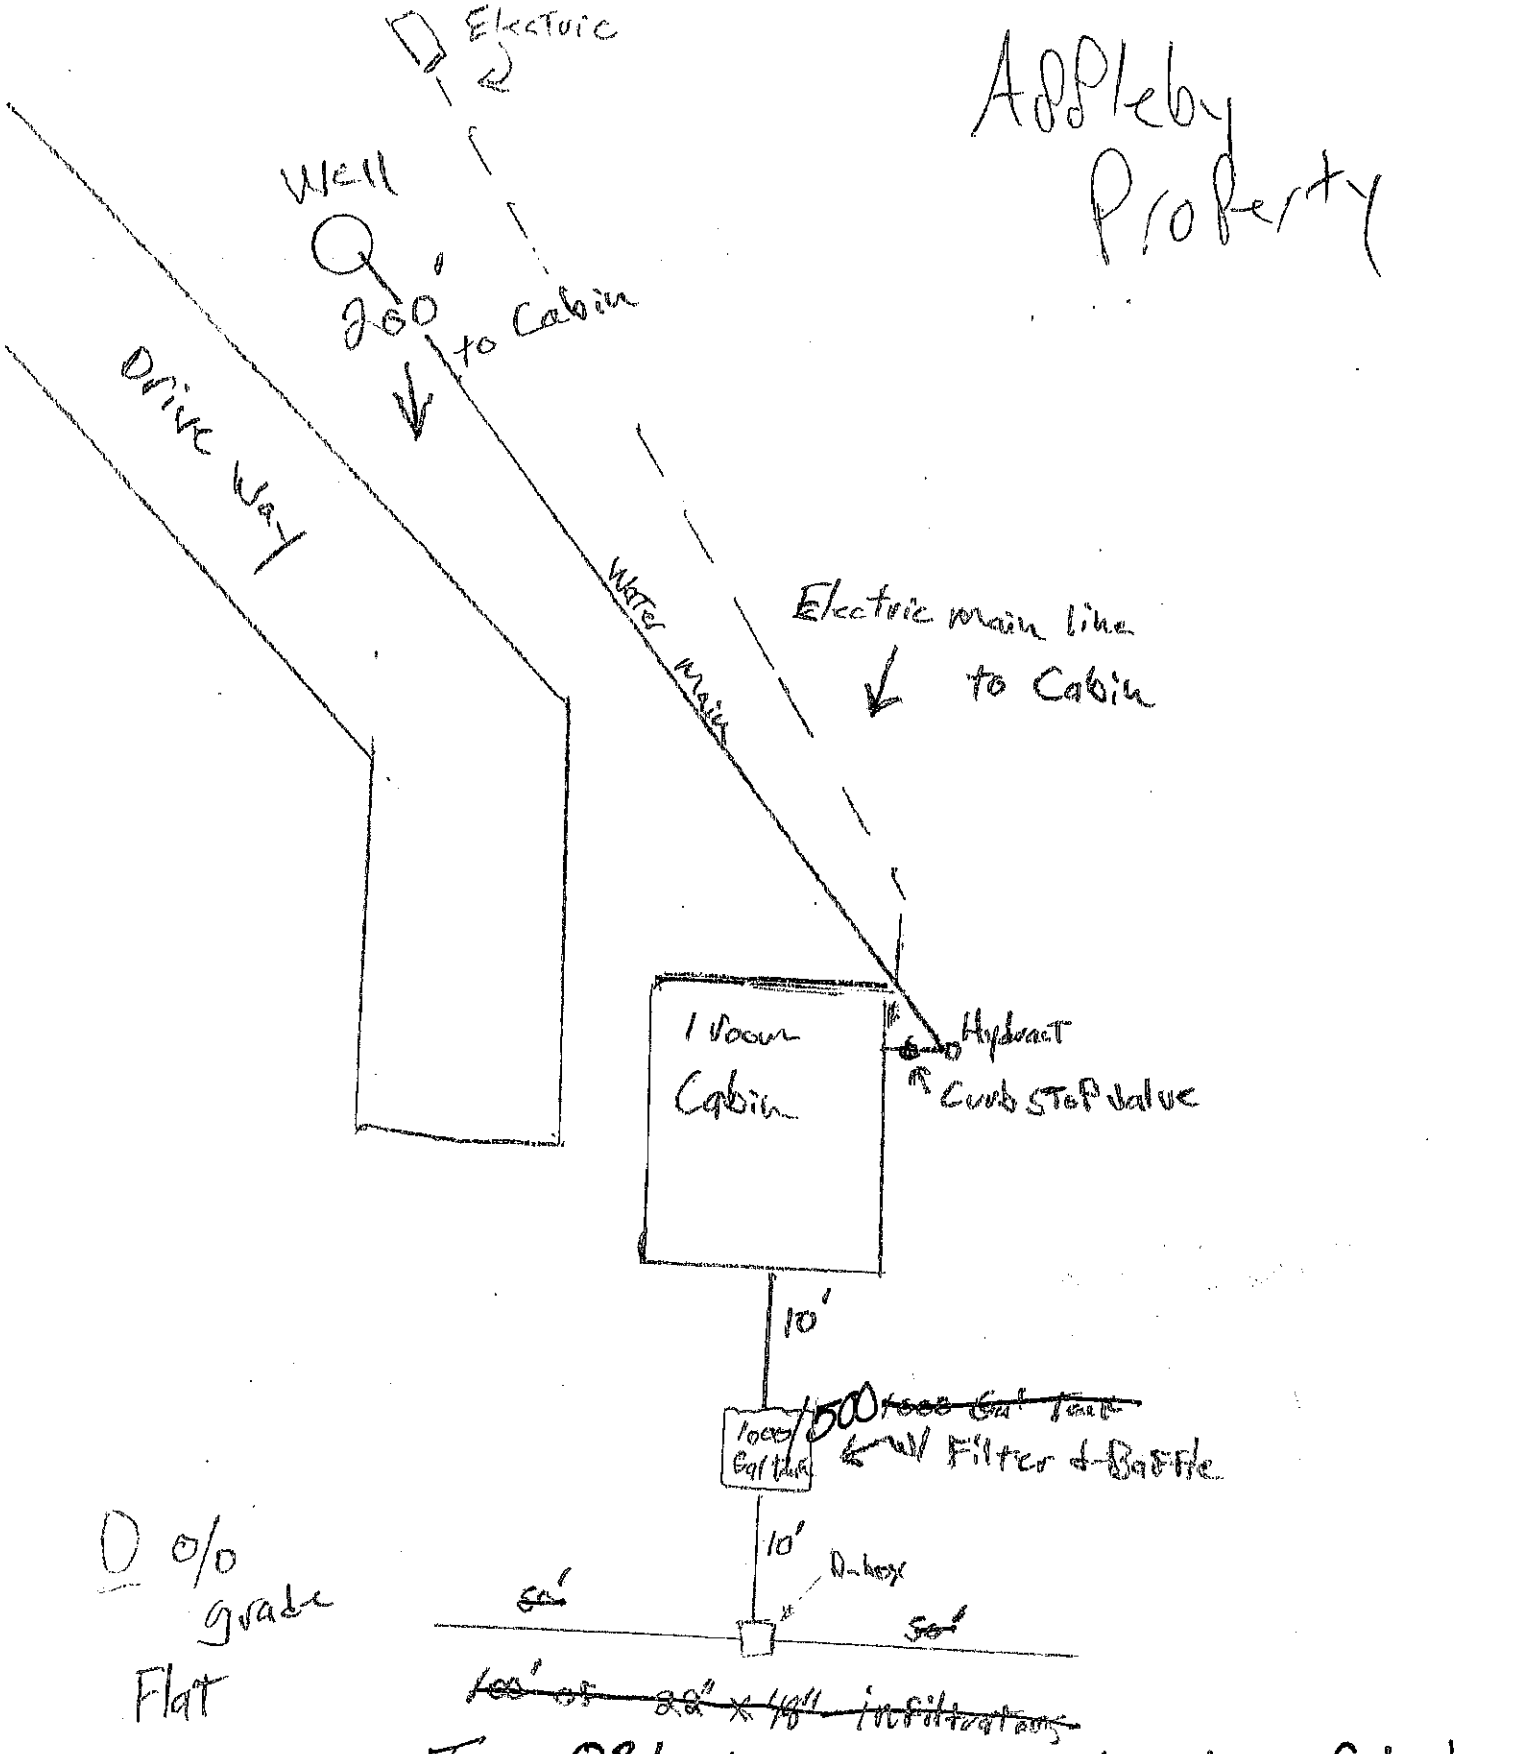
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

5


Electric
Appleby Property
Well
260'
to Cabin
Drive Way
Water main
Electric main line
to Cabin
1 Room
Cabin
Hydrant
Curb Stop valve
10'
1000 Gal Tank
500 Gal Tank
Filter & Baffle
10'
D-box
50'
50'
100' of 22" x 48" infiltrators
0 o/o
Grade
Flat
Two 83' laterals w/ 3' wide infiltrators
N
LOT LAYOUT