LINCOLN COUNTY HEALTH DEPARTMENT Permit # 24-59969
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 09/16/2024 Expiration Date: 09/15/2025

Property Owner: Laura Baughman

Mailing Address: [redacted]

Installer: Kyle McNew License #: 199

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: Installation of new gravity system for 3 Bedroom House with RV cleanout.

Parcel Description:

Legal: LITTLE BEAR FLATS, S35, T32 N, R34 W, LOT 12, PLAT 7259

Property Address: Little Bear Loop Lot 12 Assessment Code: 59969

DEQ COSA: EQ#23-1195 Date: 03/31/2023

Approved Design Criteria: Installation of new gravity system for 3 Bedroom House with RV cleanout with 4 Laterals @85' with reduction for chambers. RV used as dwelling until house is completed. RV must be disconnected to hook up house as per COSA EQ#23-1195.

# of Bedrooms: 3 +RV Cleanout Septic Tank Size: 1000/500 +1000 gallons Trench Width: 24"

# of Laterals: 4 Length of Laterals: 85' Trench Depth: 24"-36"

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. Reduction given for chambers. It is the installer's responsibility to ensure that all required horizontal setbacks are met. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, R.S.

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

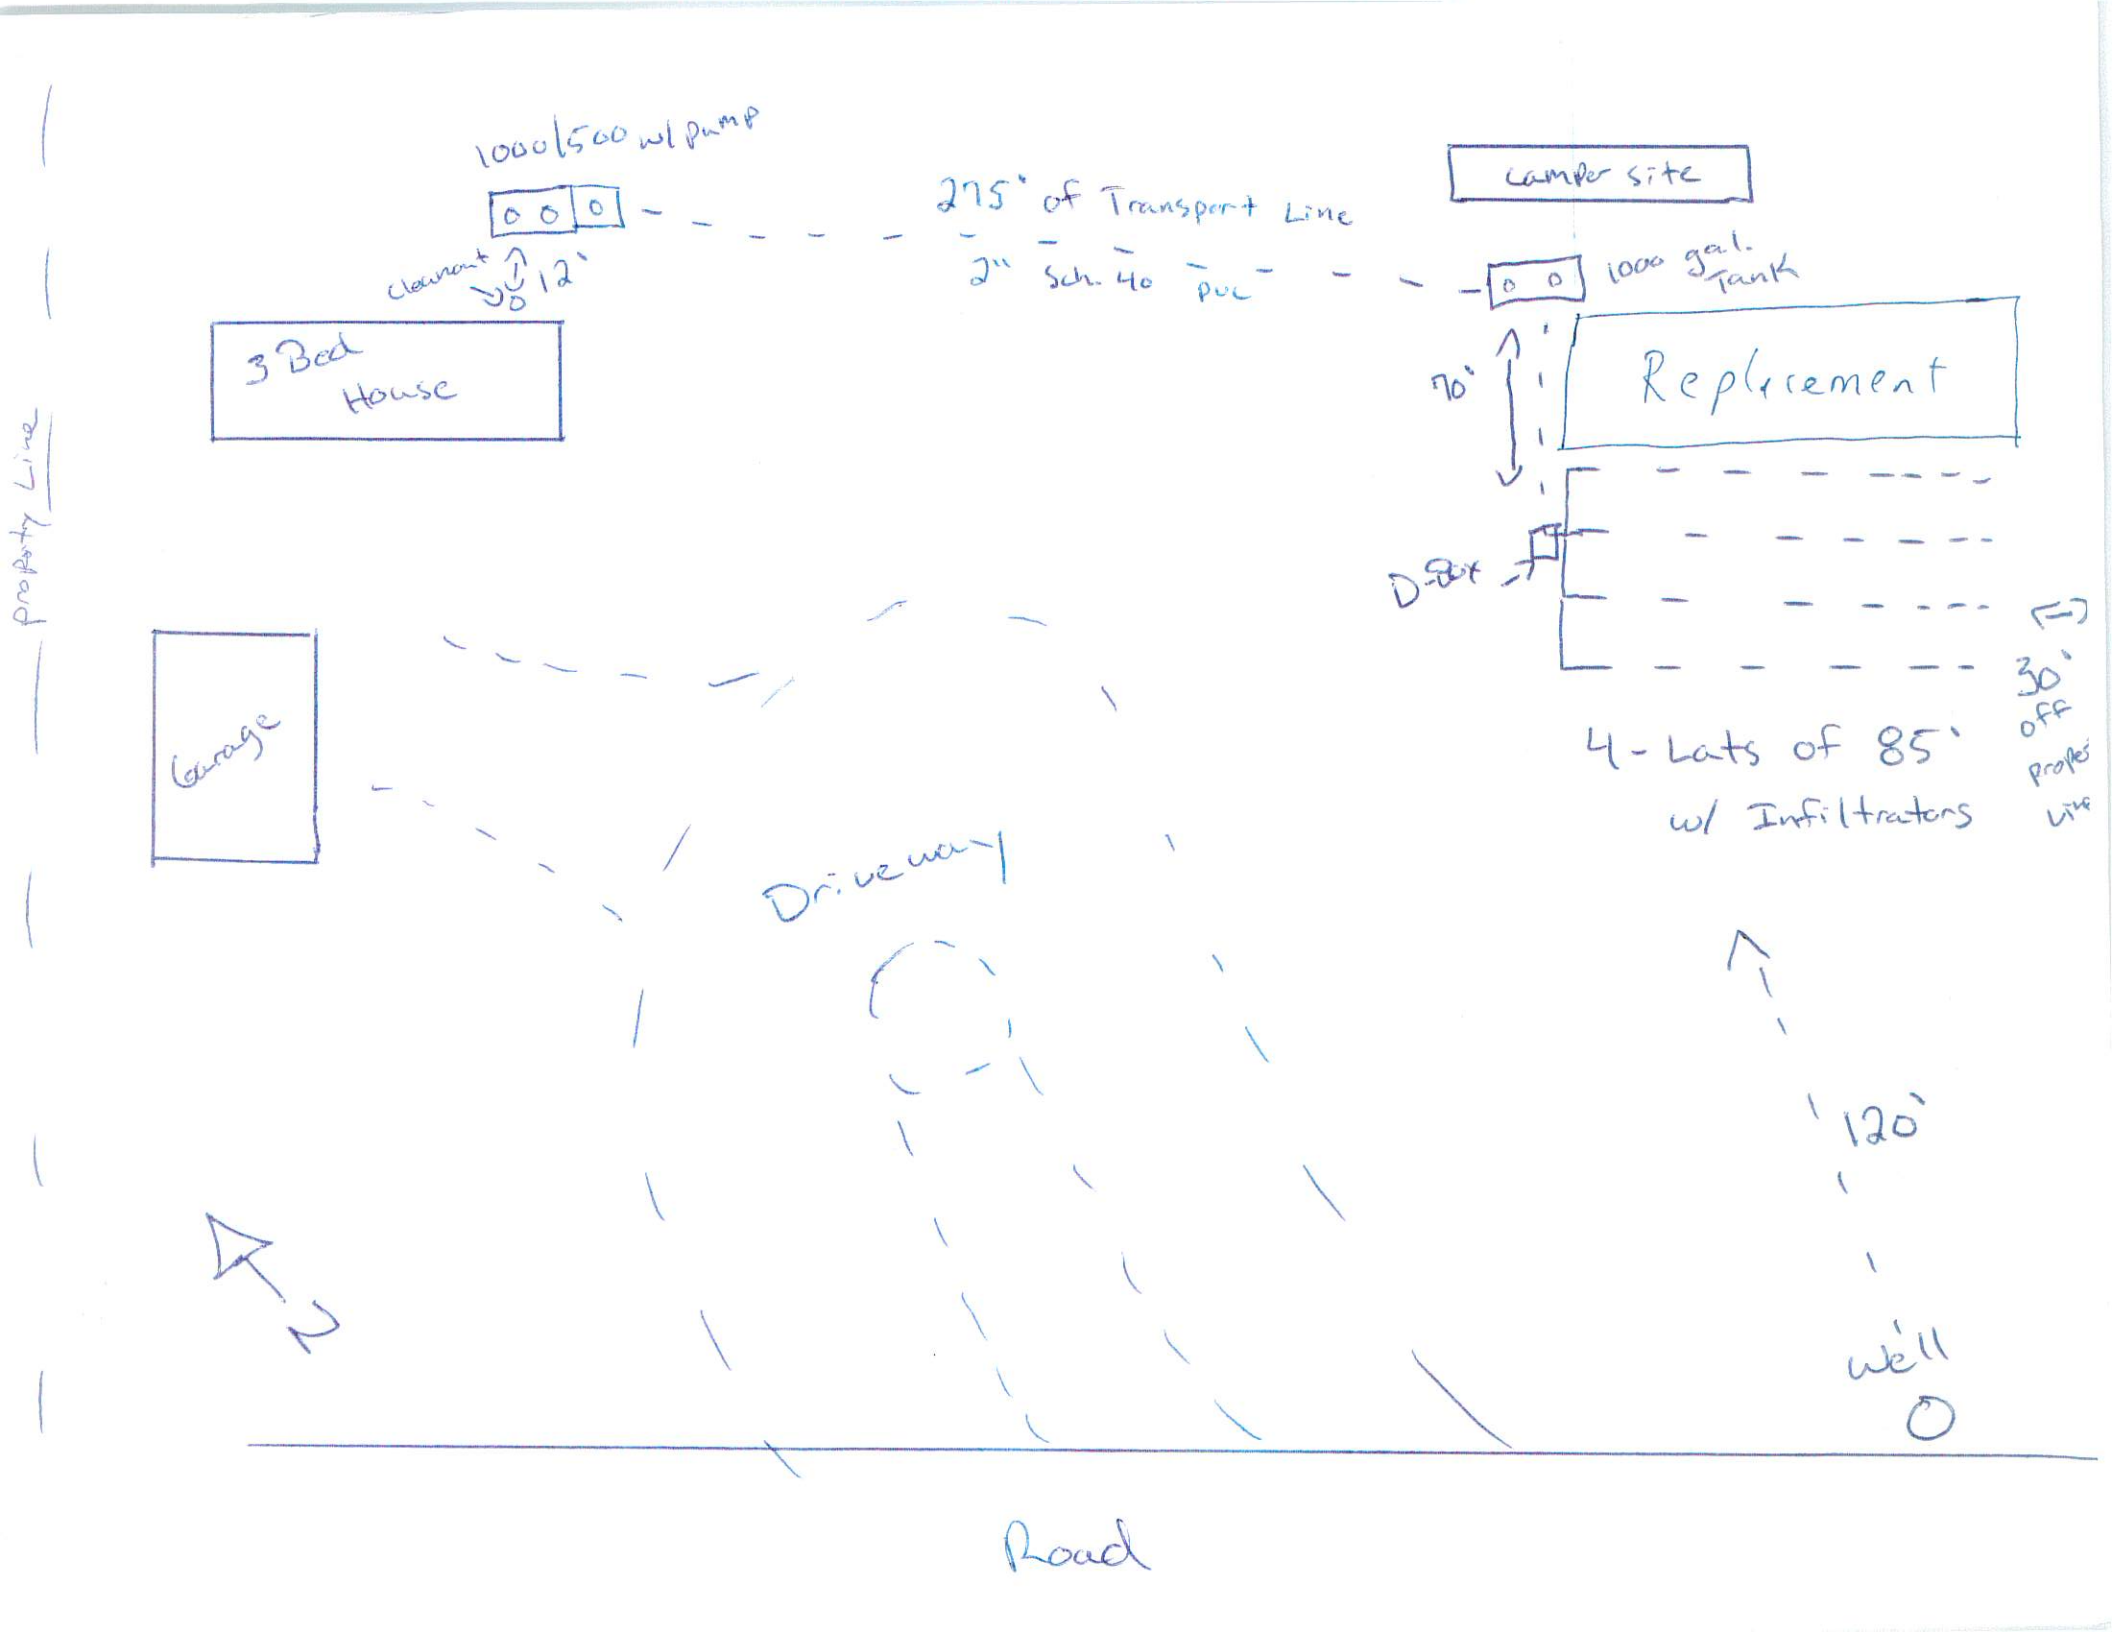
This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

Signed: Robin Blumberg Date: 6/11/25

✓ Lincoln County Health Department (LCHD) ____ Licensed Installer w/ approval of LCHD

This permit is not finalized until the system is inspected and the closure statement is signed.

This permit is not a guarantee that the system will function properly for a prescribed period of time.


1000/500 wl pump
clearout
12'
3 Bed House
275' of Transport Line
2" Sch. 40 PVC
camper site
1000 gal. Tank
70'
Replacement
D-Box
4 - Lats of 85'
w/ Infiltrators
30' off property line
Garage
Driveway
120'
well
N
Road
Property Line