County

LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 04/15/2021 Expiration Date: 04/15/2022

Property Owner: Steve & Evelyn Baum c/o:

Address: 1234 Doak Creek Rd Libby, MT 59923

Telephone: (Home) (Work)

Installer: Tally Hoe License No. 1

___ New Installation __XX__ Existing System

____ Repair __XX__ Replacement ____ Extension ____ Other

Describe: 2 Line rockeless chamber.

Parcel Description:

Legal: S01, T31 N, R31 W, TR 1A OR SWNE TR 1B OR E2NWNE 60.00 ACRES

Address or Location: 1234 Doak Creek Rd Libby, MT 59923

Geo/Assessors code: 0000002953

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1000 gallons Drainfield Size: ~~112~~ 140' Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Thomas J Cole *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Thomas J Cole *Date:* 4-29-21

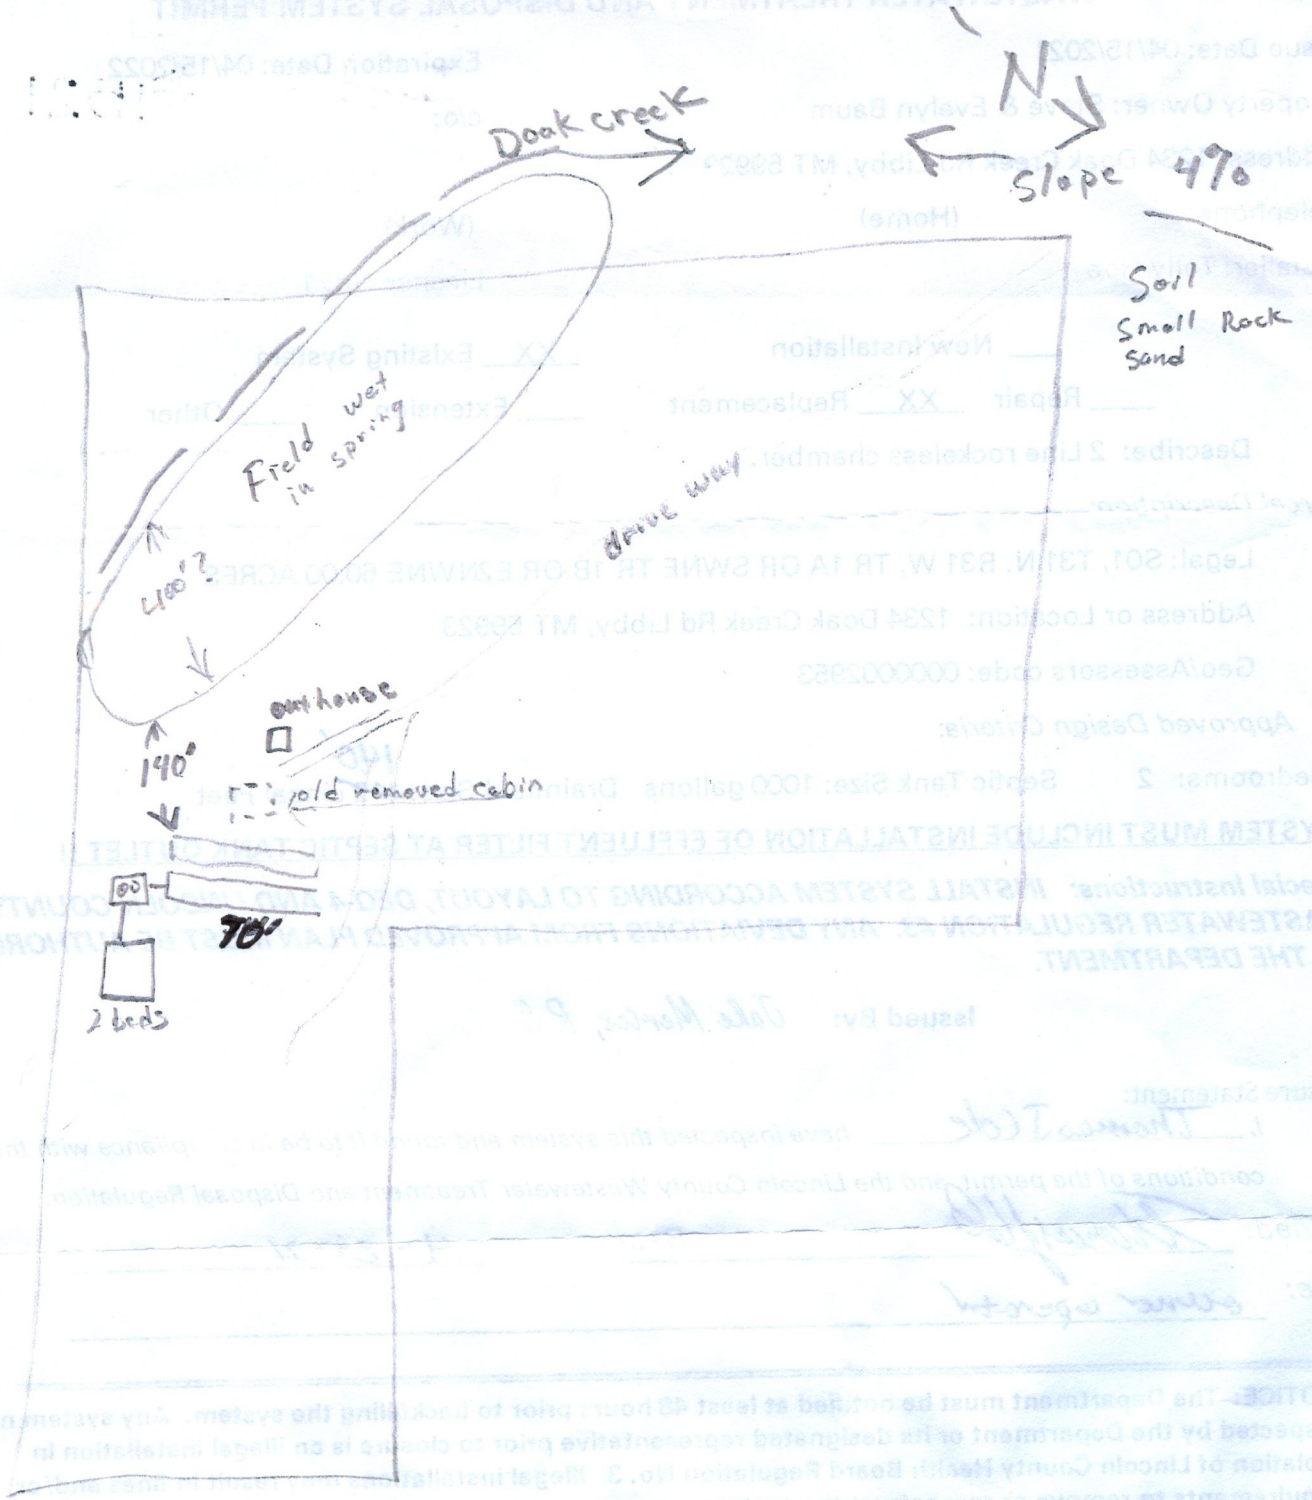
Title: owner operator

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


N
Doak creek
Slope 4%
Soil
Small Rock
Sand
Field wet in spring
drive way
400'?
140'
outhouse
old removed cabin
70'
2 beds