LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 7/9/2018 Expiration Date: 7/9/2019

Property Owner: Chris Biglin c/o: Kootenai Sand & Gravel

Address: PO BOX 1559

Telephone: (Home) [redacted] (Work)

Installer: KS&G License No. 109

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Three 75' pressure dosed lateral in 3' wide trenches.

Parcel Description:

Legal: S08 T36 R26

Address or Location: Henion Hollow Lot 1

Geo/Assessors code: 0000055261

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000/500 gallons Drainfield Size: 225 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

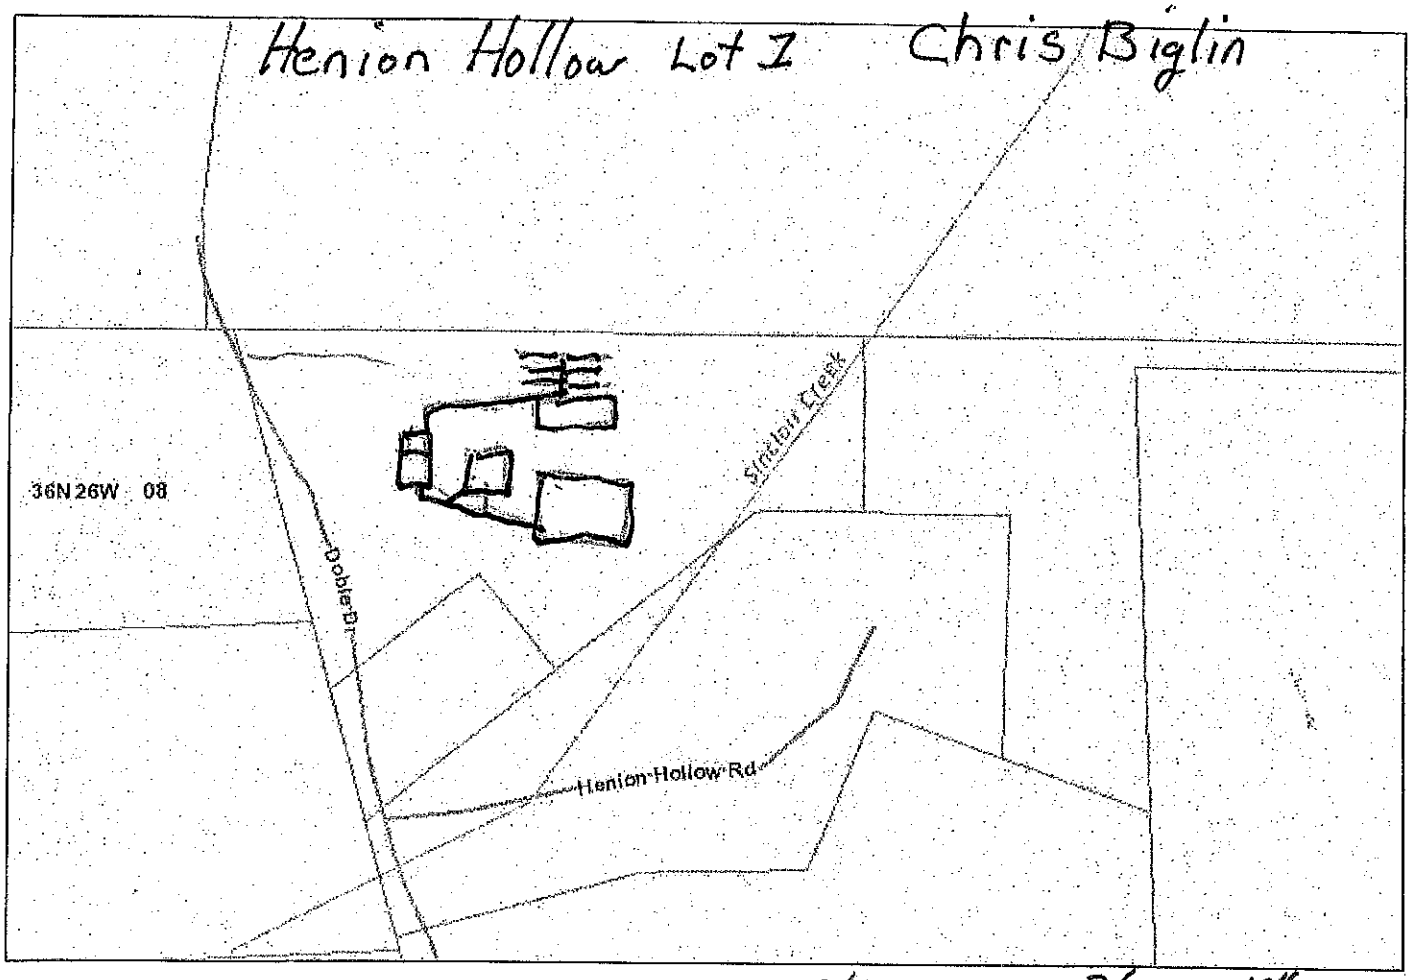
Title: _____

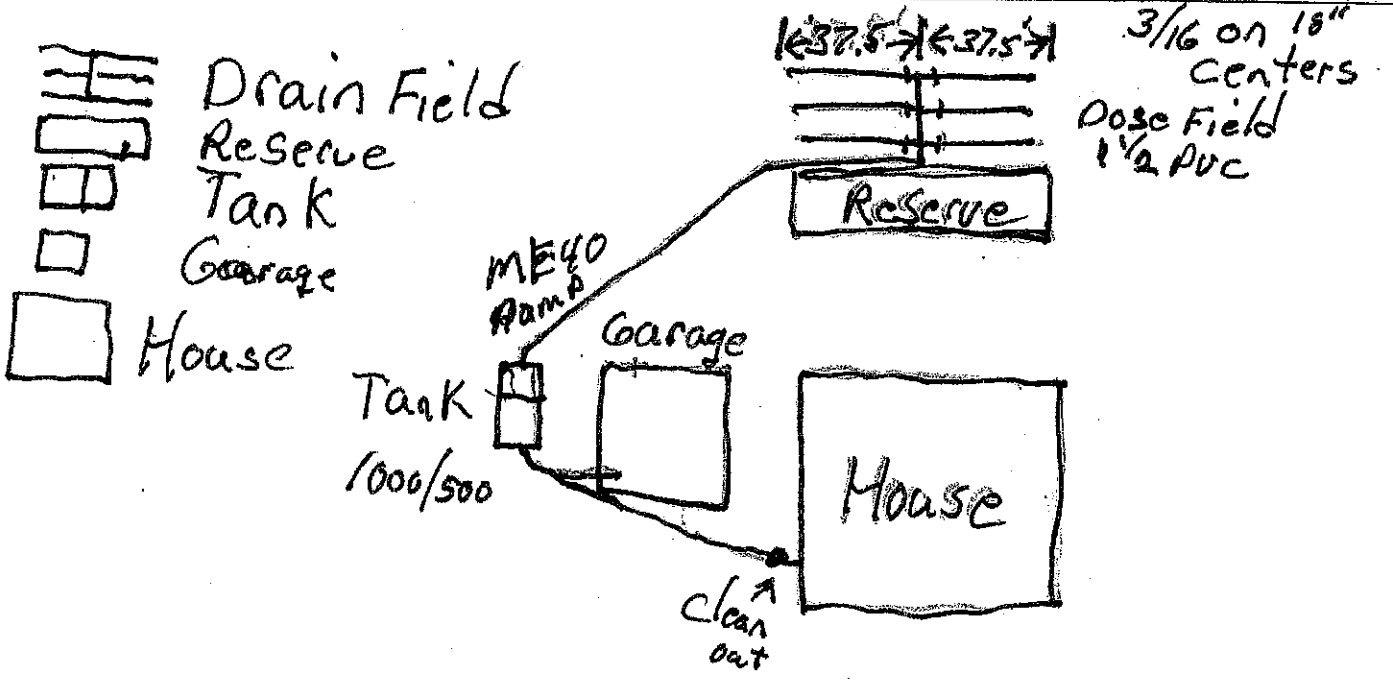
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Henion Hollow Lot I Chris Biglin
36N 26W 08
Stratton Creek
Dobler Dr
Henion Hollow Rd


Drain Field
Reserve
Tank
Garage
House
37.5
37.5
3/16 on 18" Centers
Dose Field
1 1/2 PVC
Reserve
ME40 Ramp
Garage
Tank
1000/500
House
Clean out