LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 06/01/2021 Expiration Date: 06/01/2022

Property Owner: Wade Bradley c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Paul Dalziel License No. 175

___XX___ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Two 70' sand lined pressure dosed trenches.

Parcel Description:

Legal: SILVER TIP RANCH, S22, T37 N, R31 W, BLOCK 4, ACRES 1.3826, LOT 25

Address or Location: LOT 25

Geo/Assessors code: 0000053608

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1000/500 gallons Drainfield Size: 140 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Paul Dalziel, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Paul Dalziel *Date:* 8/18/2021

Title: _____

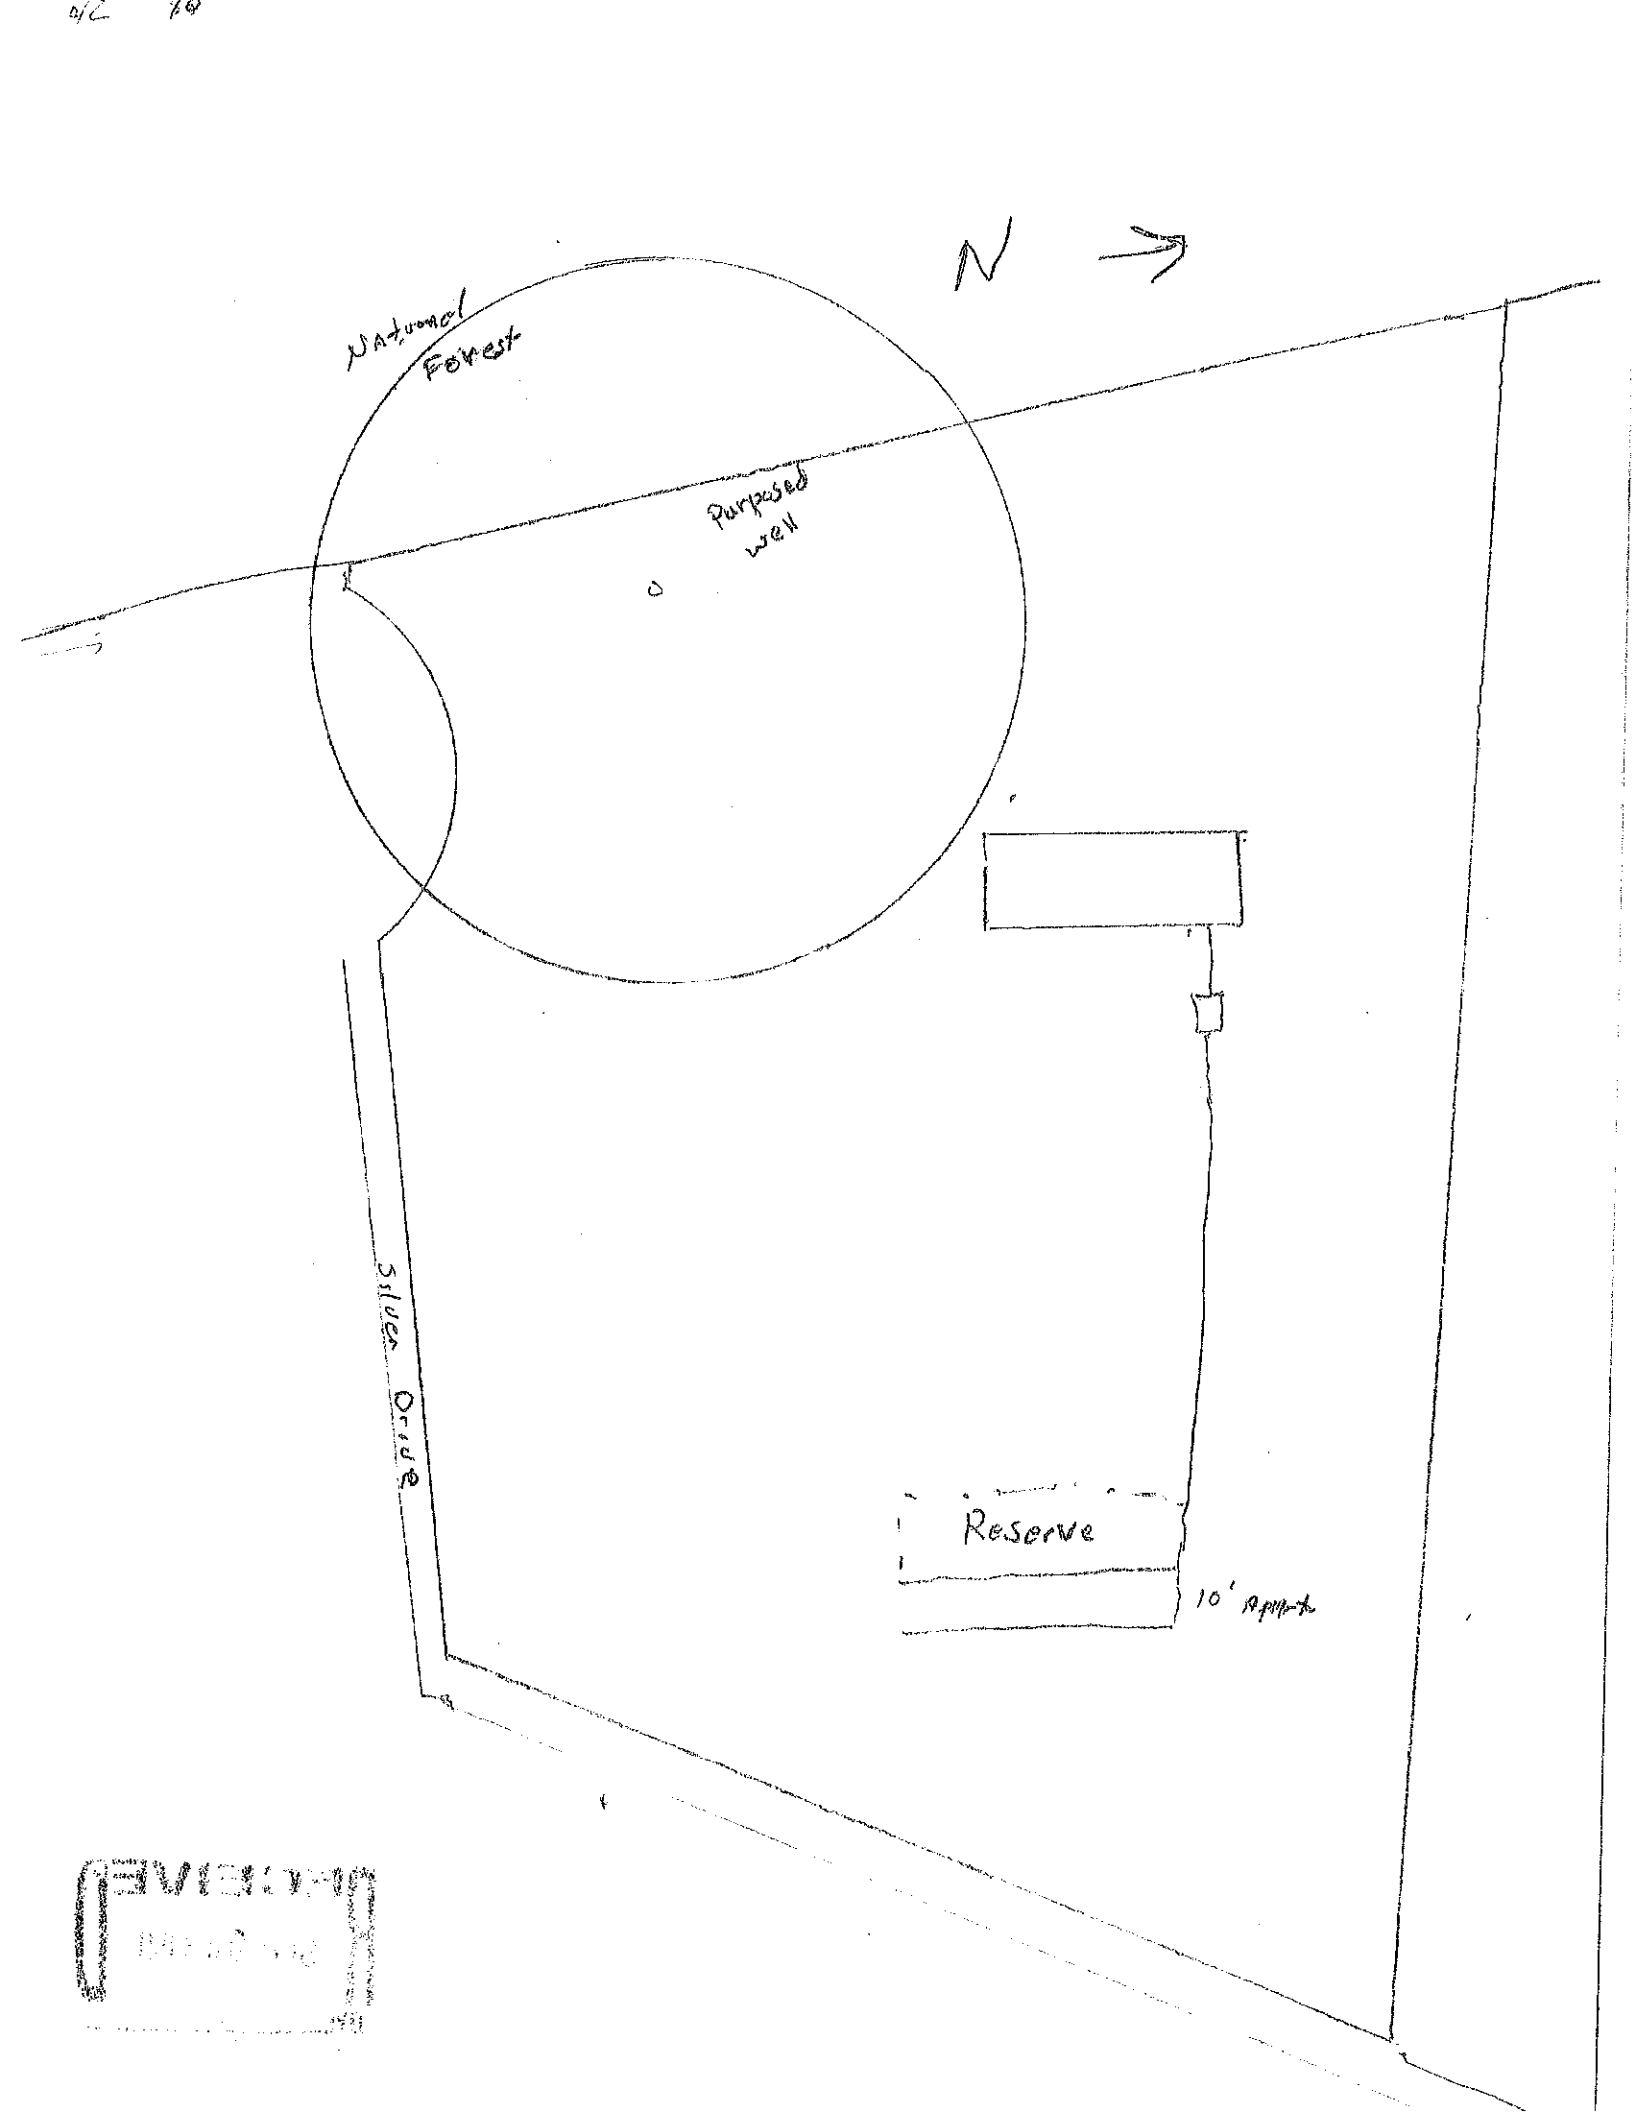
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

RECEIVED
SEP 08 2021
BY:


N
National Forest
Purposed well
Silver Creek
Reserve
10' Right-of-