LINCOLN COUNTY HEALTH DEPARTMENT Permit#
ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 07/25/2023 Expiration Date: 07/25/2024

Property Owner: Vern Burlingame

Mailing Address: [redacted]

Telephone: E-mail:

Installer: Tally Hoe License #: 1

Approved Work: (Check One) ☒ New Installation ☐ Existing System

☐ Replace Drainfield ☐ Replace Tank ☐ Extension

Describe: New installation of 4 lines @ 64' each, rockless chambers.

Parcel Description: I dug up leach pipe drainfield this could have been a replacement system

Legal: NIKKI ACRES, S02, T30 N, R31 W, Lot 8A, ACRES 2.55, PM 7227

Property Address: 2352 E 5th Street Ext. Assessment Code: 14370

DEQ COSA: 20-1755 Date: 09/22/2020

Approved Design Criteria: Pressure-Dosed, Shallow Capped System

# of Bedrooms: 3 Septic Tank Size: 1000 gallons Trench Width: 24 inches

# of Laterals: 4 Length of Laterals: 64 lineal feet Trench Depth: 30 inches

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET!!

Special Instructions: Install system according to the COSA, lot layout, the Lincoln County Wastewater Treatment and Disposal Regulation, and Circular DEQ-4. It is the installer's responsibility to ensure that all required horizontal setbacks are met. Reduction given for chambers. CHANGES MUST BE PRE-AUTHORIZED BY THE DEPARTMENT.

Issued By: Robin Blumberg, SIT

NOTICE: The Department must be notified at least 3 business days (72 hours) prior to backfilling the system. Call 406-283-2442. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation Ch. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

Closure Statement:

This system is in compliance with the approved design criteria and Lincoln County's Wastewater Treatment and Disposal Regulation.

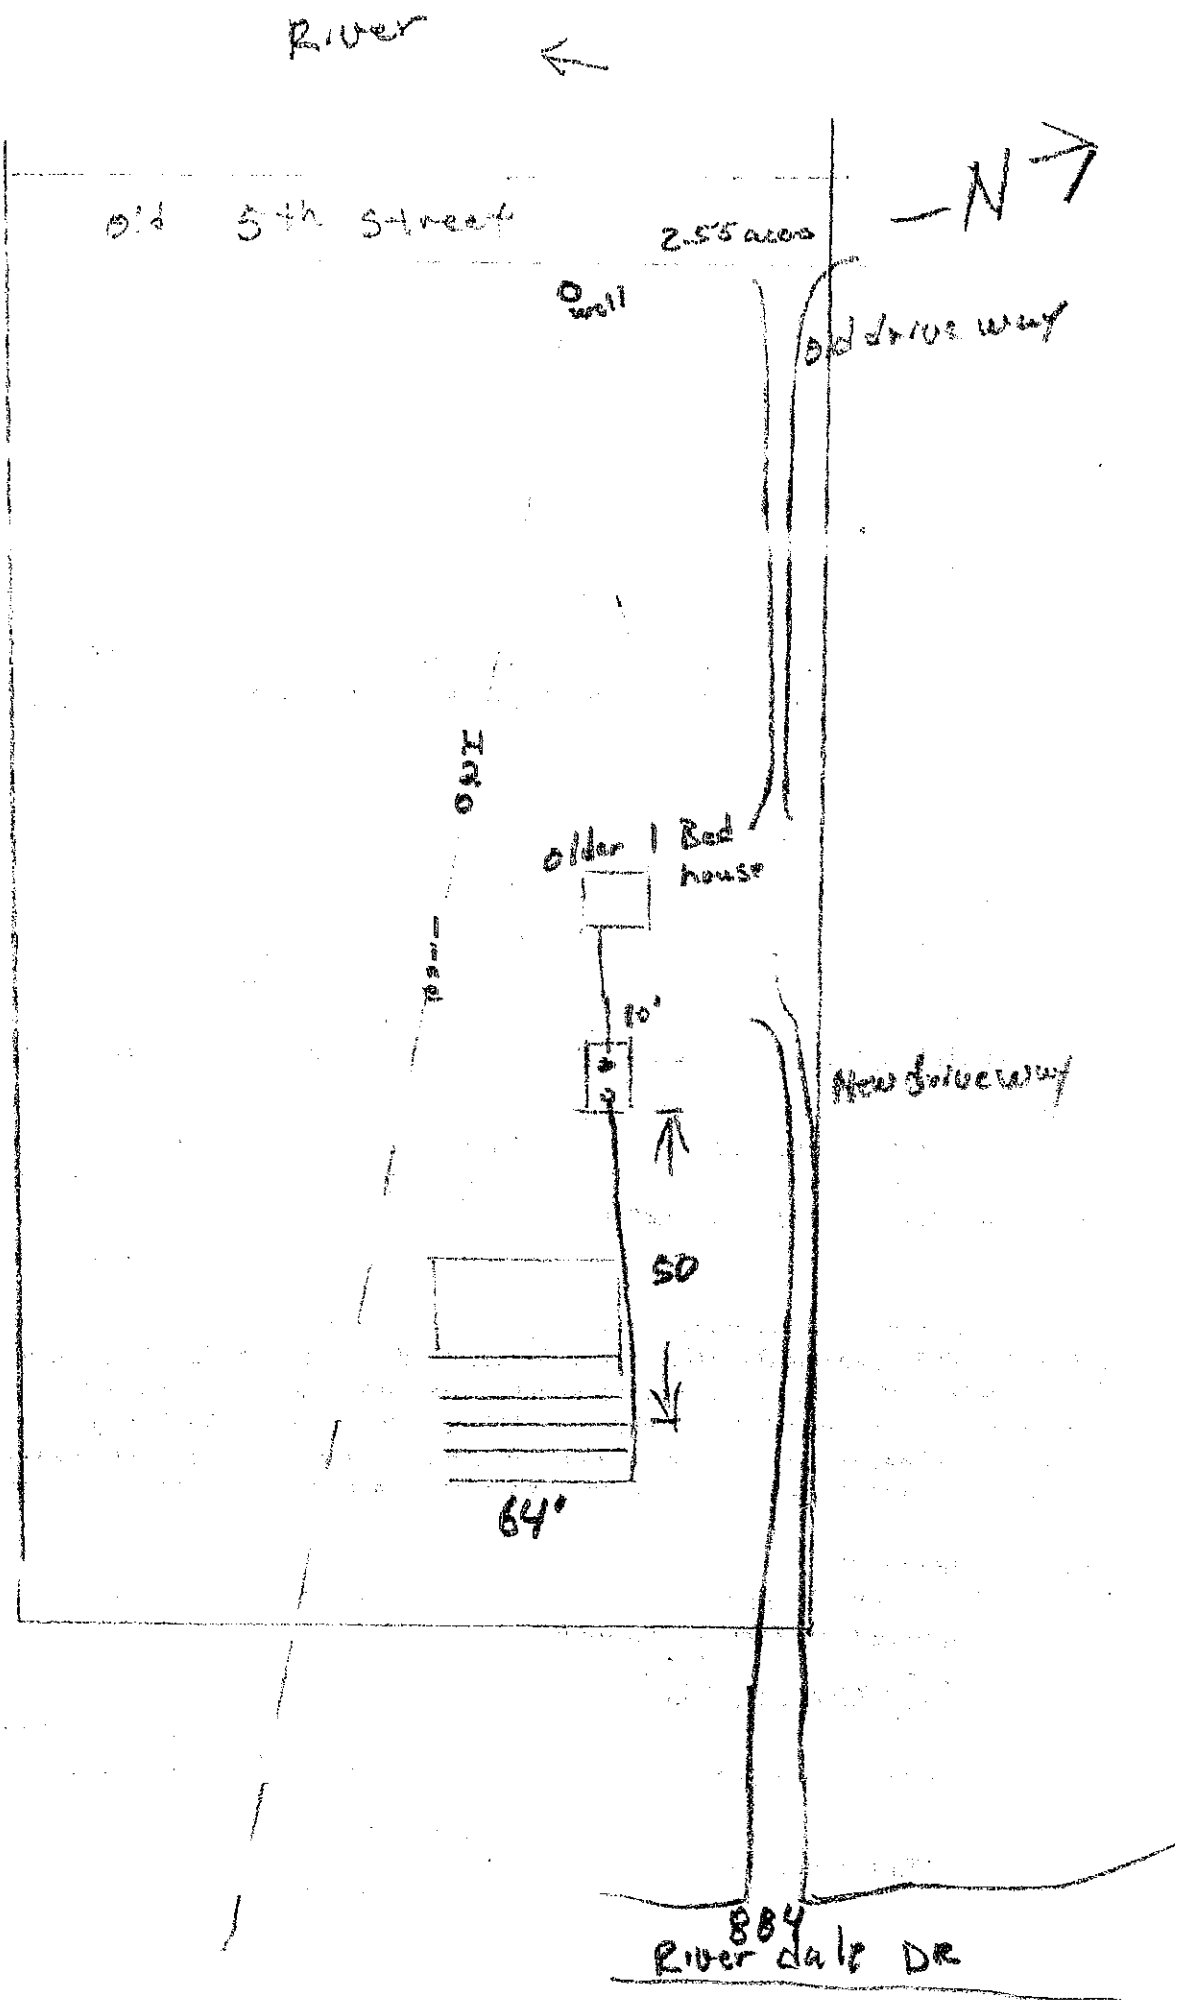
Signed: Thomas D Cole *Date:* 8-10-23

____ Lincoln County Health Department (LCHD) by kathie on phone ✓ Licensed Installer w/ approval of LCHD

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV


River
N
Old 5th Street
2.55 acres
well
Old drive way
older 1 Bed house
220'
10'
New driveway
50'
64'
884
River dale DR