LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Sign + return

Issue Date: 09/07/2021 Expiration Date: 09/06/2022

Property Owner: John Clarke c/o:

Address: 6739 Tobacco Road, Eureka, MT 59917

Telephone: (Home) (Work)

Installer: Elmer Brenneman License No. 170

Proposed Work: (Check One) ☒ New Installation ☐ Existing System

☐ Repair ☐ Replacement ☐ Extension ☐ Other _____

Describe: Two 96' laterals using chambers

Parcel Description:

Legal: S16 T35N R26W, COS 3798, 32.25 Acres, Tract 1

Address or Location: 6739 Tobacco Road

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 192 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kathi J. Hooper, R.S.

Closure Statement:

I, Elmer Brenneman, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

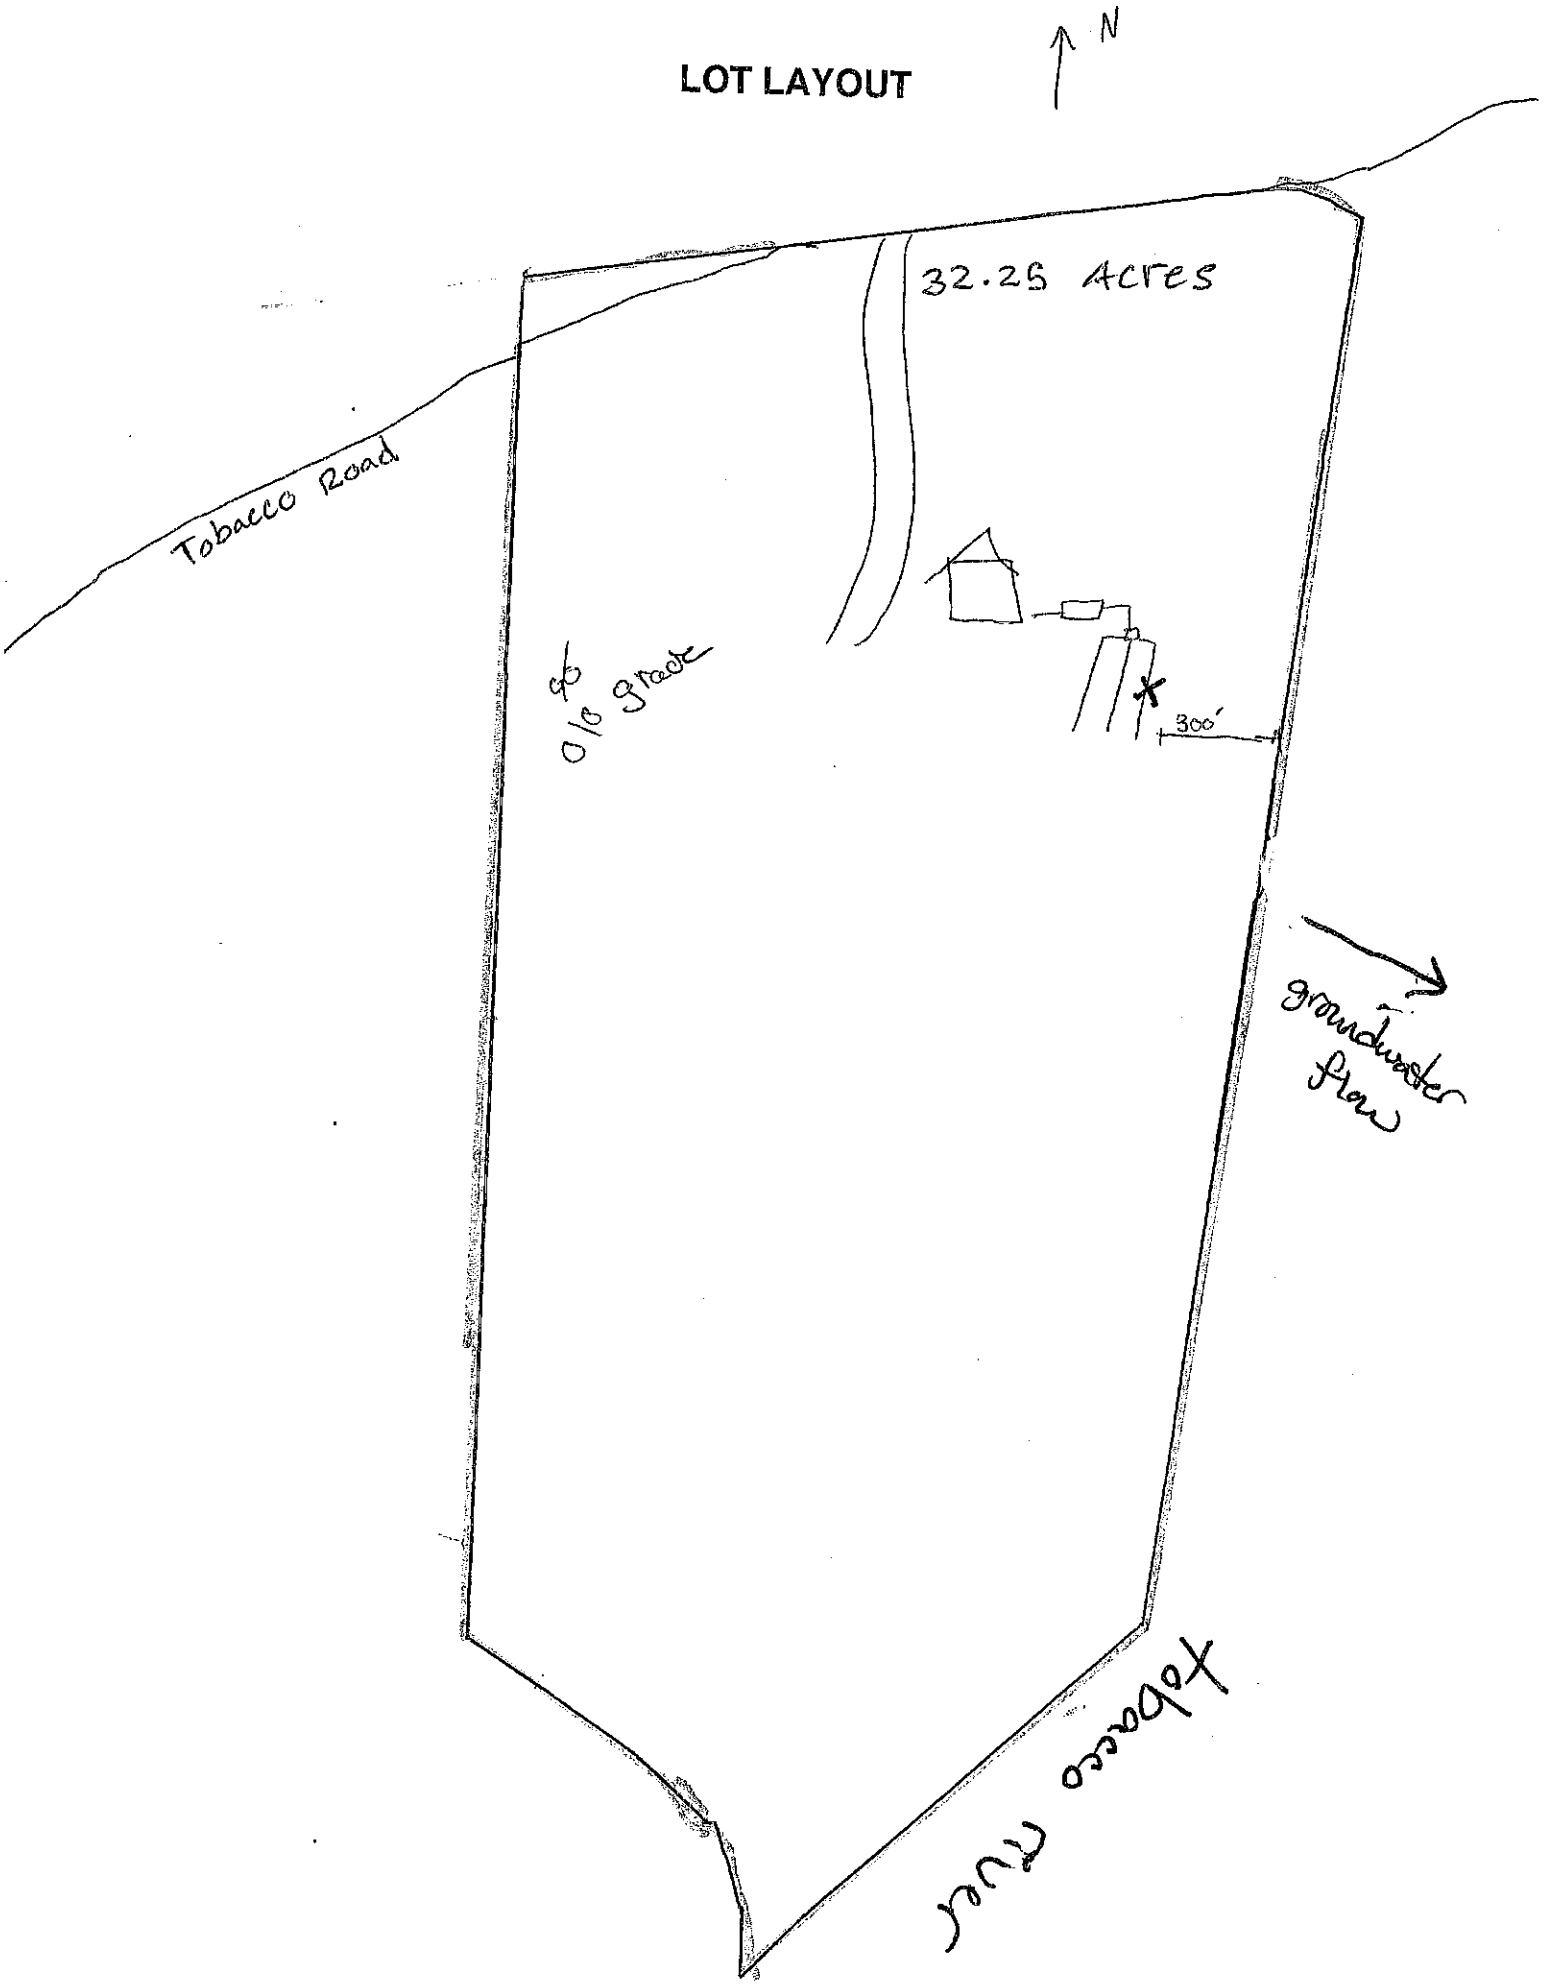
Signed: Elmer Brenneman *Date:* 11-18-2021

Title: Brenneman's Excavation

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

LOT LAYOUT


N
32.25 Acres
Tobacco Road
9%
0/0 grade
300'
groundwater flow
Tobacco River