LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 05/18/2021 Expiration Date: 05/18/2022

Property Owner: David Cortez c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Noble Excavating Inc. License No. 20

___XX New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Four 94' laterals using drain rock.

Parcel Description:

Legal: CABINET MOUNTAIN VIEWS, S27, T30 N, R31 W, ACRES 6.27, LOT 3 PM 6871

Address or Location: LOT 3

Geo/Assessors code: 0000050095

Approved Design Criteria:

Bedrooms: 2 Septic Tank Size: 1500 gallons Drainfield Size: 375 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

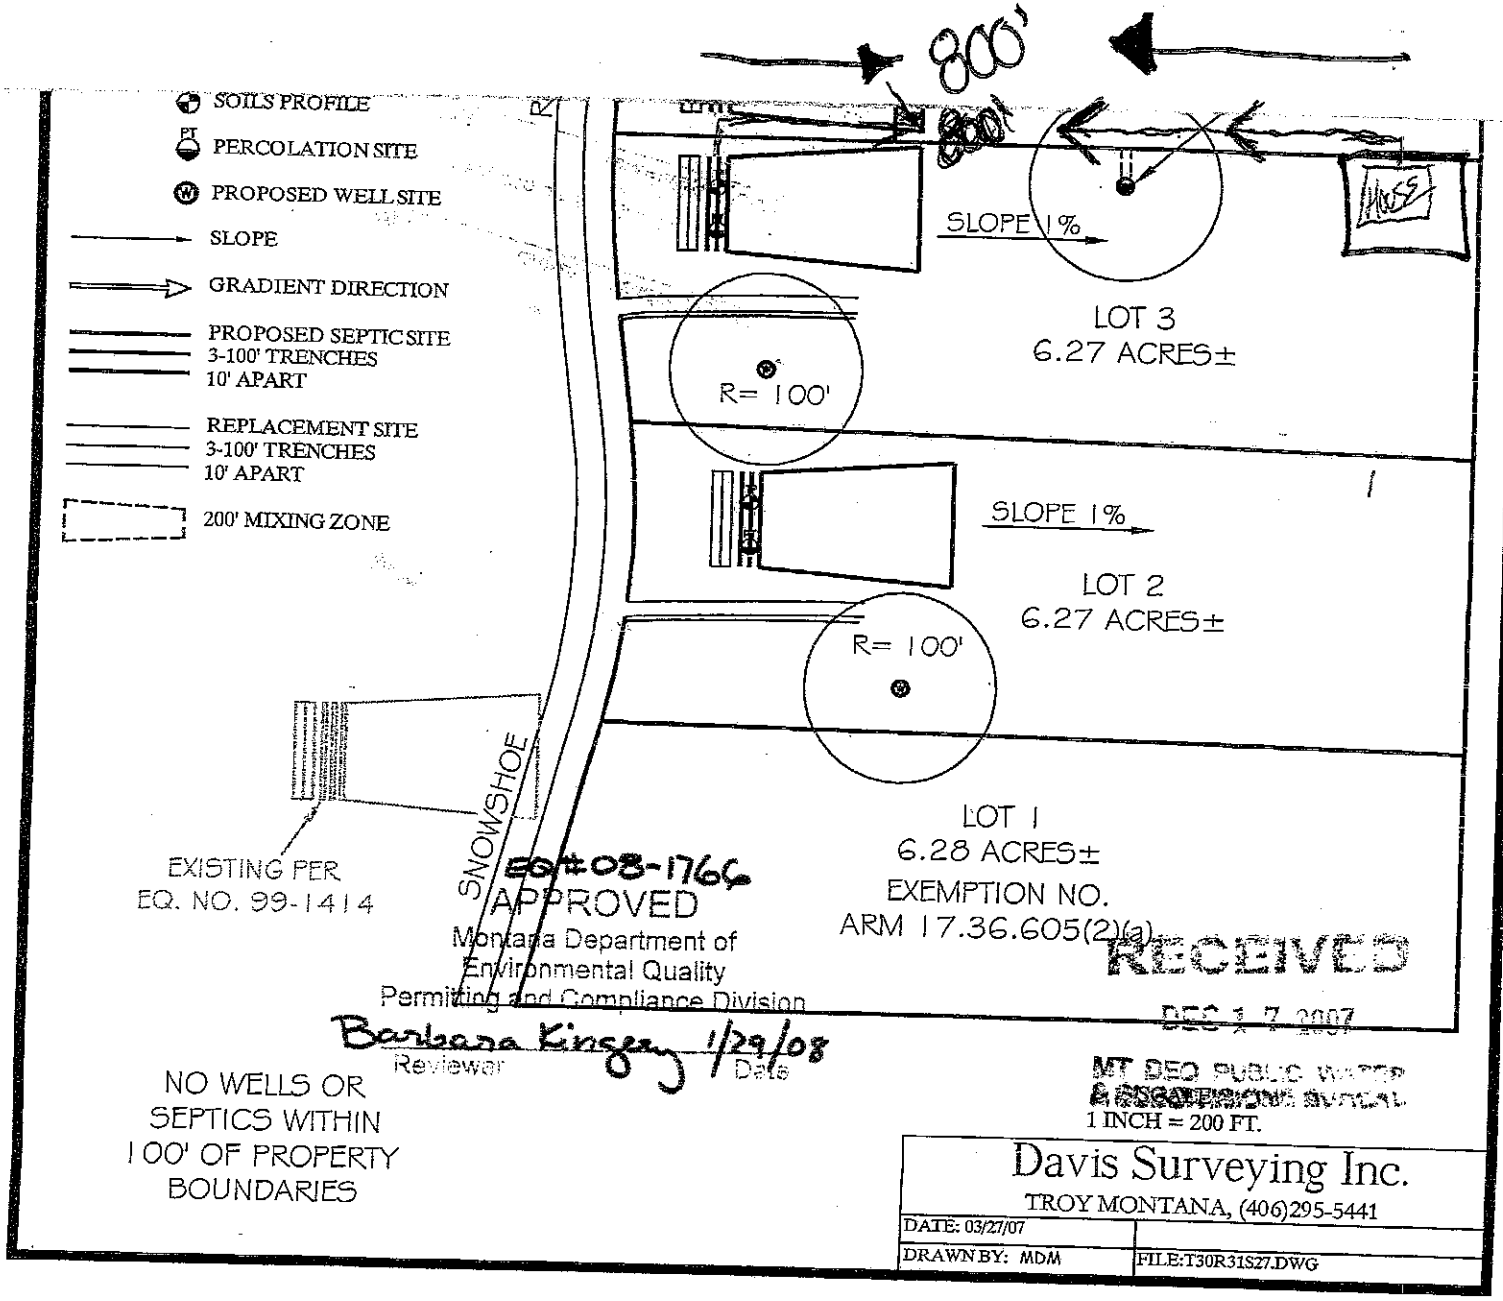
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


SOILS PROFILE
PERCOLATION SITE
PROPOSED WELL SITE
SLOPE
GRADIENT DIRECTION
PROPOSED SEPTIC SITE
3-100' TRENCHES
10' APART
REPLACEMENT SITE
3-100' TRENCHES
10' APART
200' MIXING ZONE
800'
800'
SLOPE 1%
LOT 3
6.27 ACRES±
R= 100'
SLOPE 1%
LOT 2
6.27 ACRES±
R= 100'
LOT 1
6.28 ACRES±
EXEMPTION NO.
ARM 17.36.605(2)(a)
EXISTING PER
EQ. NO. 99-1414
SNOWSHOE
EQ#08-1766
APPROVED
Montana Department of
Environmental Quality
Permitting and Compliance Division
Barbara Kingery 1/29/08
Reviewer Date
NO WELLS OR
SEPTICS WITHIN
100' OF PROPERTY
BOUNDARIES
RECEIVED
DEC 17 2007
MT DEQ PUBLIC WATER
& SEWER SECTION
1 INCH = 200 FT.
Davis Surveying Inc.
TROY MONTANA, (406)295-5441
DATE: 03/27/07
DRAWN BY: MDM
FILE:T30R31S27.DWG