LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 12/03/2019 (original)

Expiration Date: 11/16/2022 (renewal)

Property Owner: Hugh Cross

c/o: Enviro-Tech

Address: [redacted]

Telephone: [redacted] (Home)

(Work)

Installer:

License No.

__xx__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: Four 94' Laterals using drain rock and perf pipe.

Parcel Description:

Legal: S27, T36 N, R26 W, CS 3721, PARCEL 3 IN NWNW, 1.446 ACRES

Address or Location: Parcel 3

Geo/Assessors code: 0000011838

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 375 Lineal Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Kathi Hooper, R.S.

Closure Statement:

I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: _____ *Date:* _____

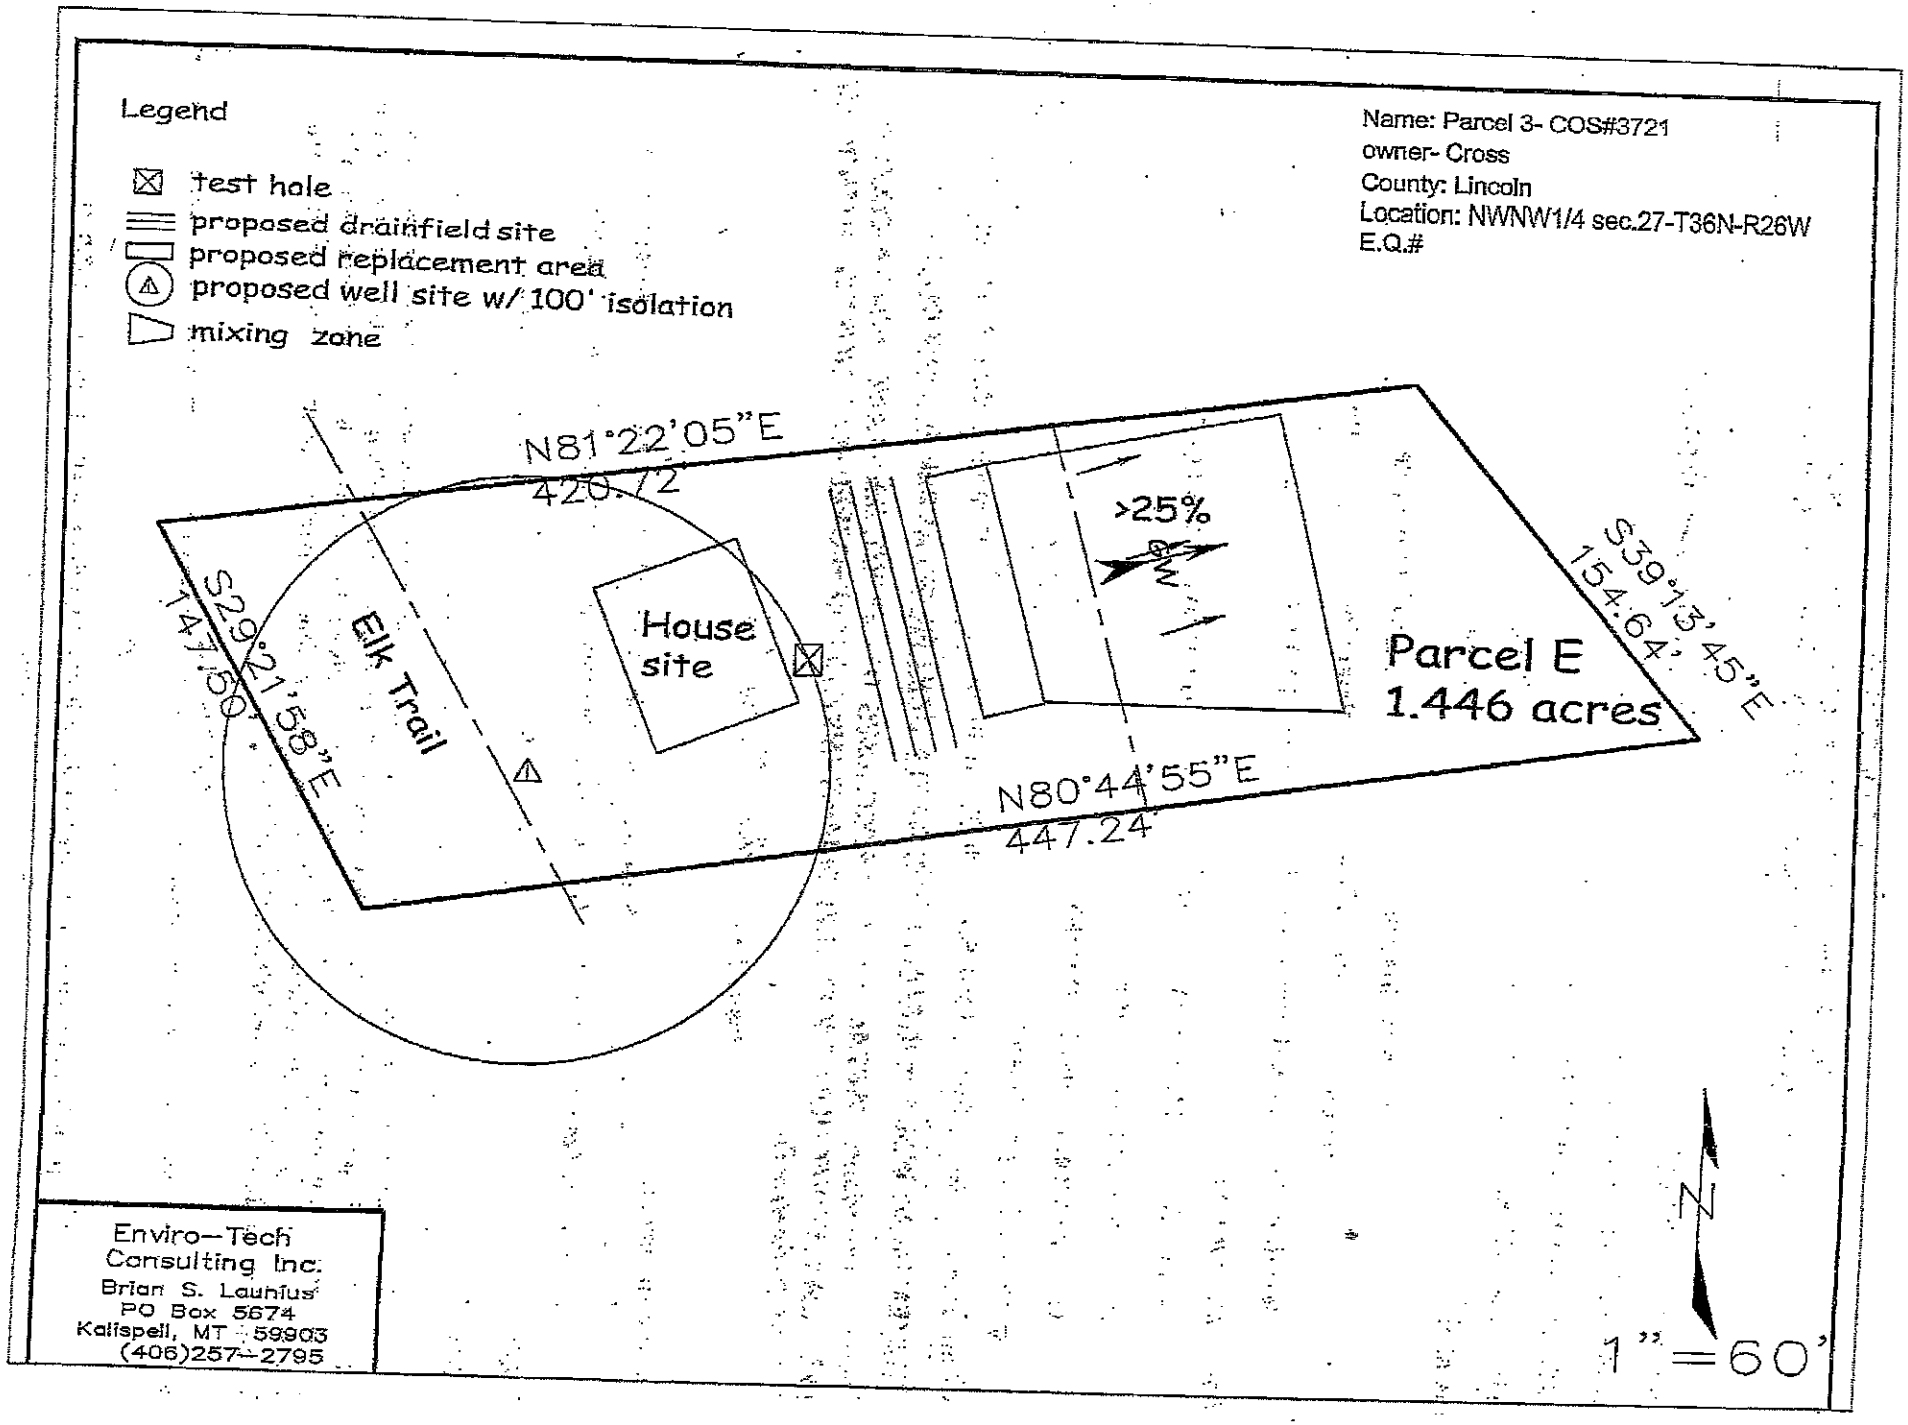
Title: _____

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Legend
test hole
proposed drainfield site
proposed replacement area
proposed well site w/ 100' isolation
mixing zone
Name: Parcel 3- COS#3721
owner- Cross
County: Lincoln
Location: NWNW1/4 sec.27-T36N-R26W
E.Q.#
N81°22'05"E
420.72
>25%
S39°13'45"E
154.64'
Parcel E
1.446 acres
House site
Elk Trail
S29°21'58"E
147.50'
N80°44'55"E
447.24
N
1"=60'
Enviro-Tech Consulting Inc.
Brian S. Launius
PO Box 5674
Kalispell, MT 59903
(406)257-2795