LINCOLN COUNTY
DEPARTMENT of ENVIRONMENTAL HEALTH
Wastewater Treatment and Disposal System
PERMIT

Installer file

Issue Date: 10-2-01 Expiration Date: 10-2-02

Property Owner: LARRY & EUFROCINA DOTSON

Address: P.O. Box 573 LIBBY, MT 59923

Telephone: (Home) 293-5417 (Work) _____

Installer: Robert E Sprague License No. 83

✓ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: _____

Parcel Description:

Legal: Kootenai Heights, 1st Add S.34 T31N R.31W

Address or Location: 298 Remps Road

Approved Design Criteria:

Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 200 lineal feet

INSTALL SYSTEM AS PER APPROVED SITE PLAN (LOT LAYOUT) AND LINCOLN COUNTY WASTEWATER REGULATION #3.

Special Instructions: _____

Issued By: John Peterson, RS

Closure Statement:

I, Robert E. Sprague have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: Robert E. Sprague Date: 7-10-2002

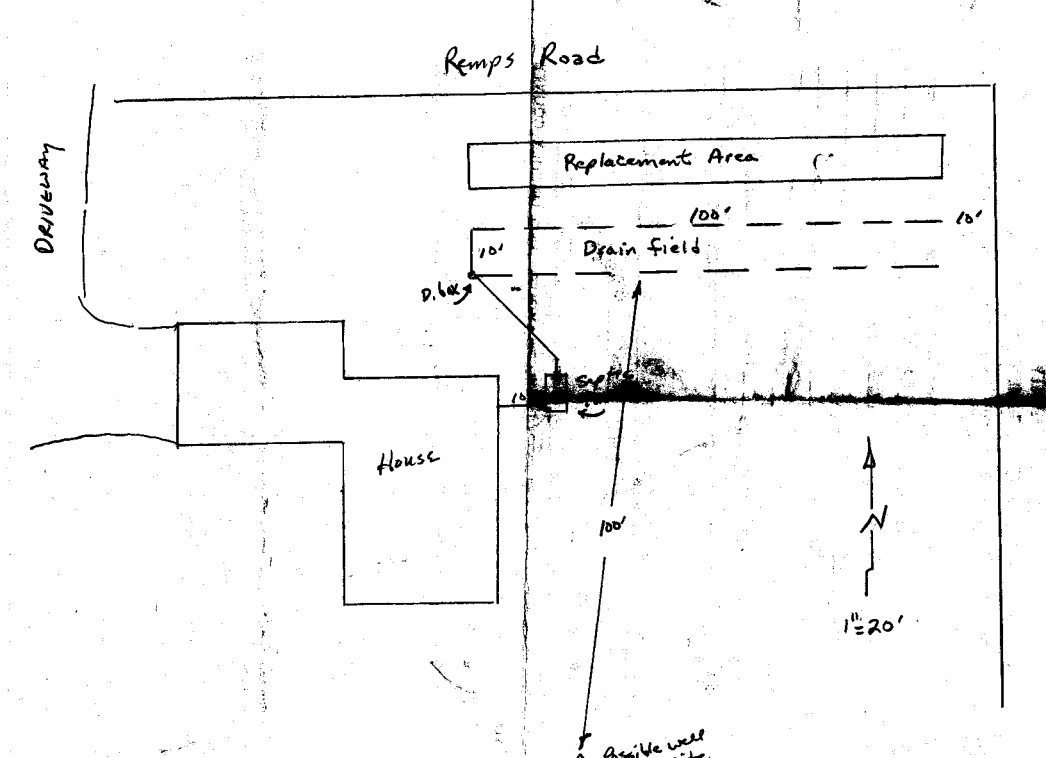
Title: installer - inspector

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulations. Such illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


Remps Road
DRIVEWAY
Replacement Area
100'
10'
10'
Drain field
D.W.
House
100'
N
1" = 20'