LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
AFFIDAVIT OF WASTEWATER TREATMENT AND DISPOSAL SYSTEM COMPLIANCE REVIEW FOR SYSTEM INSTALLED, REPAIRED OR REPLACED WITHOUT A VALID PERMIT

Issue Date: 04/29/2021 2022

Property Owner: Walter Ernst

Mailing Address: [redacted]

Telephone: [redacted] (Home) (Work)

Name of Person Who Installed System Being Reviewed: Unknown

Type of System Work Reviewed:

___ New Installation __XX__ Existing System

____ Repair __XX__ Replacement ____ Extension ____ Other

Describe: Three 68' laterals.

Property Description:

Legal: ELK MEADOWS UNIT 2, S15, T37 N, R27 W, Lot 1C, PF #5832 5.00 ACRES

Address or Location: 244 Elk Meadows Dr Eureka, MT 59917

Reviewed Design Components:

Wastewater Flows: 204/day Sewer Lines: Septic Tank: 1000 Gallons EffluentFilter:

Dosing or Lift Tank: NO Drainfield: 204 Lineal Feet Drainfield Construction: drain/wash rock CHAMBERS

Hydraulic Function: yes

Comments:

System Review Documentation Statement:

I, Kurt West, have inspected/reviewed the components of this system as listed above and found it to be in compliance with the sizing, construction, orientation and operating requirements of Chapter 17, Subchapter 9 A.R.M., Circular DEQ-4 and Lincoln County Wastewater Regulation #3.

Signed: Kurt West *Date:* 5/2/2021

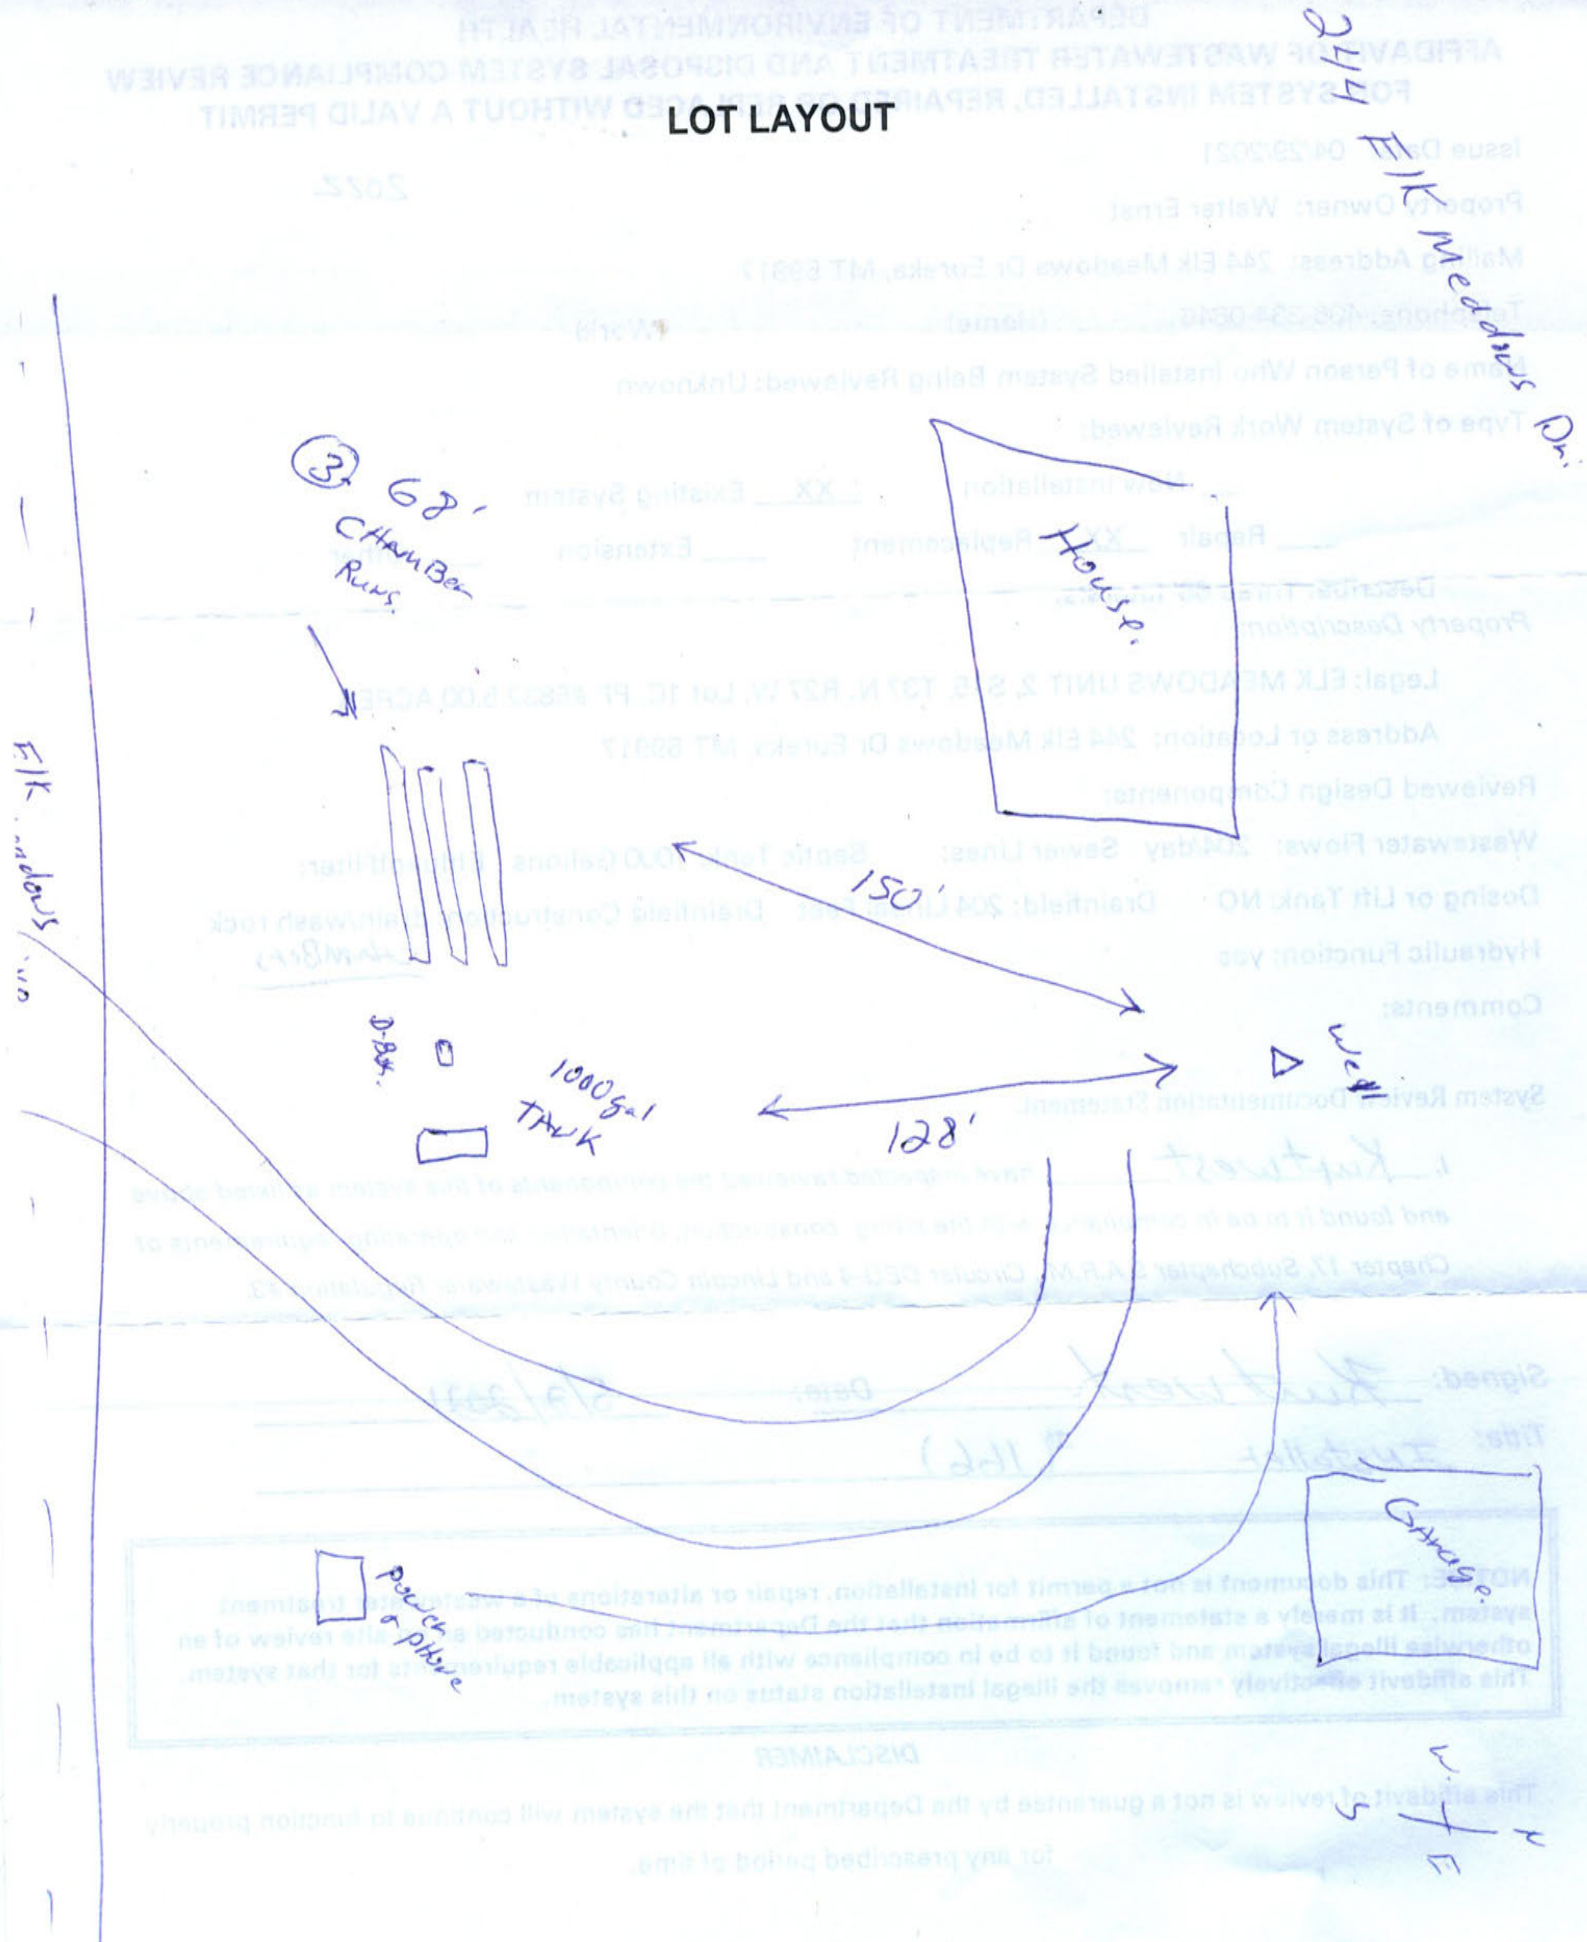
Title: Installer #(166)

NOTICE: This document is not a permit for installation, repair or alterations of a wastewater treatment system. It is merely a statement of affirmation that the Department has conducted an on-site review of an otherwise illegal system and found it to be in compliance with all applicable requirements for that system. This affidavit effectively removes the illegal installation status on this system.

DISCLAIMER

This affidavit of review is not a guarantee by the Department that the system will continue to function properly for any prescribed period of time.

LOT LAYOUT


244 Elk Meadows Dr.
Elk Meadows Dr.
68'
Channel Runs
House
150'
128'
Well
D-Box
1000 Gal Tank
Garage
Power & Phone