# LINCOLN COUNTY
# DEPARTMENT OF ENVIRONMENTAL HEALTH
# WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date:10/18/2021 Expiration Date: 10/18/2022

Property Owner: Aaron Fittery

Address: PO BOX 1559 Eureka, MT 59917

Telephone: [redacted] (Work)

Installer: Kootenai Sand & Gravel License No.109

__XX__ New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other- Renewal (MD)

Describe: Gravity System

*Parcel Description*:

Legal: S22, T34 N, R26 W, S2SWSE OR TR-5F 20.00 ACRES

Address or Location: TR-5F

Geo/Assessors code: 0000001361

*Approved Design Criteria*:

# Bedrooms 3 Septic Tank Size: 1000 gallons Drainfield Size: 375 Lineal Feet

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!**

***Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

**Issued By:** Kathi Hooper, R.S.

Closure Statement:

*I, _____, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

*Signed:* _____ *Date:* _____

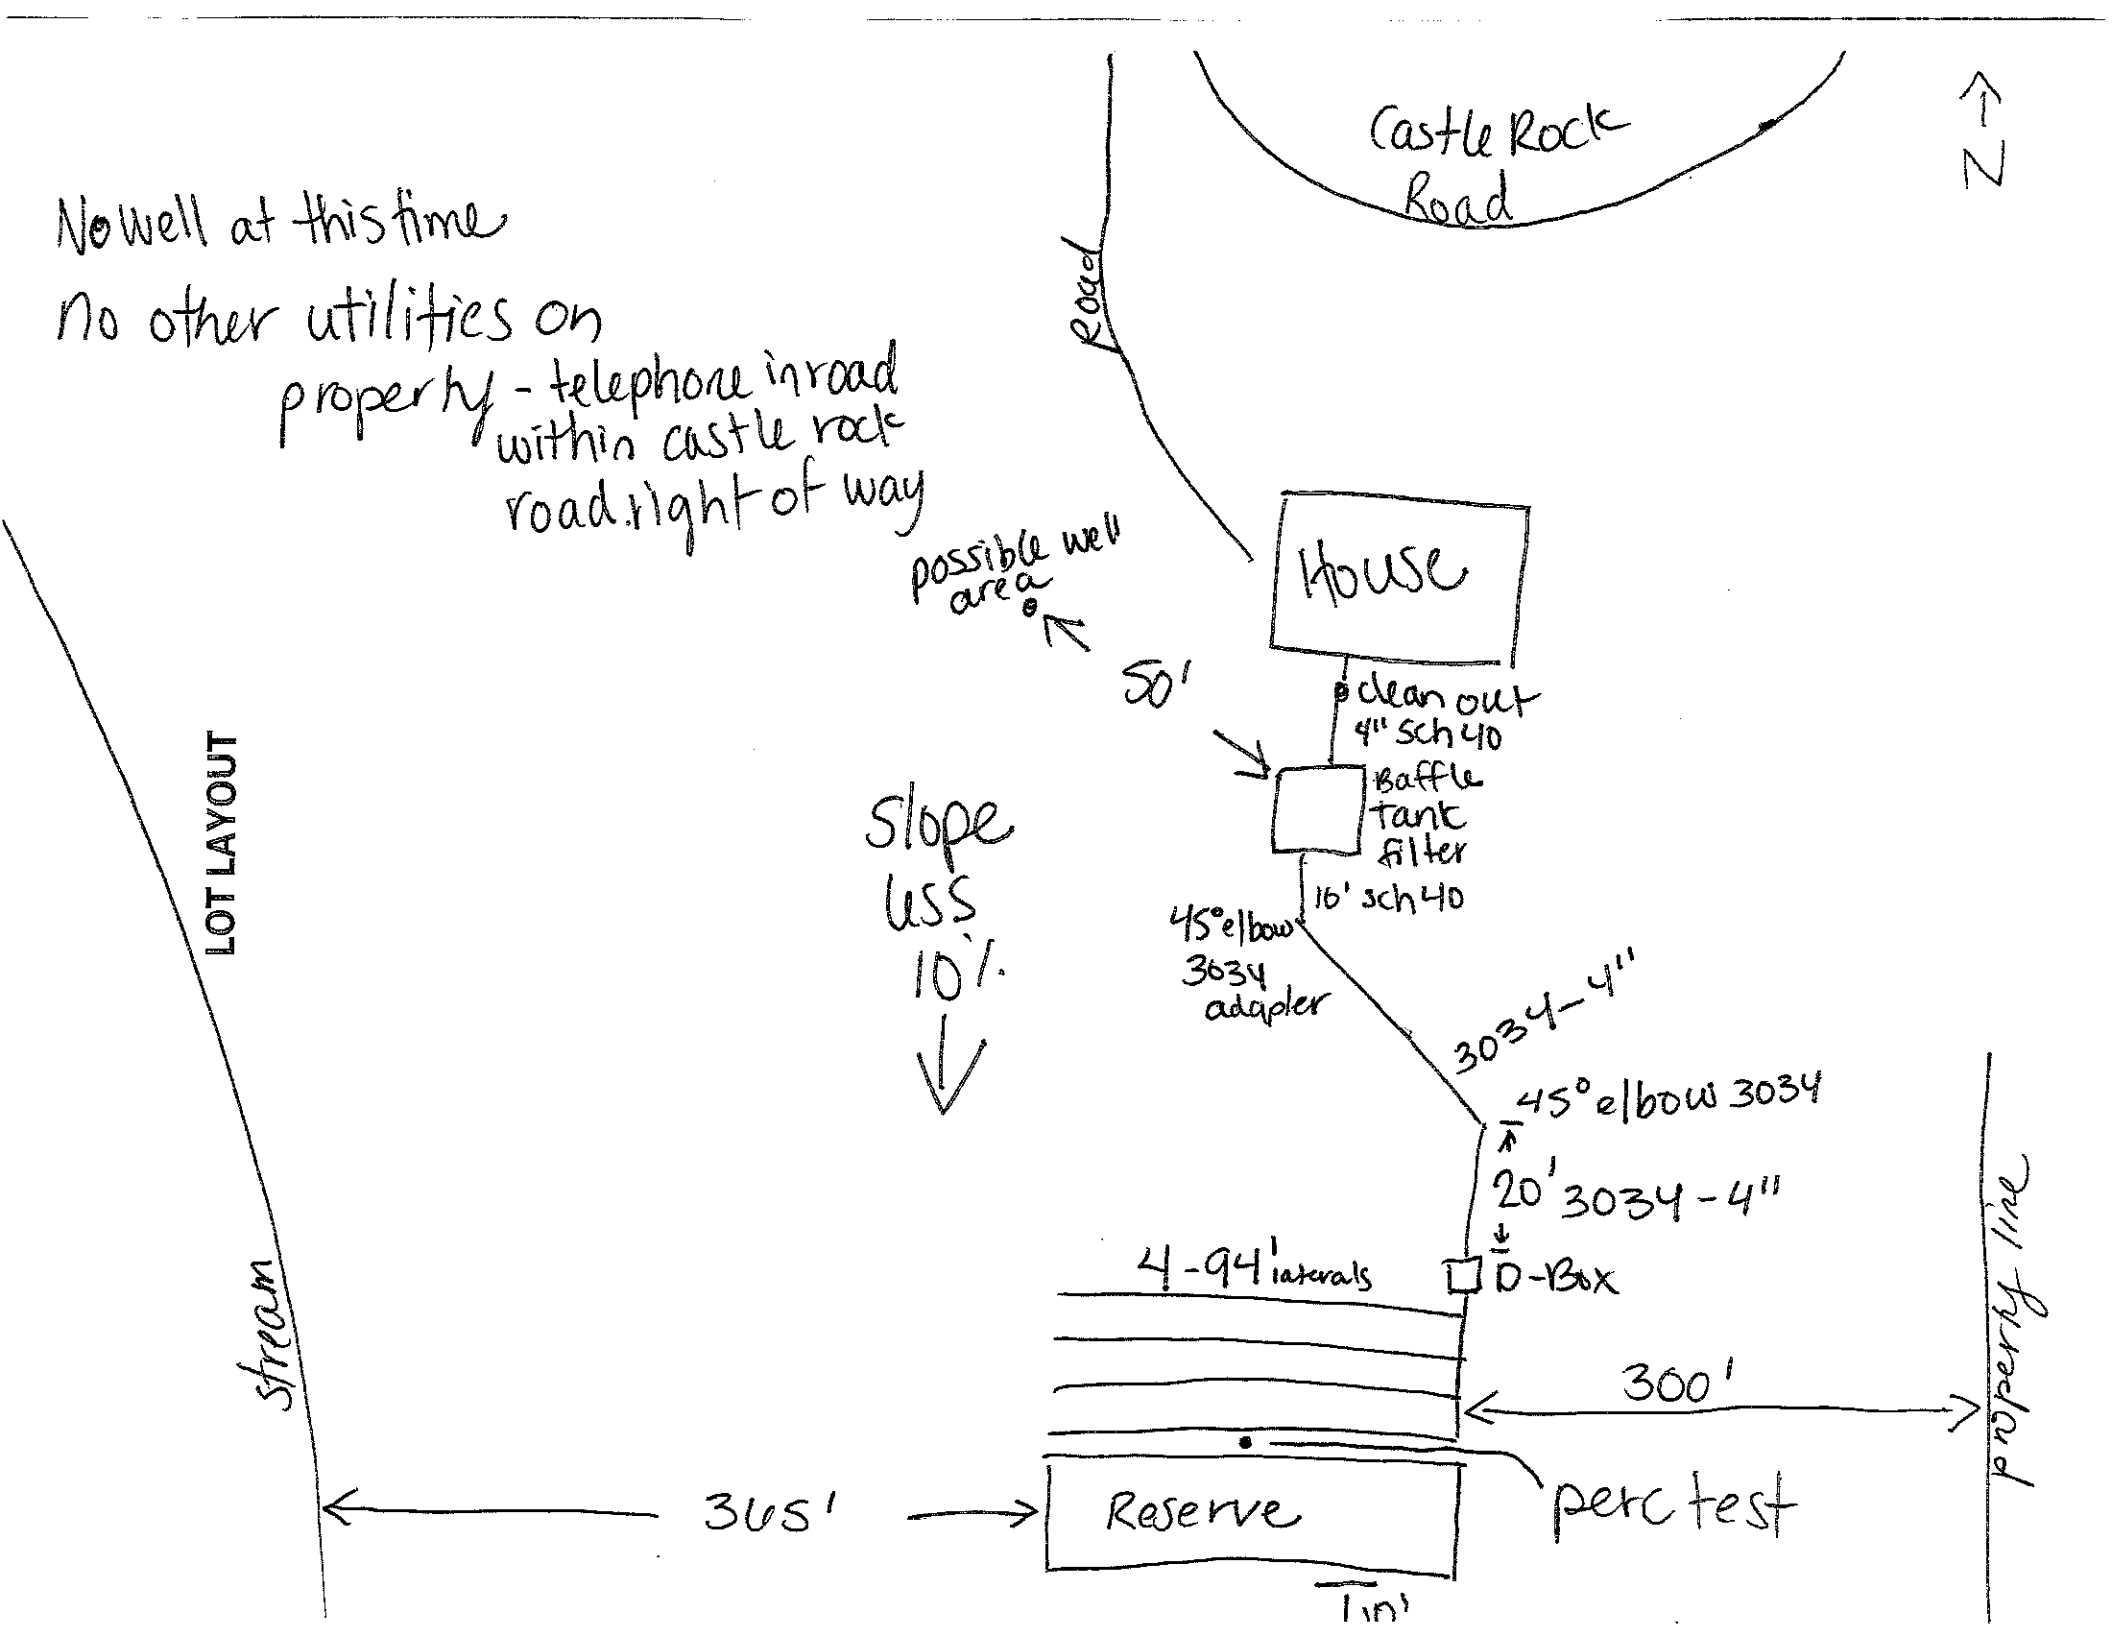
*Title:* _____

**NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

**406-283-2442**

***DISCLAIMER***

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


No well at this time
No other utilities on property - telephone in road within castle rock road right of way
Castle Rock Road
Road
N
possible well area
House
50'
clean out 4" sch 40
Baffle tank filter
10' sch 40
45° elbow 3034 adapter
3034-4"
45° elbow 3034
20' 3034-4"
D-Box
4-94' laterals
300'
property line
perc test
Reserve
100'
365'
stream
LOT LAYOUT
Slope 15% 10%