

**LINCOLN COUNTY  
DEPARTMENT OF ENVIRONMENTAL HEALTH  
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT**

Issue Date: 08/24/2021

Expiration Date: 08/24/2022

Property Owner: Lyle & Denise Flesch

c/o:

Address: PO BOX 294 Shelby, MT 59474

Telephone: [REDACTED] (Home)

(Work)

Installer: Mountain Contracting

License No. 3

☒ XX New Installation ☐ Existing System  
☐ Repair ☐ Replacement ☐ Extension ☐ Other

Describe:

*Parcel Description:*

Legal: S17, T37 N, R26 W, C.O.S. 4430, PARCEL B, ACRES 9.99

Address or Location: Parcel B

Geo/Assessors code: 0000056036

*Approved Design Criteria:*

# Bedrooms: 3 Septic Tank Size: 1500 gallons Drainfield Size: 375 Lineal Feet

**SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!**

***Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.***

Issued By: *Kathi Hooper, R.S.*

Closure Statement

I, Richard Luciano, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.

Signed: [Signature] Date: 9/1/2021


Title: Installer

**NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.**

406-283-2442

**DISCLAIMER**

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

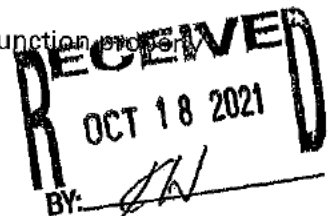

Electric Gas meter

Manifold

Replacement Area

4 = 24" Insulation Chambers x 95' Pressure lines

5/16 Drilled holes every 5'

End of Chambers with blow off valves

2% grade slope

4 Adjustable Valves

2" x 12'

200'

2 inch Supply to manifold

1 way Check Valve

3 bed House

Garage

House

Driveway

100'

Well

100' To Field

22 1/2' angle

100' To Tank

Audio Visual Alarm

EF40 Pump

500 G

1000

Electric line for pump

Intert

Saltic Tank

AS per CAS & DEQ Standards

RECEIVED

100' x 100'

As per  
CAS & IEC  
Standards

