LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Paid $50
Lori Kelley-Bowe

Issue Date: 9/20/2007 Expiration Date: 9/20/2008

Property Owner: Harry & William Flock c/o:

Address: [redacted]

Telephone: [redacted] (Work)

Installer: Harry Flock License No.

Proposed Work: (Check One) ☒ New Installation ☐ Existing System

☐ Repair ☐ Replacement ☐ Extension ☐ Other _____

Describe:

Parcel Description:

Legal: S35 T36N R32W

Address or Location: Lot 1 of Sue's Acres

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: 200 lineal feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Lori Kelley-Bowe, S.I.T.

Closure Statement:

I, Lori Kelley-Bowe *, have* ~~inspected~~ reviewed *this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Lori Kelley-Bowe *Date:* 10-9-07

Title: Sanitarian-in-training

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-293-7781 x228

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.


LINCOLN COUNTY

LOT LAYOUT

SUE'S ACRES

NOVEMBER 2000

RECEIVED
OFFICE
JAN - 5 2001
MT DEPT OF ENV QUALITY
PERMITTING & COMPLIANCE DIV

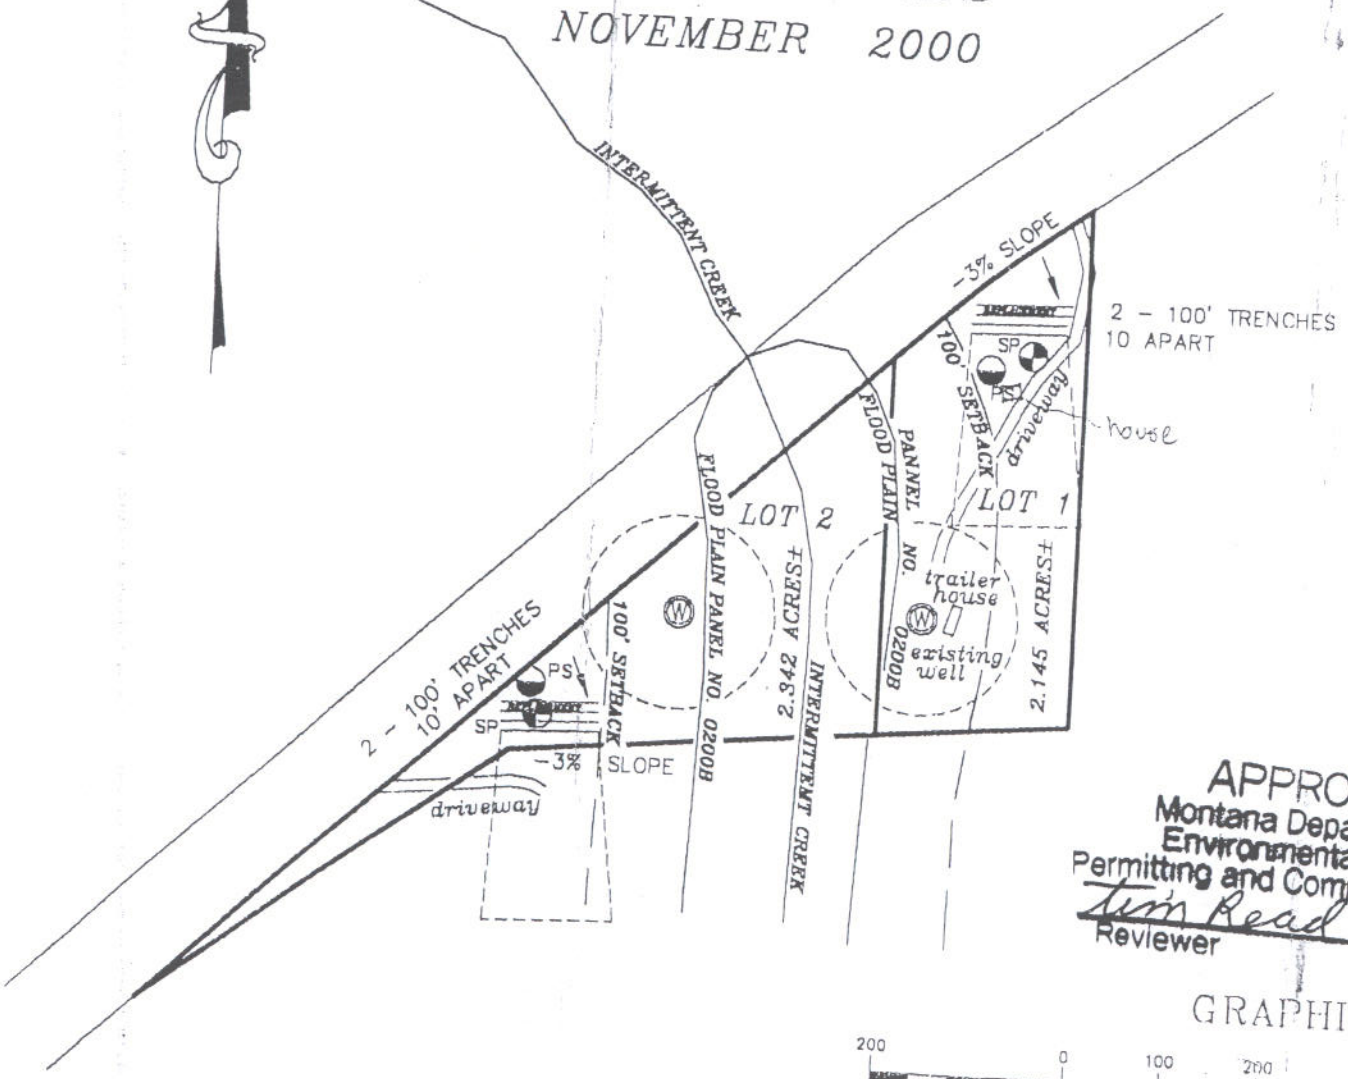

LEGEND

- SP — Soil Profile
- PS — Percolation Site
- Proposed Septic Site
- Replacement Site
- Slope
- W — Proposed Well Site

APPROVED
Montana Department of
Environmental Quality
Permitting and Compliance Division
Tim Read 1-10-2001
Reviewer Date

GRAPHIC SCALE

200 0 100 200 400

(IN FEET)