LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 08/08/2021 Expiration Date: 02/08/2022

Property Owner: Lety Fry c/o:

Address: [redacted]

Telephone: [redacted] (Home) (Work)

Installer: Brenneman's Excavation License No. 170

___ New Installation ___ Existing System

____ Repair __XX__ Replacement ____ Extension ____ Other

Describe: Two ~~65~~ 100' laterals using chambers.

Parcel Description:

Legal: S06, T36 N, R27 W, C.O.S. CS 868, PARCEL A, ACRES 4.97, or S2SWNESW

Address or Location: 1829 DOUGLAS HILL RD EUREKA MT 59917

Geo/Assessors code: 0000010494

Approved Design Criteria:

Bedrooms: 3 Septic Tank Size: 1000 gallons Drainfield Size: ~~130 Lineal Feet.~~ 200 LINEAL FEET

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Jake Mertes, R.S.

Closure Statement:

I, Elmer Brenneman, *have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: Elmer Brenneman *Date:* 4-10-2021

Title: Brenneman's Excavation

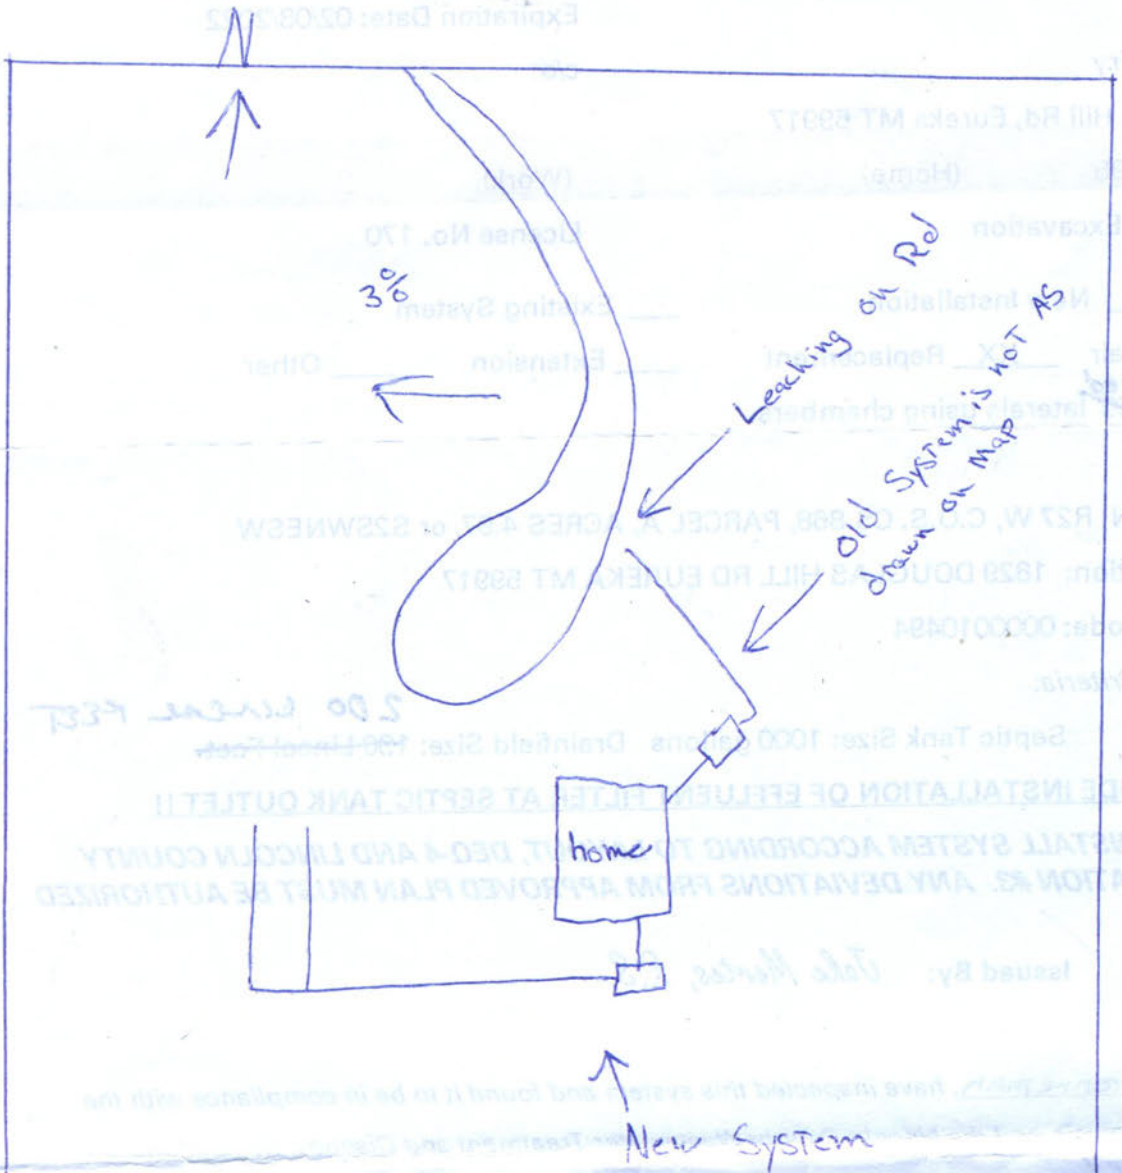
NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.

406-283-2442

DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

LOT LAYOUT


3%
Leaching on Rd
Old System is not as drawn on Map
home
New System