LINCOLN COUNTY
DEPARTMENT OF ENVIRONMENTAL HEALTH
WASTEWATER TREATMENT AND DISPOSAL SYSTEM PERMIT

Issue Date: 12/16/2021 Expiration Date: 12/16/2022

Property Owner: Edward Geneau c/o:

Address: [redacted]

Telephone: [redacted]

Installer: Koocanusa Excavating, LLC. License No. 135

XX New Installation ____ Existing System

____ Repair ____ Replacement ____ Extension ____ Other

Describe: 1,500 gallon septic tank with effluent filter. Gravity feed system with gravelless trenches (infiltrators). 4 laterals at 50-feet each in length.

Parcel Description:

Legal: S11, T36N, R27W, LOT 1A Mill Springs, PM 4704

Address or Location: 125 Spring Ln. Eureka, MT 59917

Geo/Assessors code: 0000014806

Approved Design Criteria:

Bedrooms 4 Septic Tank Size: 1,500 gallon Drainfield Size: 200 Linear Feet

SYSTEM MUST INCLUDE INSTALLATION OF EFFLUENT FILTER AT SEPTIC TANK OUTLET !!

Special Instructions: INSTALL SYSTEM ACCORDING TO LAYOUT, DEQ-4 AND LINCOLN COUNTY WASTEWATER REGULATION #3. ANY DEVIATIONS FROM APPROVED PLAN MUST BE AUTHORIZED BY THE DEPARTMENT.

Issued By: Nicholas Raines

Closure Statement:

I, Buck Schermerhorn *, have inspected this system and found it to be in compliance with the conditions of the permit, and the Lincoln County Wastewater Treatment and Disposal Regulation.*

Signed: [signature] *Date:* 12/2/22


Title: President

NOTICE: The Department must be notified at least 48 hours prior to backfilling the system. Any system not inspected by the Department or its designated representative prior to closure is an illegal installation in violation of Lincoln County Health Board Regulation No. 3. Illegal installations may result in fines and/or requirements to remove or reconstruct the system.
406-283-2442


DISCLAIMER

This permit is not a guarantee by the Department that the system will function properly for a prescribed period of time.

SV

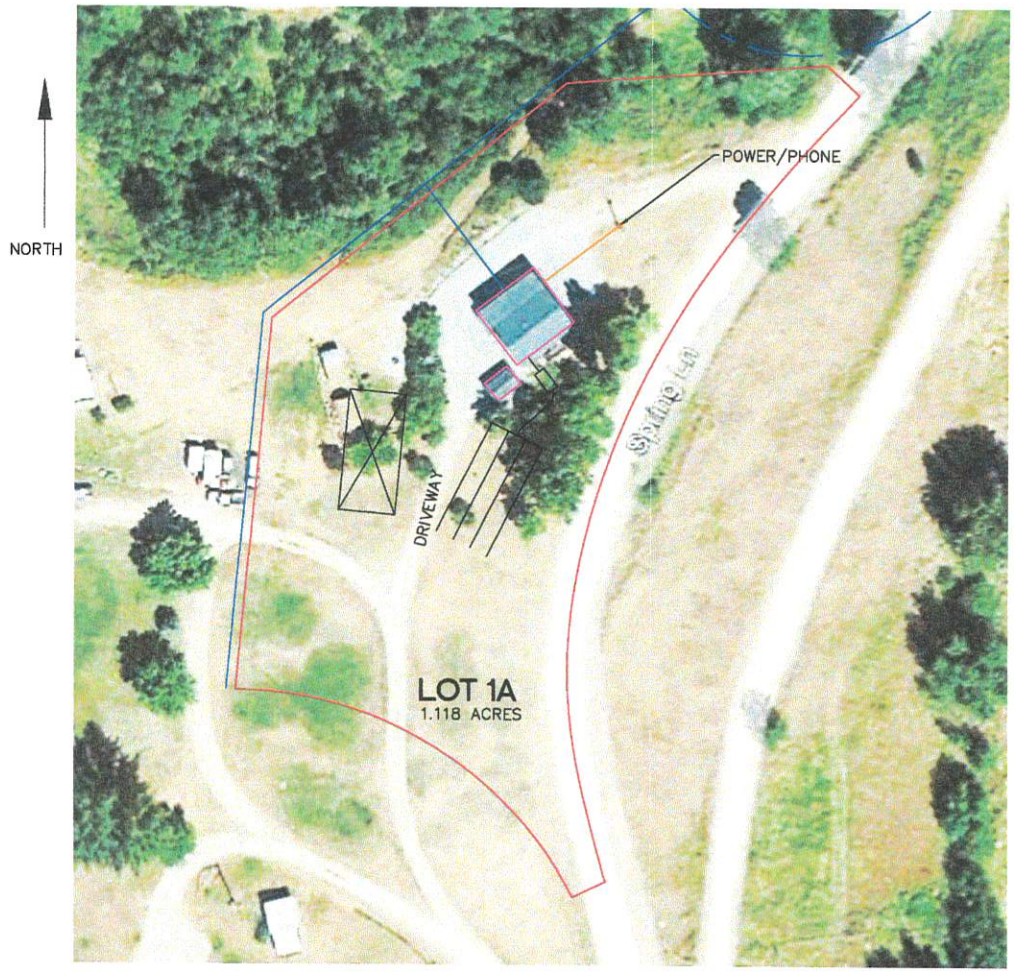

EDWARD GENEAU SITE MAP

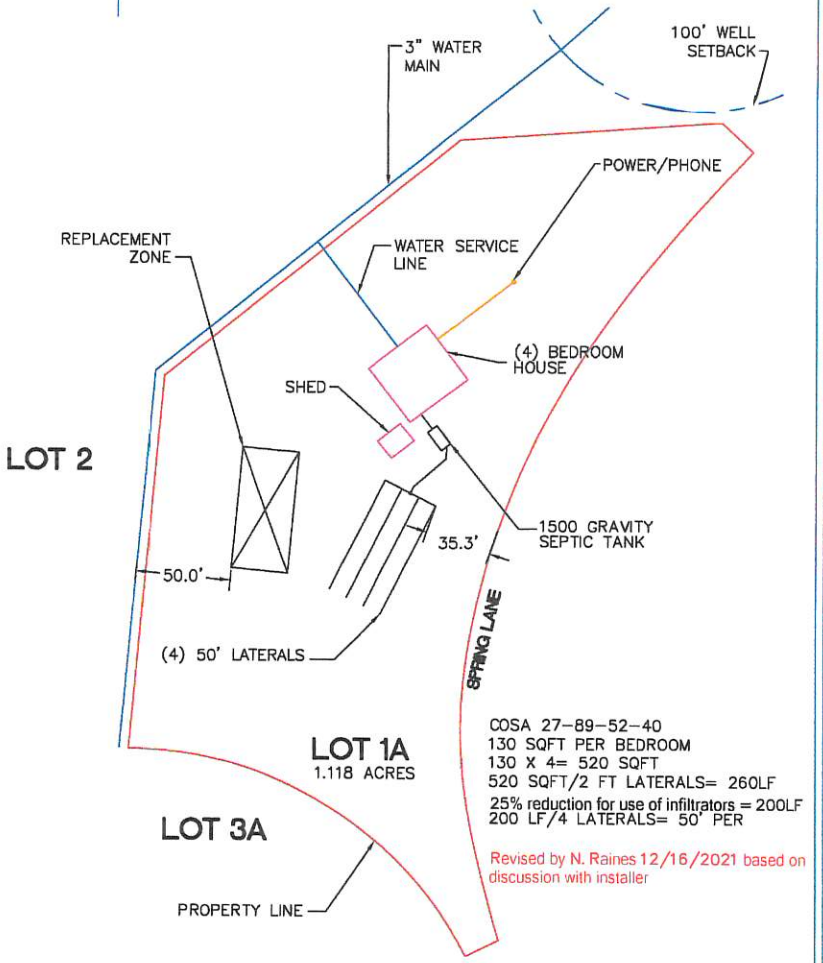

EDWARD GENEAU SITE MAP

THIS DRAWING IS PROPERTY OF KEI LAND. CONTRACT HAS BEEN SECURED BETWEEN OWNER & KEI IT CAN NOT BE SUBMITTED TO ANY OTHER PARTIES WITHOUT WRITTEN APPROVAL FROM KEI MANAGEMENT

REVI. DATE	COMPANY	SCALE:	KOOCANUSA EXCAVATING GENEAU SEPTIC
	KEI	1/16 & NOTED	REPLACEMENT
	CONTRACT:	DATE:	12/15/21
	VERBAL	12/2021	
	PLOT FILE:	WEIGHT	S. MCNAMARA 12/15/21
	PML-0001		299-001 1

⑥ ⑤ ④ ③ ②